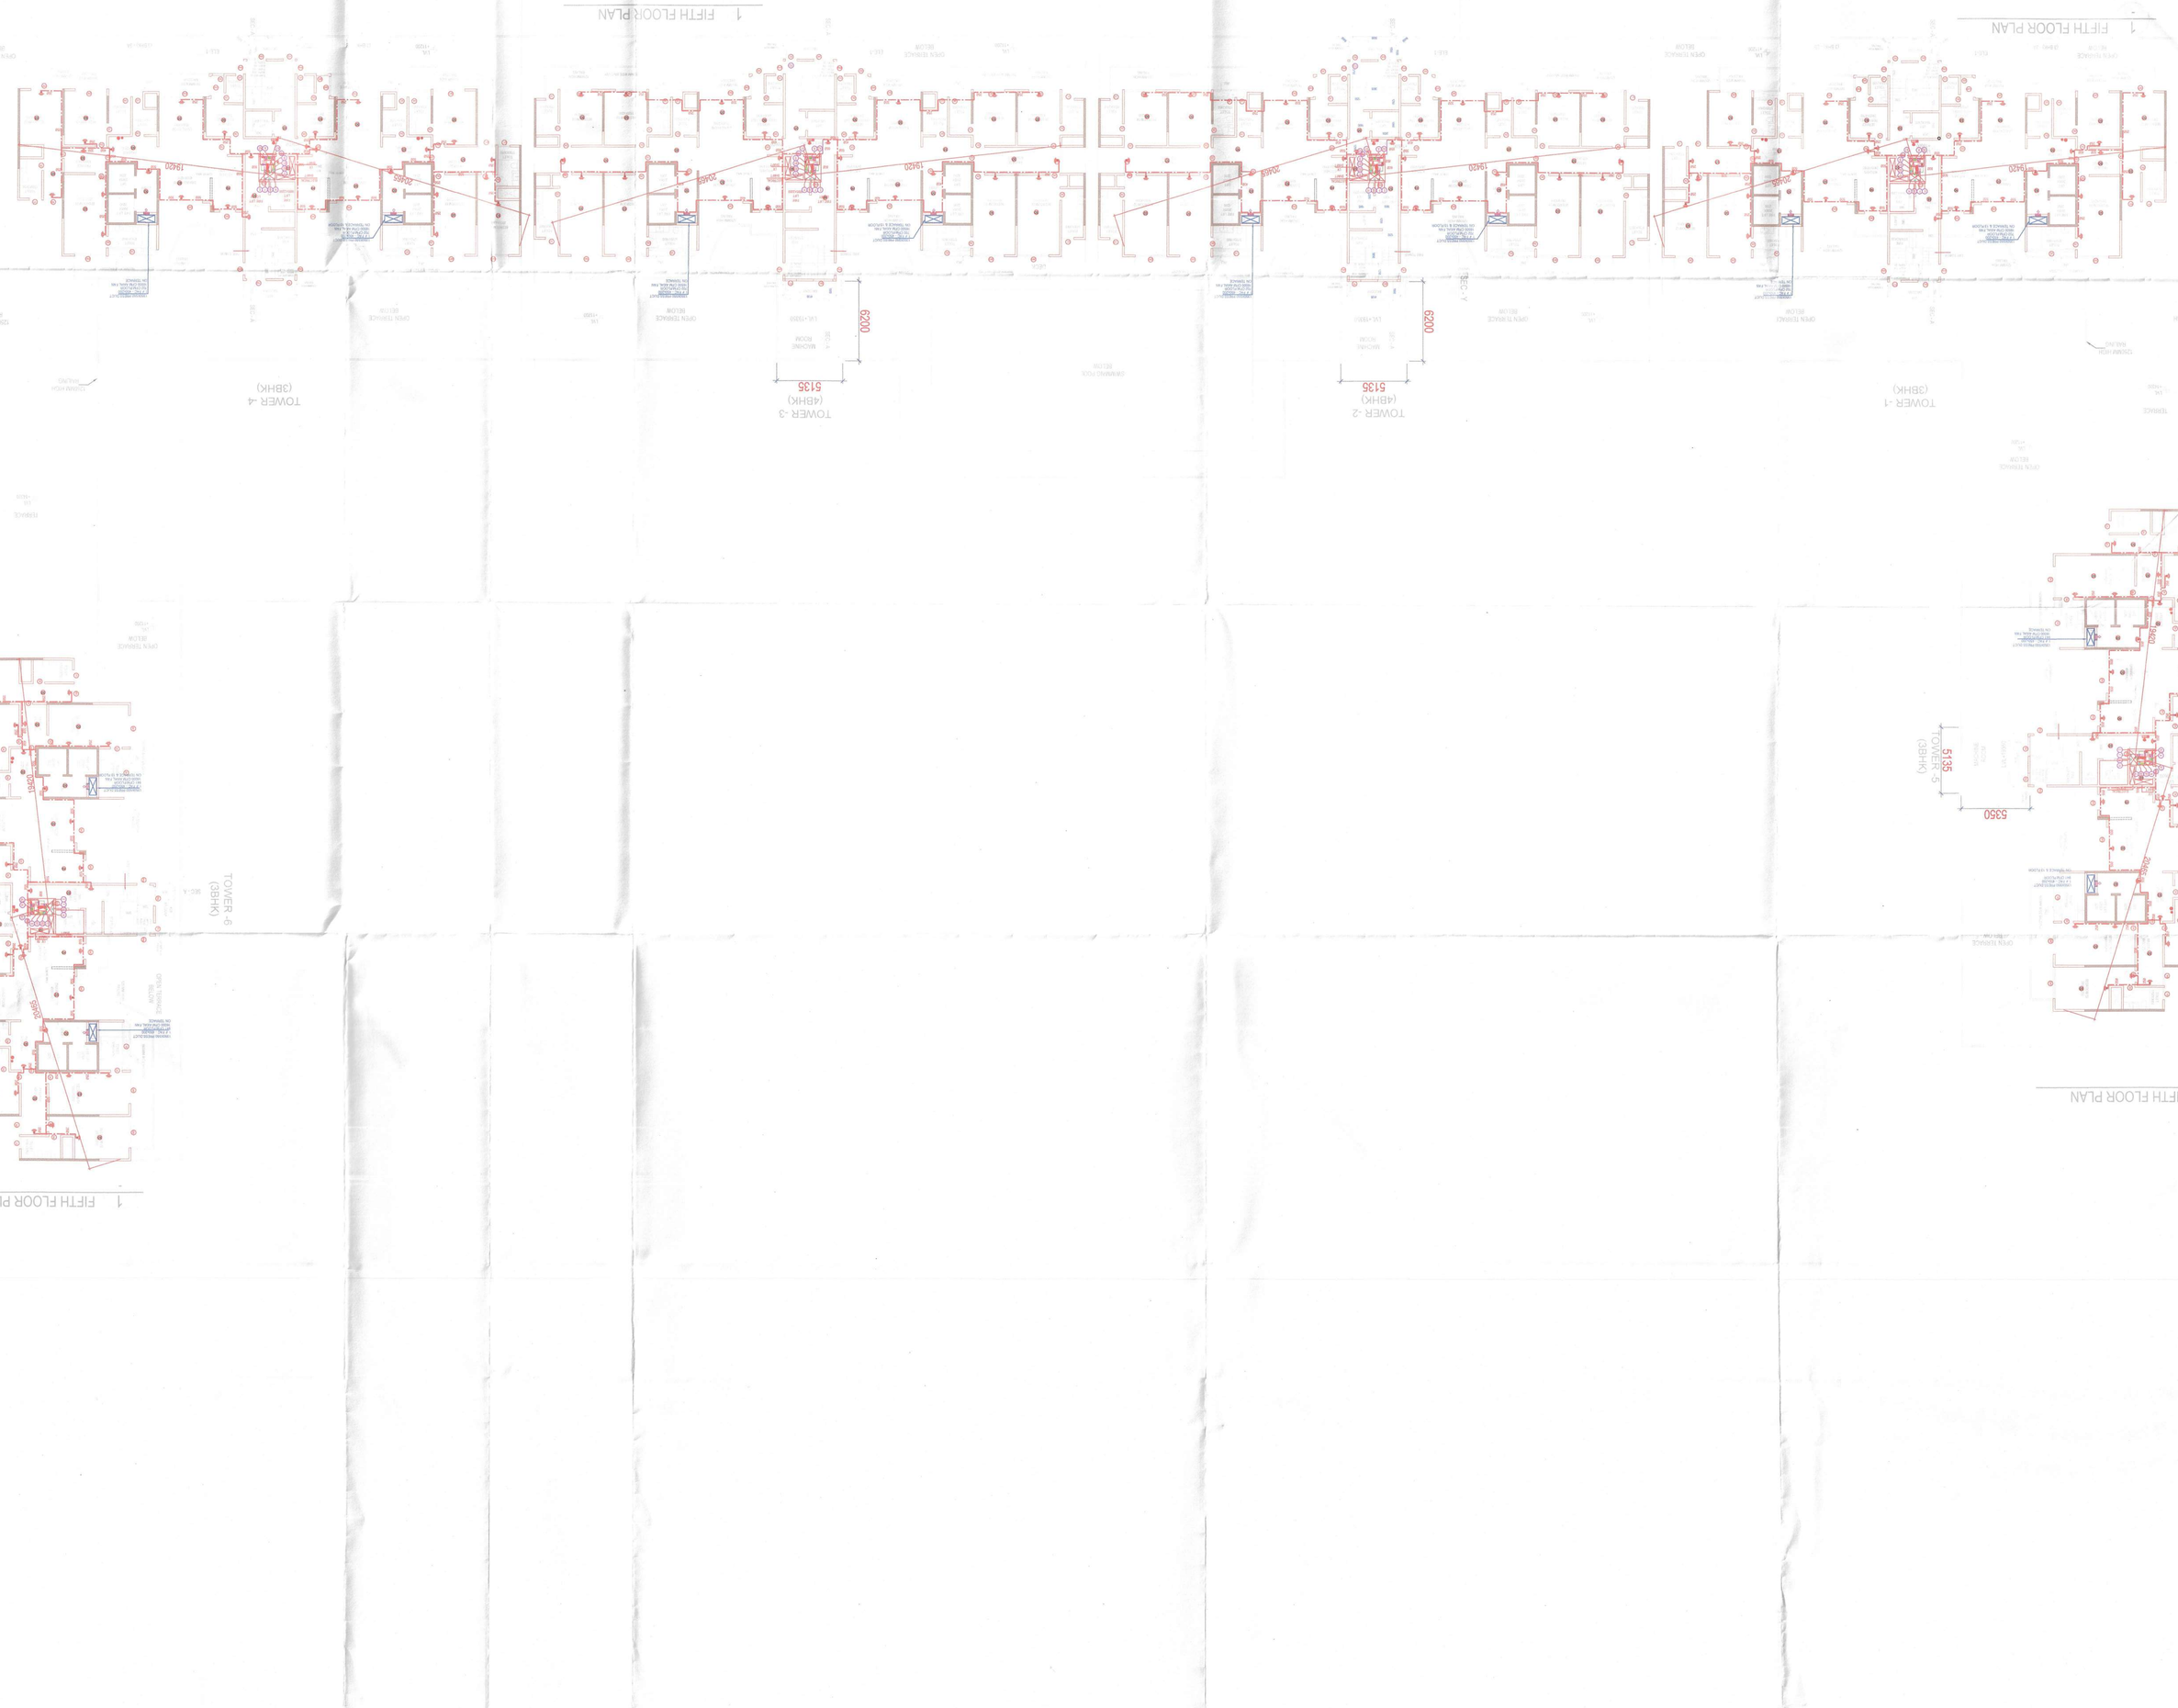


FIRE LEGEND:

SYMBOL	DESCRIPTION
A	150Ø M.S. LOW PRESSURE RWT RISER PIPE FOR GROUND TO 11TH FLOOR
A1	150Ø M.S. HIGH PRESSURE RWT RISER PIPE FOR 12TH TO 23RD LEVEL
A2	150Ø M.S. HIGH PRESSURE RWT WET RISER PIPE FOR 24TH TO 35TH LEVEL
A3	150Ø M.S. RWT DOWN COMER PIPE
A4	150Ø M.S. LOW PRESSURE SPRINKLER RISER PIPE FOR TERRACE TO 35TH FLOOR
S	FOR GROUND TO 11TH FLOOR
B1	150Ø M.S. HIGH PRESSURE SPRINKLER RISER PIPE FOR 12TH TO 23RD LEVEL
B2	150Ø M.S. HIGH PRESSURE SPRINKLER RISER PIPE FOR 24TH TO 35TH LEVEL
B3	150Ø M.S. SPRINKLER DOWN COMER PIPE FOR TERRACE TO 35TH FLOOR
C	80Ø M.S. DRAIN PIPE
D	DOMESTIC WATER SUPPLY RISER PIPE
FHC	FIRE HOSE CABINET
	FLOW SWITCH
	PENDENT TYPE SPRINKLER
	UPRIGHT TYPE SPRINKLER
	SIDE WALL TYPE SPRINKLER
	EXTENDED SIDE WALL TYPE SPRINKLER
E	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE FROM GROUND TO 11TH LEVEL
F	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE ALTERNATE PIPE FOR 23TH LEVEL
G	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE ALTERNATE PIPE FOR 24TH 35TH LEVEL
H	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE ALTERNATE PIPE FOR 36TH TO TERRACE

DOOR/WINDOW SCHEDULE

S. No.	TYPE	WIDTH (MM)	CILL (MM)	LINTEL (MM)	HEIGHT (MM)
1	CD1	2100	0 OF	+2400	2400
2	CD	1900	0 OF	+2400	2400
3	DD	1200	0 OF	+2400	2400
4	DA	900	0 OF	+2400	2400
5	HD	1200	0 OF	+2400	2400
6	FD	900	0 OF	+2400	2400
7	FDA	1200	0 OF	+2400	2400
8	VW	1500	ASI/ ELEVATION		
9	V3	600	+1500	+2400	900
10	OP	1800	OPENABLE PANEL ASI/ ELEVATION		

DOOR/WINDOW SCHEDULE

S. No.	TYPE	WIDTH (MM)	CILL (MM)	LINTEL (MM)	HEIGHT (MM)
1	DZ	1800	0 OF	+2400	2400
2	DD	1200	0 OF	+2400	2400
3	DA	900	0 OF	+2400	2400
4	DS	750	0 OF	+2400	2400
5	DWH	2450	0 OF	+2400	2400
6	DWZ	3400	0 OF	+2400	2400
7	DWD	1200	0 OF	+2400	2400
8	DWS	1500	0 OF	+2400	2400
9	FD	900	0 OF	+2400	2400
10	FDZ	550	0 OF	+2100	2100
11	FDH	1200	0 OF	+2100	2100
12	GH	800	0 OF	+2400	2400
13	WH	2000	+900	+2400	1500
14	WZ	2450	+900	+2400	1500
15	WD	1200	+900	+2400	1500
16	WH4	1000	ASI/ ELEVATION		
17	VW	500	+900	+2400	1500
18	V1	300	+1500	+2400	900
19	V2	600	+1500	+2400	900
20	V3	600	+1500	+2400	900
21	V4	1700	+1500	+2400	900
22	V5	3700	+1500	+2400	900

NOTE : LINTEL LEVEL OF TOP FLOOR/REFUGE FLOOR WALL BE 2400mm
D3 IS HRE RATED & FD,FDZ & FDZ ARE 2 HR FIRE RATED

REVISED BUILDING PLANS FOR MIXED LAND USE COLONY (95% RESIDENTIAL COMPONENT) UNDER 5% COMMERCIAL COMPONENT) UNDER TRANSIT ORIENTED DEVELOPMENT POLICY. (TOD)FOR THE AREA MEASURING 8.3437 ACRES (LICENSE NO. 127 OF 2023 DATED 16/06/2023) IN SECTOR-84, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY GANGA GLOBAL HOMES PVT.LTD.

LC - 4946

OWNERS' SIGNATURE

ARCHITECT' SIGNATURE

Avanija Vashisth
CA/2018/91670

DRAWING TITLE
COMBINED BLOCK (TOWER 1- 6)

FIFTH FLOOR PLAN
FIRE SUBMISSION DRAWING

NORTH

ARCHITECT
GANGA REALTY - DESIGN TEAM
GANGA REALTY
Vidaa Tower, Golf Course Road
Gurugram, Haryana

DATE JULY, 2025

SCALE 1:100 @ A1

DEALT Fire Fighting Scheme is Verified by Vide Letter No. 2881 Dated 01.12.25

CHECKED Dated ... (HO) FSO (RO)

S - 215