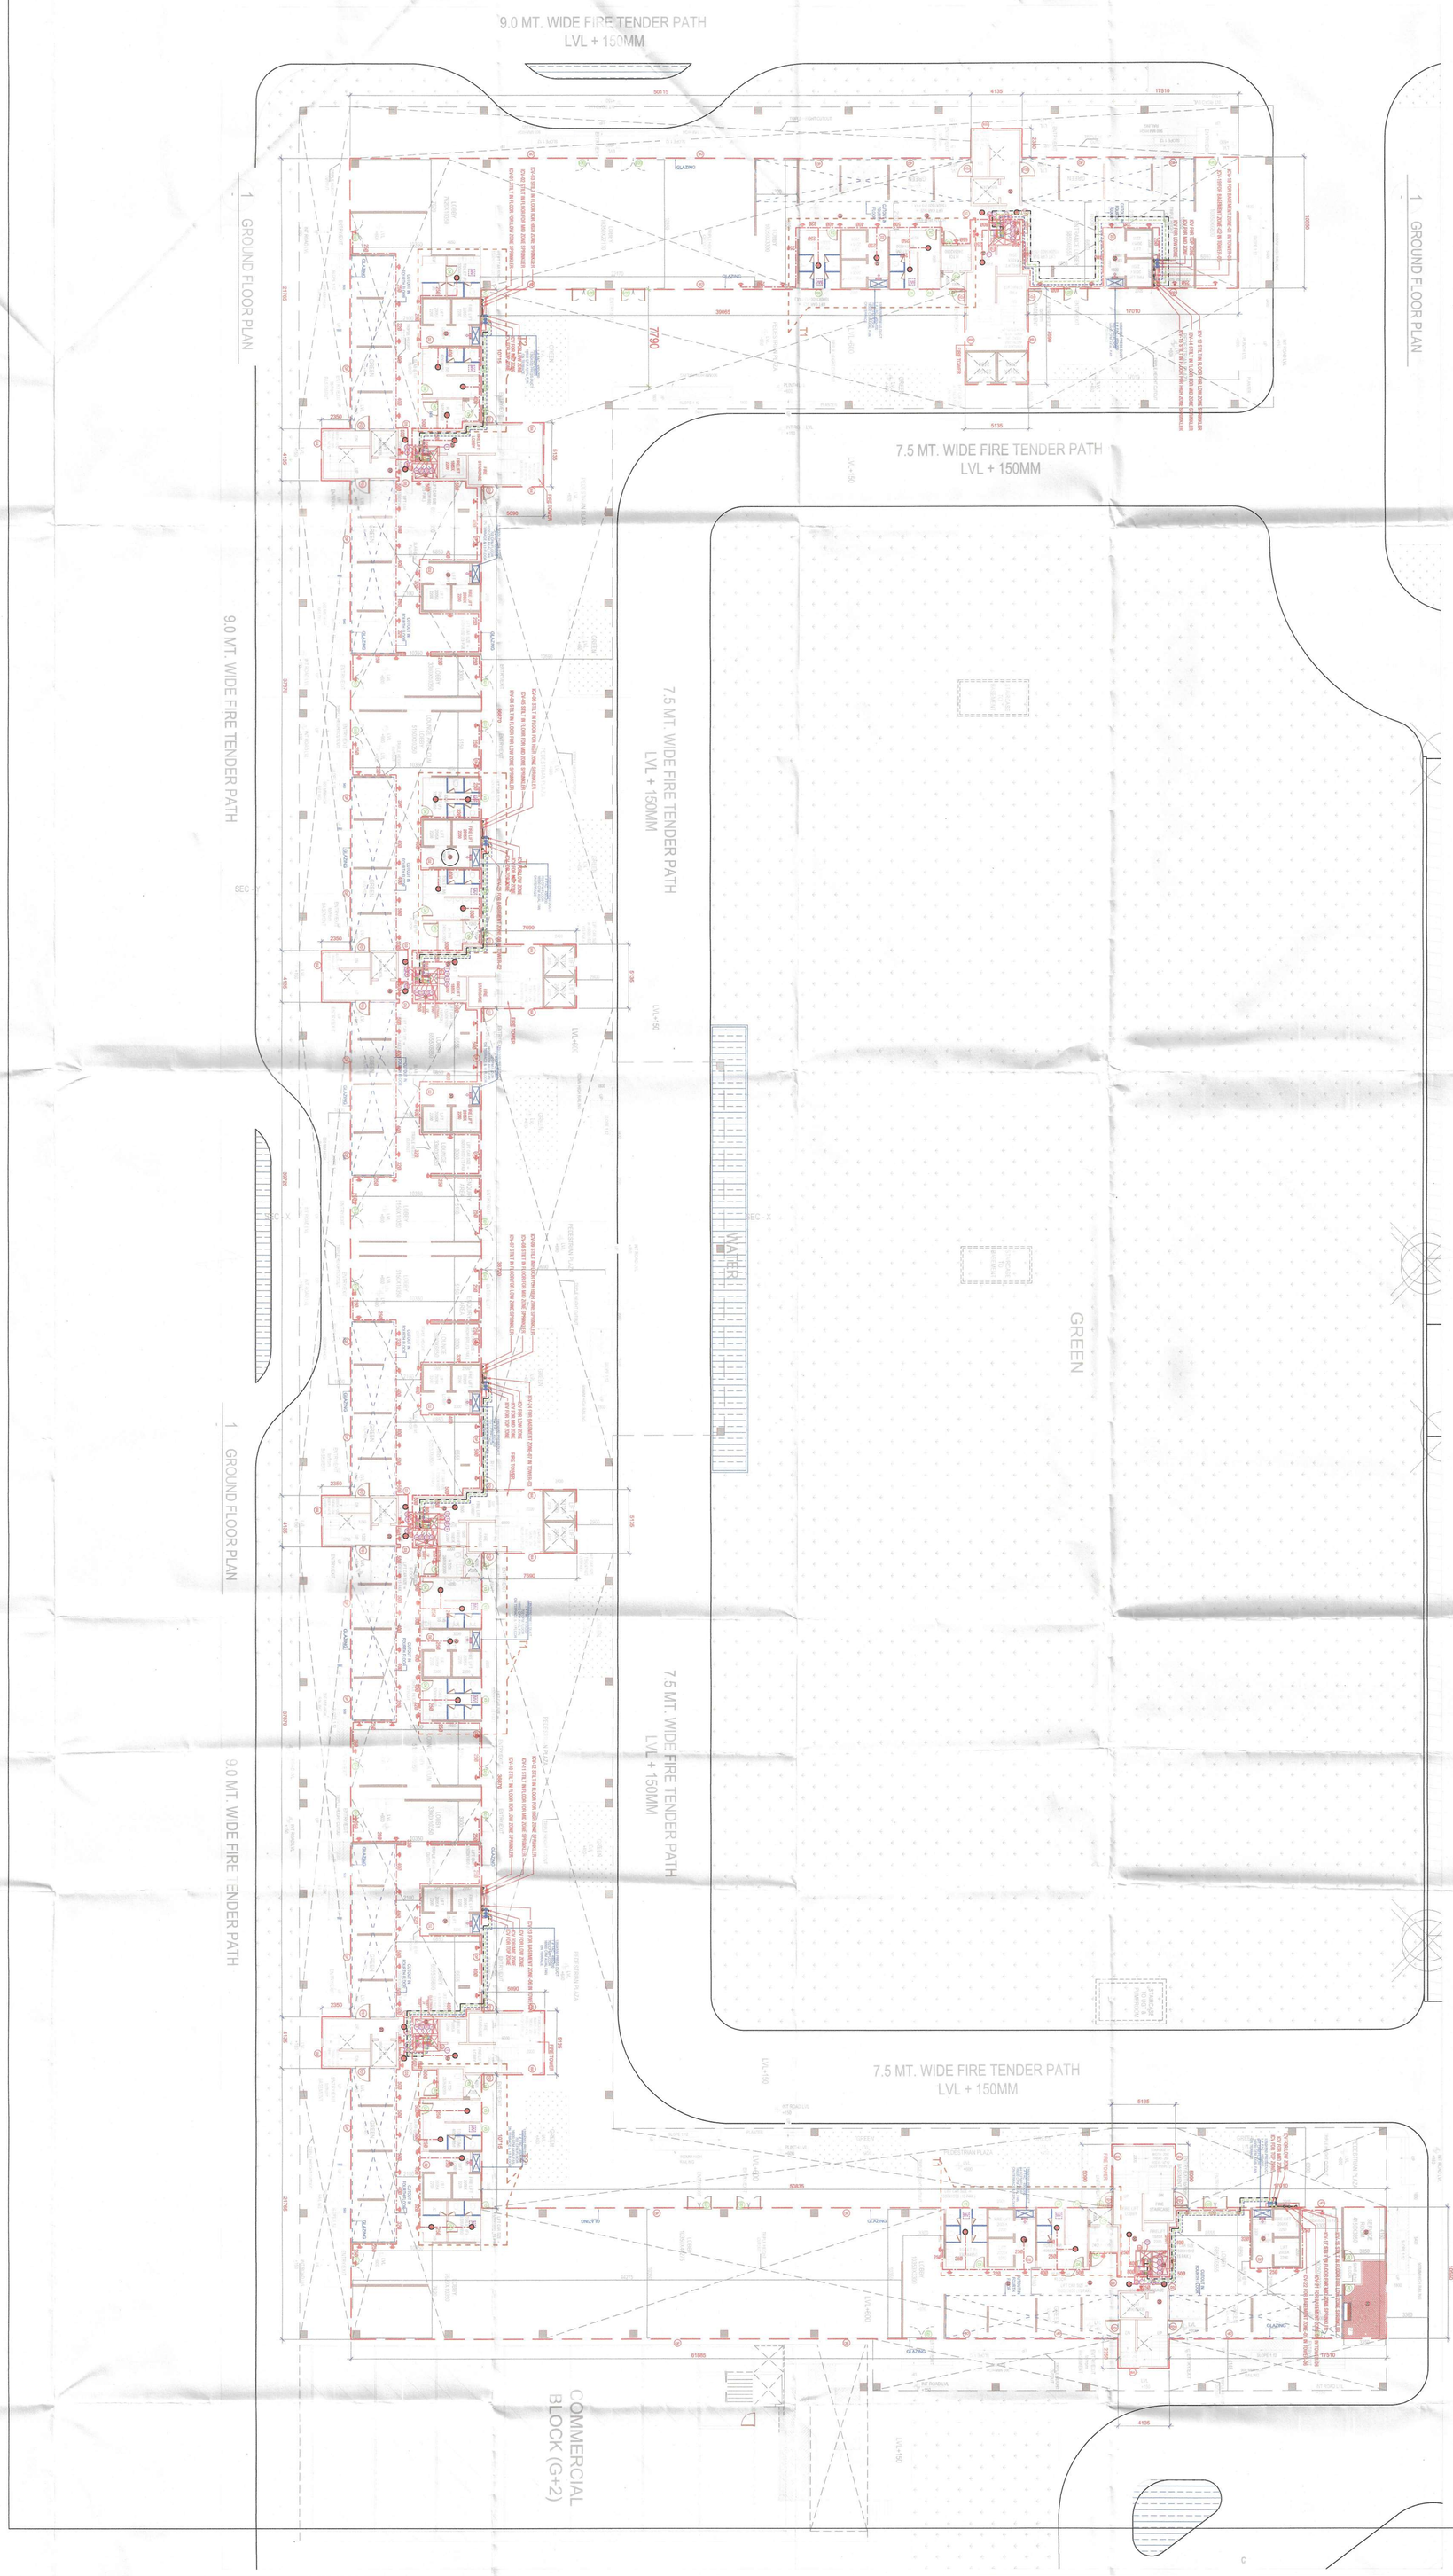


Certified that fire Fighting Scheme is as per N.B.C. Part IV, revised upto

FSO
Gurugram

FIRE LEGEND

SYMBOL	DESCRIPTION
(A)	150Ø M.S. LOW PRESSURE FIRE WET RISER PIPE FOR GROUND TO 11TH. FLOOR
(H)	150Ø M.S. HIGH PRESSURE FIRE WET RISER PIPE FOR 12TH TO 23RD LEVEL
(A2)	150Ø M.S. HIGH PRESSURE FIRE WET RISER PIPE FOR 24TH TO 35TH LEVEL
(A3)	150Ø M.S. FIRE DOWN COMER PIPE
(E)	150Ø M.S. LOW PRESSURE SPRINKLER RISER PIPE FOR GROUND TO 11TH. FLOOR
(B)	150Ø M.S. HIGH PRESSURE SPRINKLER RISER PIPE FOR 12TH TO 23RD LEVEL
(B2)	150Ø M.S. HIGH PRESSURE SPRINKLER RISER PIPE FOR 24TH TO 35TH LEVEL
(B3)	150Ø M.S. SPRINKLER DOWN COMER PIPE FOR TERRACE TO 35TH. FLOOR
(G)	80Ø M.S. RAIN PIPE
(I)	DOMESTIC WATER SUPPLY RISER PIPE
FHC	FIRE HOSE CABINET
⊗	FLOW SWITCH
✺	PENDENT TYPE SPRINKLER
●	UPRIGHT TYPE SPRINKLER
➧	SIDE WALL TYPE SPRINKLER
➧	EXTENDED SIDE WALL TYPE SPRINKLER
(E)	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE FOR GROUND TO 11TH LEVEL
(F)	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE FOR 12TH TO 23TH LEVEL
(G)	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE ALTERNATE PIPE FOR 12TH 35TH LEVEL
(H)	150Ø M.S. SPRINKLER ALTERNATE RISER PIPE ALTERNATE PIPE FOR 36TH TO TERRACE

DOOR/WINDOW SCHEDULE

S. No.	TYPE	WIDTH (MM)	SILL (MM)	LINTEL (MM)	HEIGHT (MM)
1	D2	1800	±0.0	+2400	2400
2	D3	1200	±0.0	+2400	2400
3	D4	900	±0.0	+2400	2400
4	D5	750	±0.0	+2400	2400
5	DW1	2400	±0.0	+2400	2400
6	DW2	3400	±0.0	+2400	2400
7	DW3	1200	±0.0	+2400	2400
8	DW5	1800	±0.0	+2400	2400
9	FD	900	±0.0	+2400	2100
10	FD2	550	±0.0	+2100	2100
11	FD1	1200	±0.0	+2100	2100
12	G1	800	±0.0	+2400	2400
13	W1	2000	+900	+2400	1500
14	W2	2450	+900	+2400	1500
15	W4	1500	AS' ELEVATION		
16	W4a	1600	AS' ELEVATION		
17	W5	900	+900	+2400	1500
18	V1	900	+1500	+2400	900
19	V2	800	+1500	+2400	900
20	V3	800	+1500	+2400	900
21	V4	1700	+1500	+2400	900
22	V6	3755	+1500	+2400	900

NOTE :-LINTEL LEVEL OF 13th SERVICE FLOOR WILL BE 2400mm
D3 IS 1HR. FIRE RATED & FD1/FD 2 & FD2 ARE 2 HR. FIRE RATED

DOOR/WINDOW SCHEDULE

S. No.	TYPE	WIDTH (MM)	SILL (MM)	LINTEL (MM)	HEIGHT (MM)
1	GD1	2000	±0.0	+2400	2400
2	D2	1800	±0.0	+2400	2400
3	D3	1200	±0.0	+2400	2400
4	D4	900	±0.0	+2400	2400
5	HD	1200	±0.0	+2400	2400
6	FD	900	±0.0	+2400	2400
7	FD1	1200	±0.0	+2400	2400
8	W4	1500	AS' ELEVATION		
9	V3	600	+1500	+2400	900
10	OP	1800	OPENABLE PANEL AS' ELEVATION		

REVISED BUILDING PLANS FOR MIXED LAND USE COLONY (95% RESIDENTIAL COMPONENT & 5% COMMERCIAL COMPONENT) UNDER TRANSIT ORIENTED DEVELOPMENT POLICY (TOD)FOR THE AREA MEASURING 8.34375 ACRES (LICENSE NO. 127 OF 2023 DATED 16/06/2023) IN SECTOR-84, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY GANGA GLOBAL HOMES PVT.LTD.

LC - 4946

Ganga Global Homes Pvt. Ltd.

Avanika Vashisth
CA/2018/41670

COMBINED BLOCK (TOWER 1 - 6)
GROUND FLOOR PLAN
FIRE SUBMISSION DRAWING

GANGA REALTY - DESIGN TEAM

GANGA REALTY
Vatika Tower, Golf Course Road
Gurugram, Haryana

JULY, 2025

Fire Fighting Scheme Approved
Vide Letter No. Dated.....
Dated.....
FSO (HQ)

S - 211