


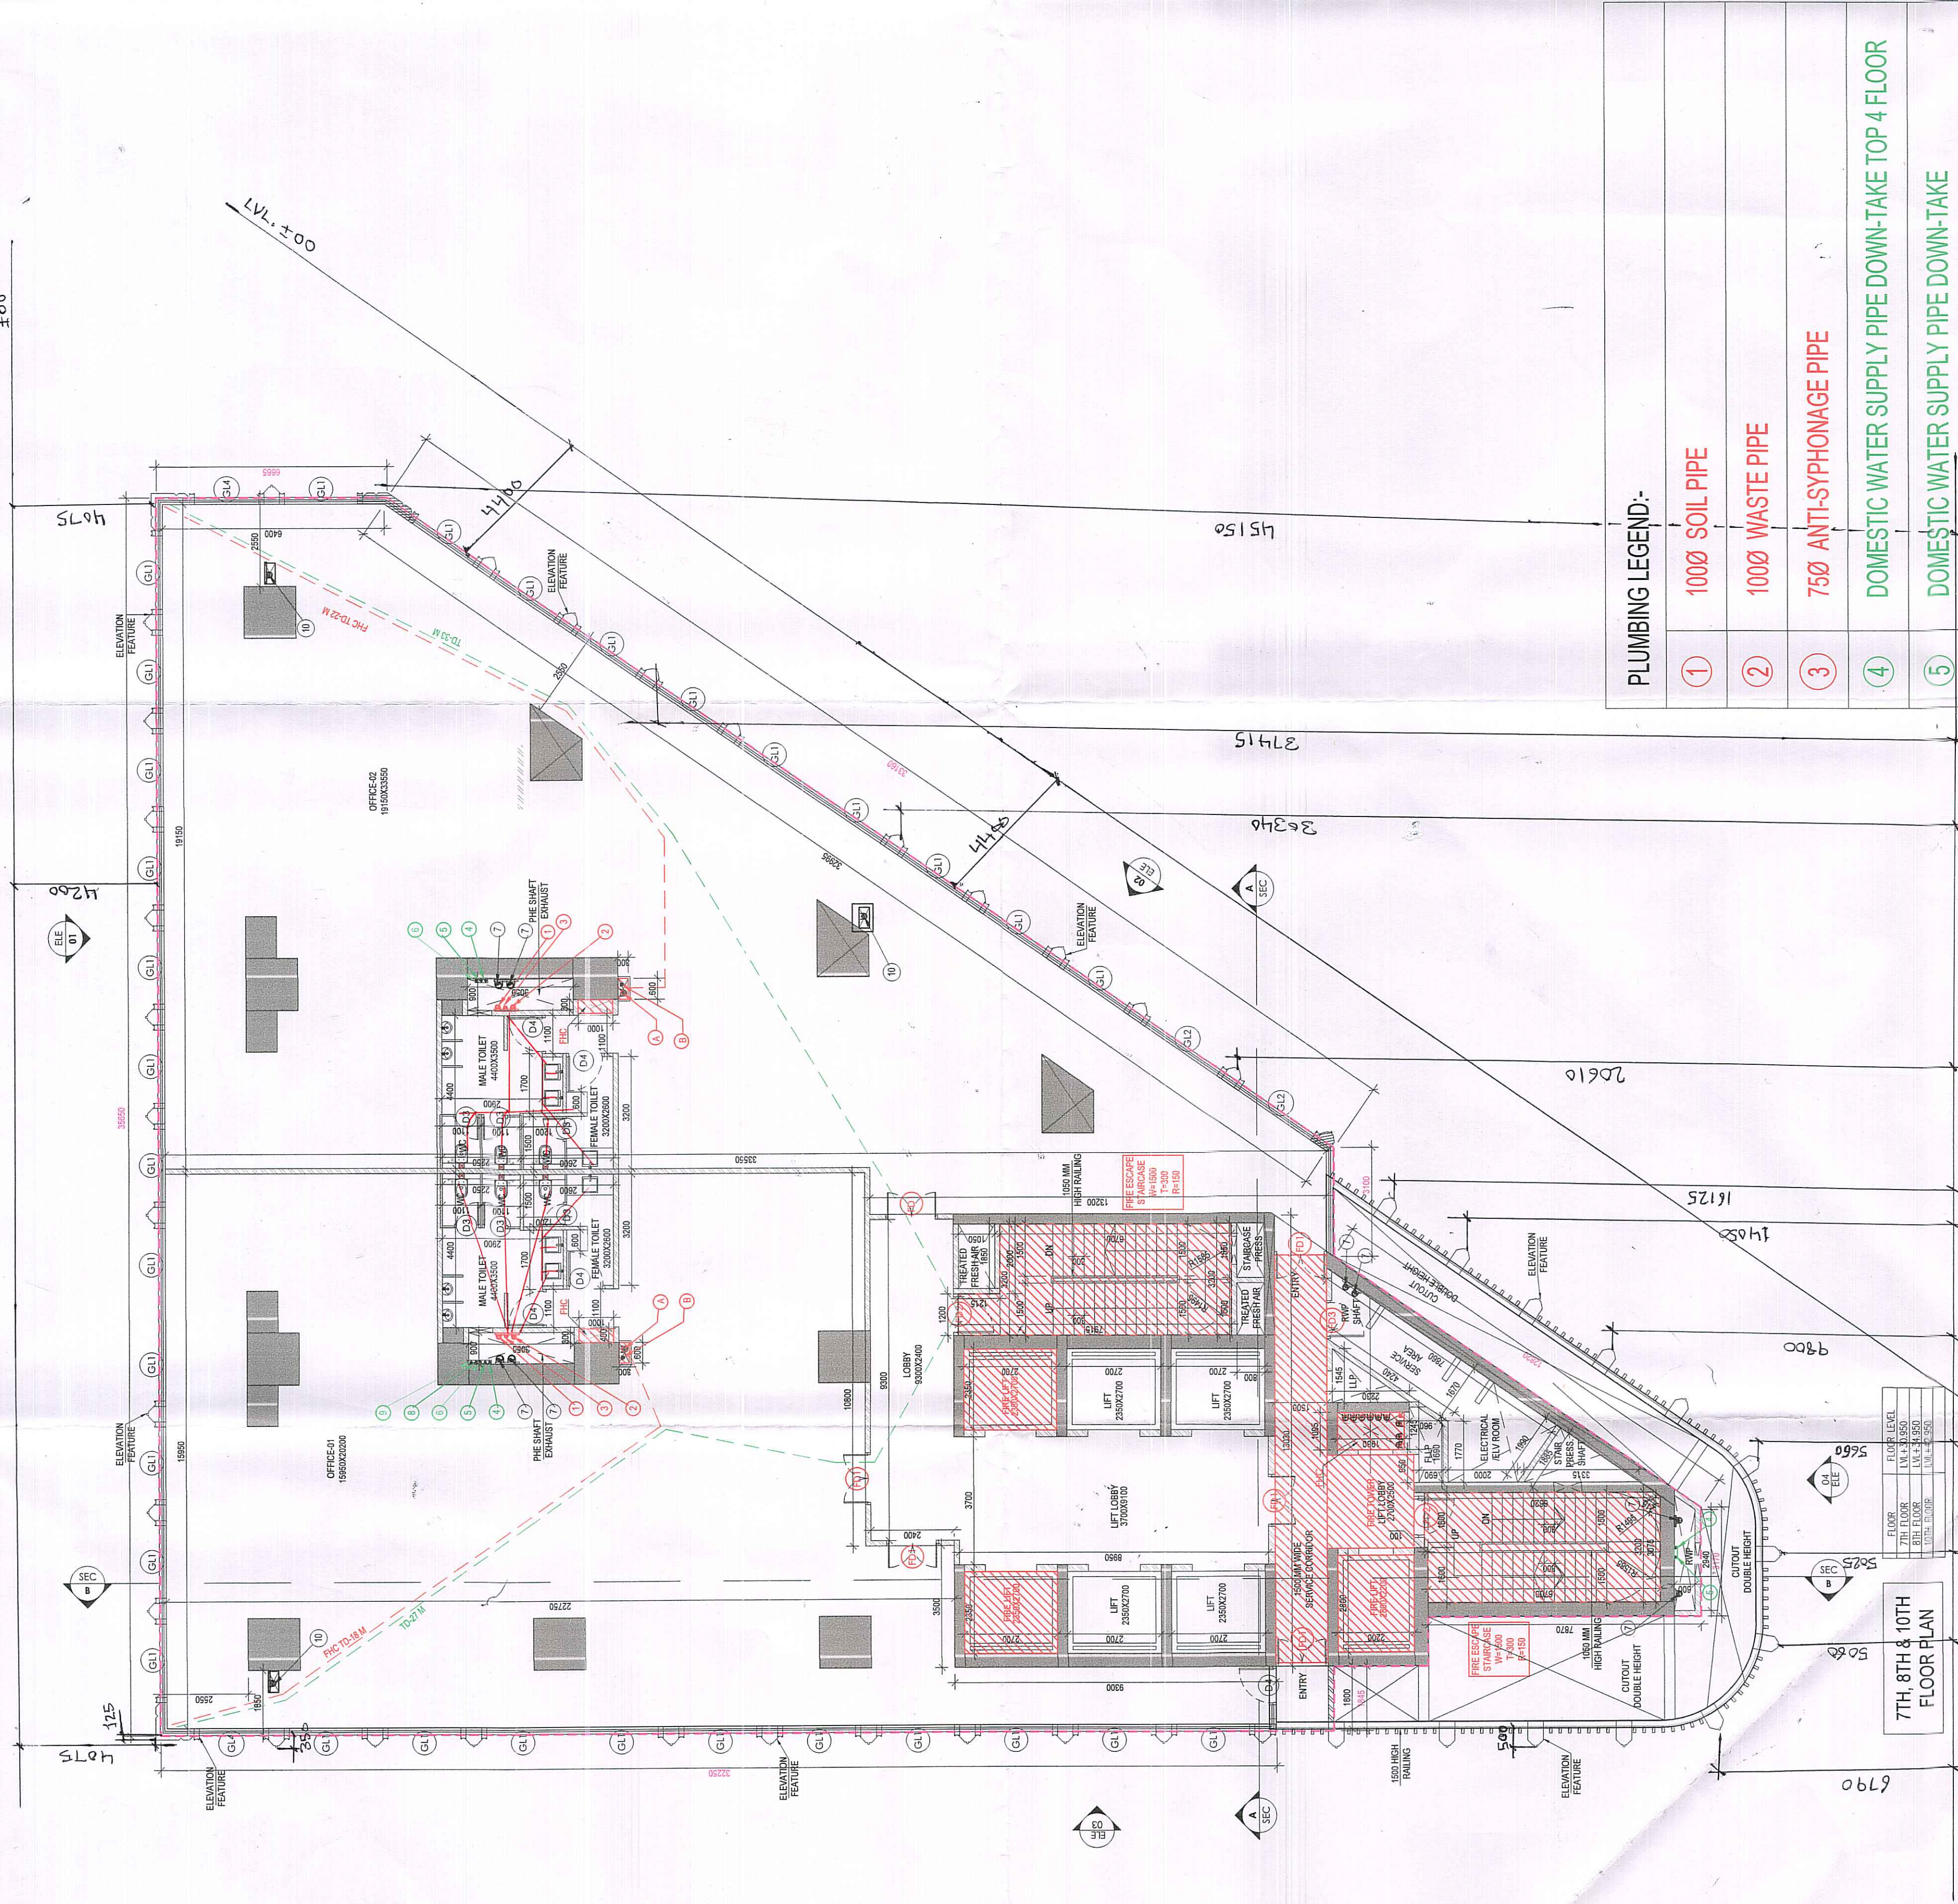

PLUMBING LEGEND:-	
1	1000 SOIL PIPE
2	1000 WASTE PIPE
3	750 ANTI-SYPHONAGE PIPE
4	DOMESTIC WATER SUPPLY PIPE DOWN-TAKE TOP 4 FLOOR
5	DOMESTIC WATER SUPPLY PIPE DOWN-TAKE
6	FLUSHING WATER SUPPLY PIPE DOWN-TAKE
7	1500 RAIN WATER PIPE
8	DOMESTIC WATER SUPPLY RISER
9	FLUSHING WATER SUPPLY RISER
10	1500 RAIN WATER PIPE FOR BALCONY
COP CLEAN OUT PLUG	
FT	FLOOR TRAP WITH (1500 SLEEVE OR 150X150MM CUTOUT)
FD	FLOOR DRAIN WITH (1250 SLEEVE OR 125X125MM CUTOUT)
WC	WC DROP WITH (1500 SLEEVE OR 150X150MM CUTOUT)

S.No.	FIRE FIGHTING LEGEND:-
A	1500 M.S FIRE UPRANT RISER
B	800 M.S DRAIN PIPE
C	1500 M.S SPRINKLER RISER
Ca	1500 M.S SPRINKLER RISER
FHC	FIRE HOSE CABINET

REQUIRED STAIRCASE WIDTH 7TH, 8TH, 10TH LEVEL CALCULATION:-
(OFFICE 814.90 SQM 1 Person/10)=81 persons
(CIRCULATION SPACE , TOILET , LOBBY 213.71 250M 1 Person/10)=21 persons
TOTAL= 102 persons
Required staircase width @ 10mm/person for 102 persons =1020 mm i.e. MINIMUM 1250 MM.
PROVIDED STAIRCASE WIDTH = 1500+1500 =3000MM

DOORS	
Door	Description
1	1500
2	1500
3	1500
4	1500
5	1500
6	1500
7	1500
8	1500
9	1500
10	1500
11	1500
12	1500
13	1500
14	1500
15	1500
16	1500
17	1500
18	1500
19	1500
20	1500
21	1500
22	1500
23	1500
24	1500
25	1500
26	1500
27	1500
28	1500
29	1500
30	1500
31	1500
32	1500
33	1500
34	1500
35	1500
36	1500
37	1500
38	1500
39	1500
40	1500
41	1500
42	1500
43	1500
44	1500
45	1500
46	1500
47	1500
48	1500
49	1500
50	1500
51	1500
52	1500
53	1500
54	1500
55	1500
56	1500
57	1500
58	1500
59	1500
60	1500
61	1500
62	1500
63	1500
64	1500
65	1500
66	1500
67	1500
68	1500
69	1500
70	1500
71	1500
72	1500
73	1500
74	1500
75	1500
76	1500
77	1500
78	1500
79	1500
80	1500
81	1500
82	1500
83	1500
84	1500
85	1500
86	1500
87	1500
88	1500
89	1500
90	1500
91	1500
92	1500
93	1500
94	1500
95	1500
96	1500
97	1500
98	1500
99	1500
100	1500

AREA CALCULATION OF 7TH, 8TH & 10TH FLOOR	
Sl. No.	Area (Sq. M)
1	1000
2	1000
3	1000
4	1000
5	1000
6	1000
7	1000
8	1000
9	1000
10	1000
11	1000
12	1000
13	1000
14	1000
15	1000
16	1000
17	1000
18	1000
19	1000
20	1000
21	1000
22	1000
23	1000
24	1000
25	1000
26	1000
27	1000
28	1000
29	1000
30	1000
31	1000
32	1000
33	1000
34	1000
35	1000
36	1000
37	1000
38	1000
39	1000
40	1000
41	1000
42	1000
43	1000
44	1000
45	1000
46	1000
47	1000
48	1000
49	1000
50	1000
51	1000
52	1000
53	1000
54	1000
55	1000
56	1000
57	1000
58	1000
59	1000
60	1000
61	1000
62	1000
63	1000
64	1000
65	1000
66	1000
67	1000
68	1000
69	1000
70	1000
71	1000
72	1000
73	1000
74	1000
75	1000
76	1000
77	1000
78	1000
79	1000
80	1000
81	1000
82	1000
83	1000
84	1000
85	1000
86	1000
87	1000
88	1000
89	1000
90	1000
91	1000
92	1000
93	1000
94	1000
95	1000
96	1000
97	1000
98	1000
99	1000
100	1000

Note:-
ALL FLOOR MECHANICAL VENTILATED LIGHTED & 100% POWER BACKUP PROVIDED TO POWER BACKUP IS BEING PROVIDED. TOILET ARE MECHANICAL VENTILATED. ALL LIFTS SHALL HAVE POWER BACK-UP. ALL ELECTRICAL INSTALLATION SHALL BE AS PER PROVISION OF RELEVANT CODE. FIRE FIGHTING SAFETY PROVISIONS WILL BE AS PER RELEVANT CODE PROVISIONS. BASEMENT AREA SHALL HAVE MECHANICALLY VENTILATED AS PER RELEVANT CODE. ALL TOILETS ARE VENTILATED AS PER HARYANA BUILDING CODE 2017. BUILDINGS HAS AUTOMATIC SPRINKLER SYSTEM WHEREVER REQUIRED BY RELEVANT CODE. BUILDINGS HAS AUTOMATIC FIRE RESISTANT STRUCTURES AS PER RELEVANT IS CODES FOR EARTHQUAKE RESISTANCE. SOLAR PANELS OF REQUIRED CAPACITY SHALL BE PROVIDED AS PER HARE DAZONING NORMS. ALL HANDICAP RAMPS WITH RAILING. ALL FIRE FIGHTING INSTALLATIONS SHALL BE AS PER PROVISION OF RELEVANT CODE. THE RAINWATER HARVESTING SYSTEM SHALL BE PROVIDED AS PER CENTRAL GROUND WATER AUTHORITY NORMS.

PROJECT:
PROPOSED BUILDING PLAN OF COMMERCIAL COMPLEX SITE AREA 1.98 ACRES
4943.0 SQM IN SECTOR 28, GURUGRAM

OWNER'S
ACQUISITIVE INFRADEVELOPERS PVT. LTD.
WITH LODHA DEVELOPERS LIMITED

OWNER'S SEAL & SIGNATURE
OWNER'S SEAL
OWNER'S SIGNATURE

ARCHITECT'S SEAL & SIGNATURE
ARCHITECT'S SEAL
ARCHITECT'S SIGNATURE

MAY - 2026
Scale : 1:100
Drawing No:-
Drawing Title:-
TOWER 01
7TH, 8TH & 10TH FLOOR PLAN
AREA CALCULATION
1:100