


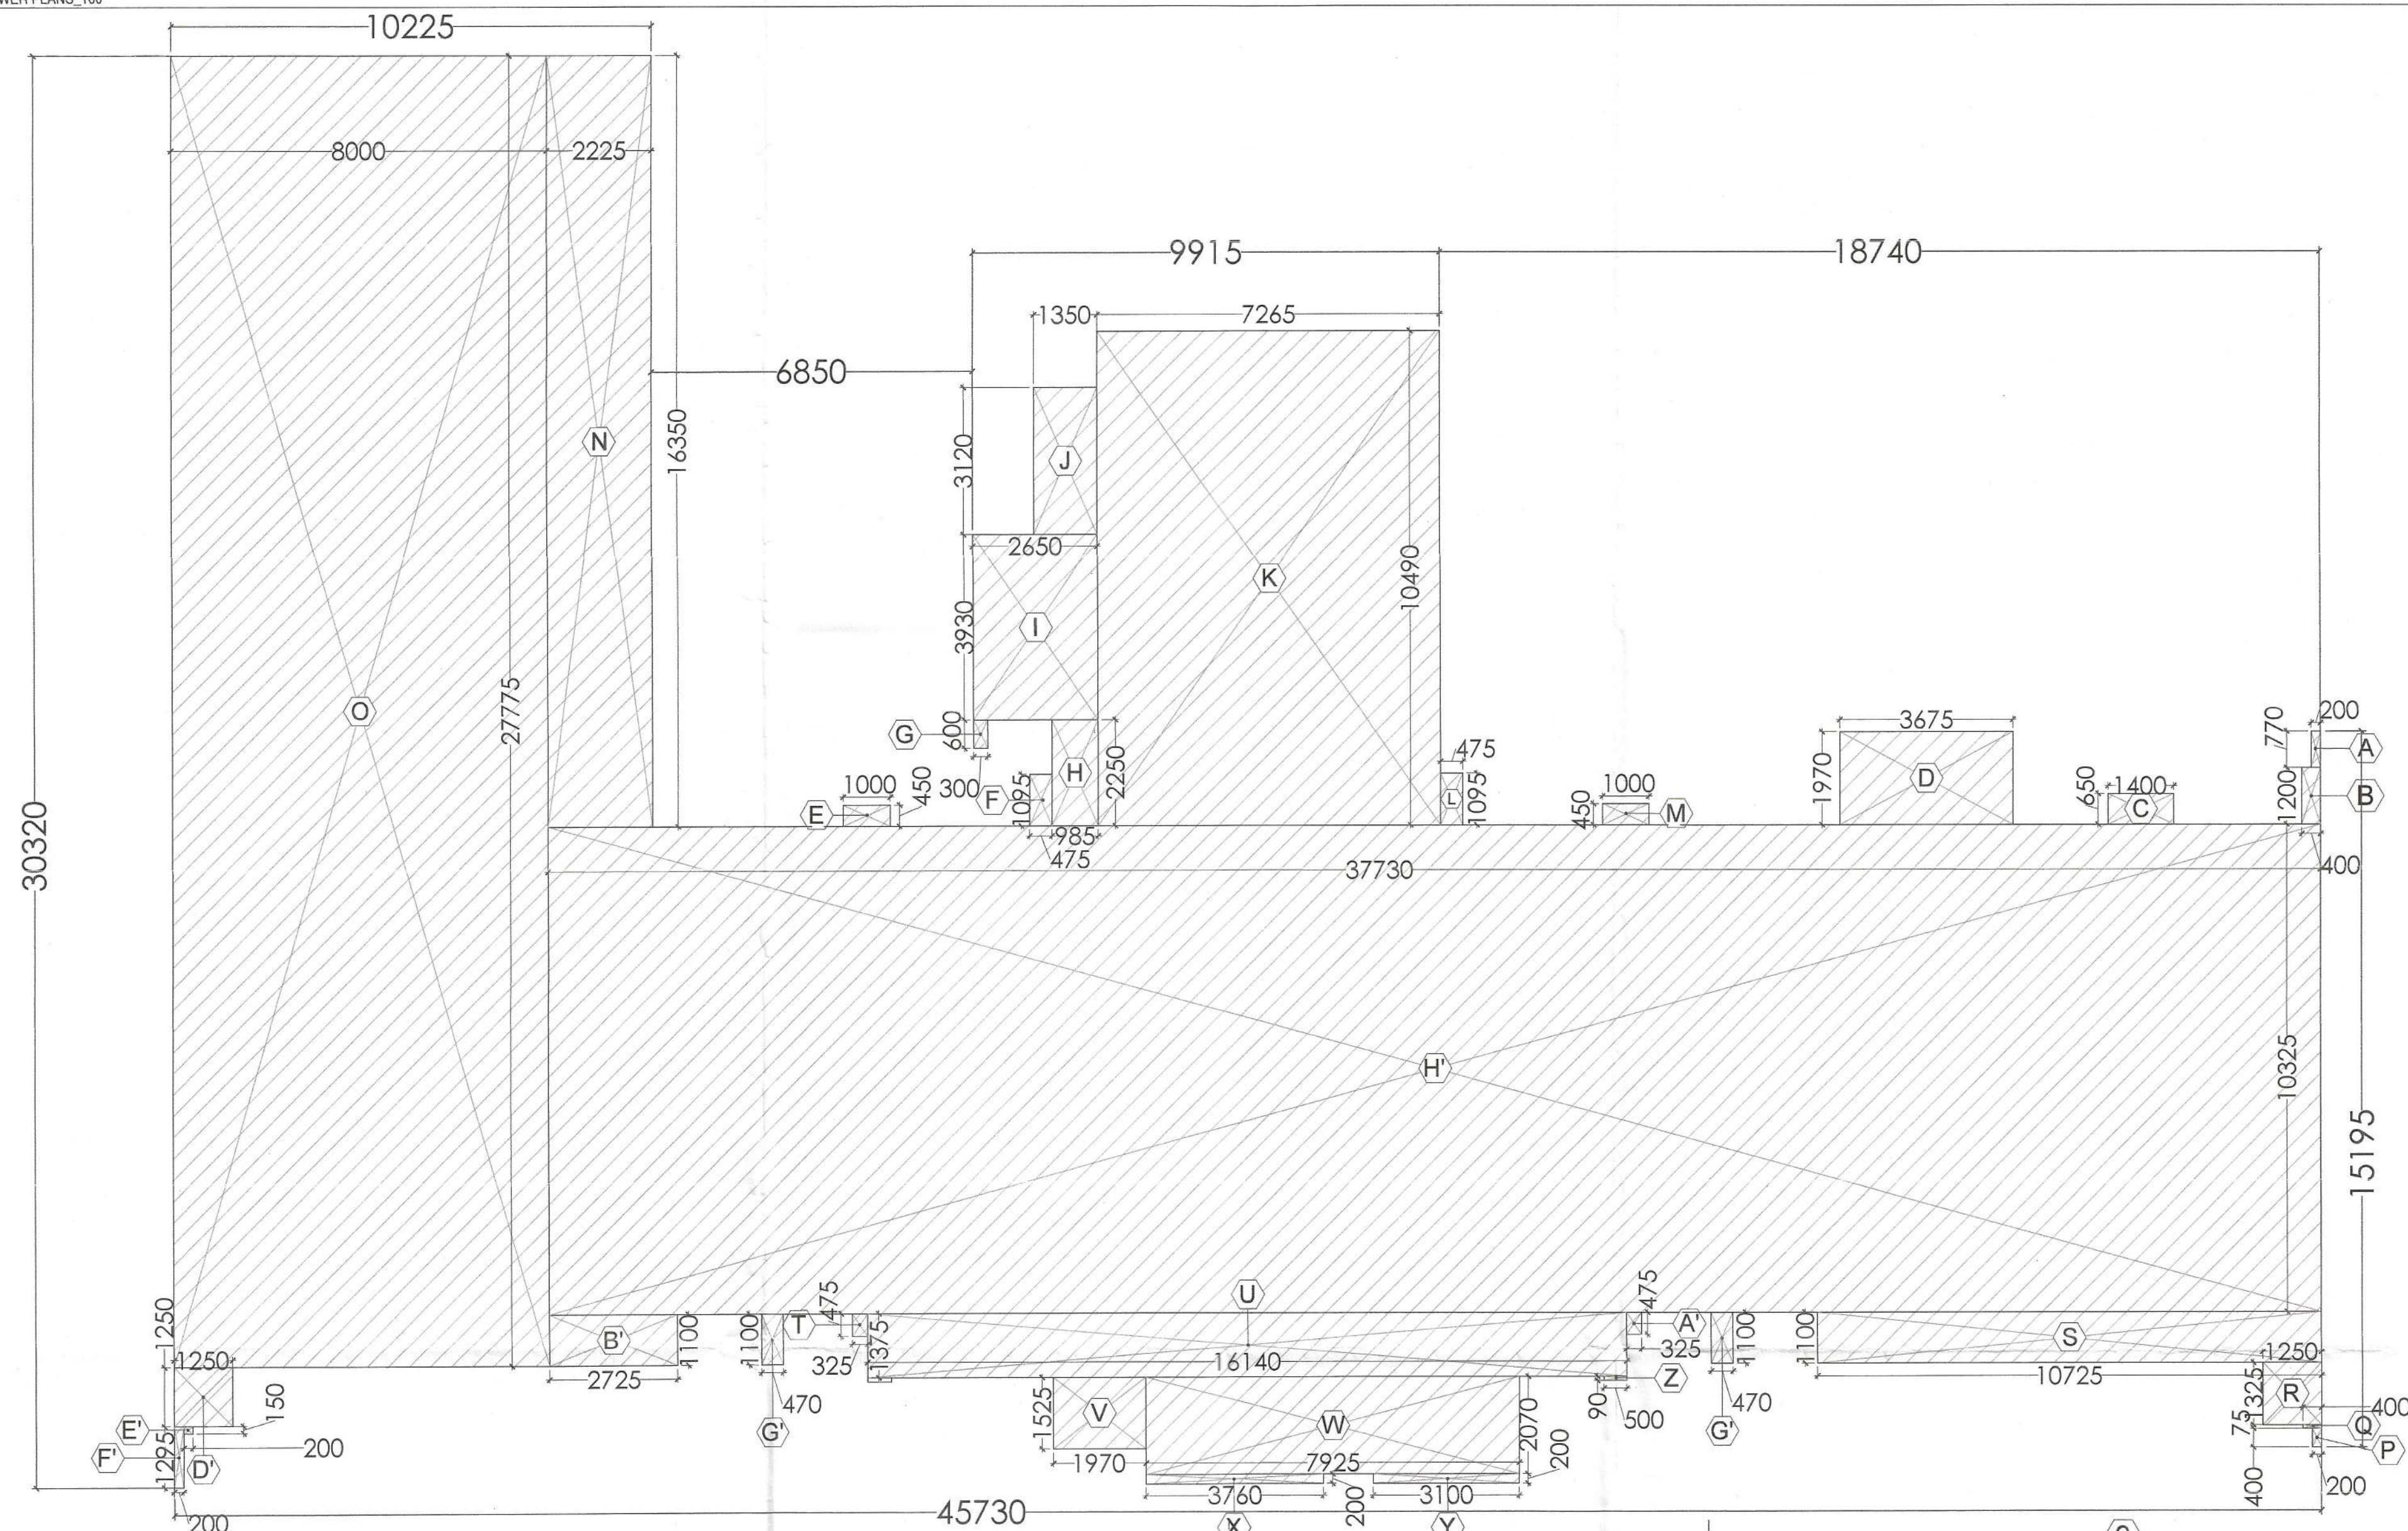


NOTES :-

- VRV System is being provided.
- Full DG power back up is being provided.
- Toilets are mechanical ventilated.
- All lifts shall have 100% power back-up.
- All electrical installations shall be as per provision of nbc.
- Fire-fighting/safety provisions will be as per relevant nbc provisions.
- Basement area shall have mechanically ventilated as per relevant code.
- All toilets are ventilated as per haryana building code 2017.
- Building has automatic sprinkler system wherever required by nbc.
- Building will be designed (structures) as per relevant i.s. codes for earthquake resistance.
- Solar panels of required capacity shall be provided on roof top as per hareda/zoning norms.
- All handicap ramps with railing.
- All fire fighting installations shall be as per provision of nbc.
- The rainwater harvesting system shall be provided as per central ground water Authority norms.

NOTES:-


- REFER DRAWING NO. AR-T4-201 & 202 FOR ELEVATIONS
- REFER DRAWING NO. AR-T4-301 FOR SECTIONS

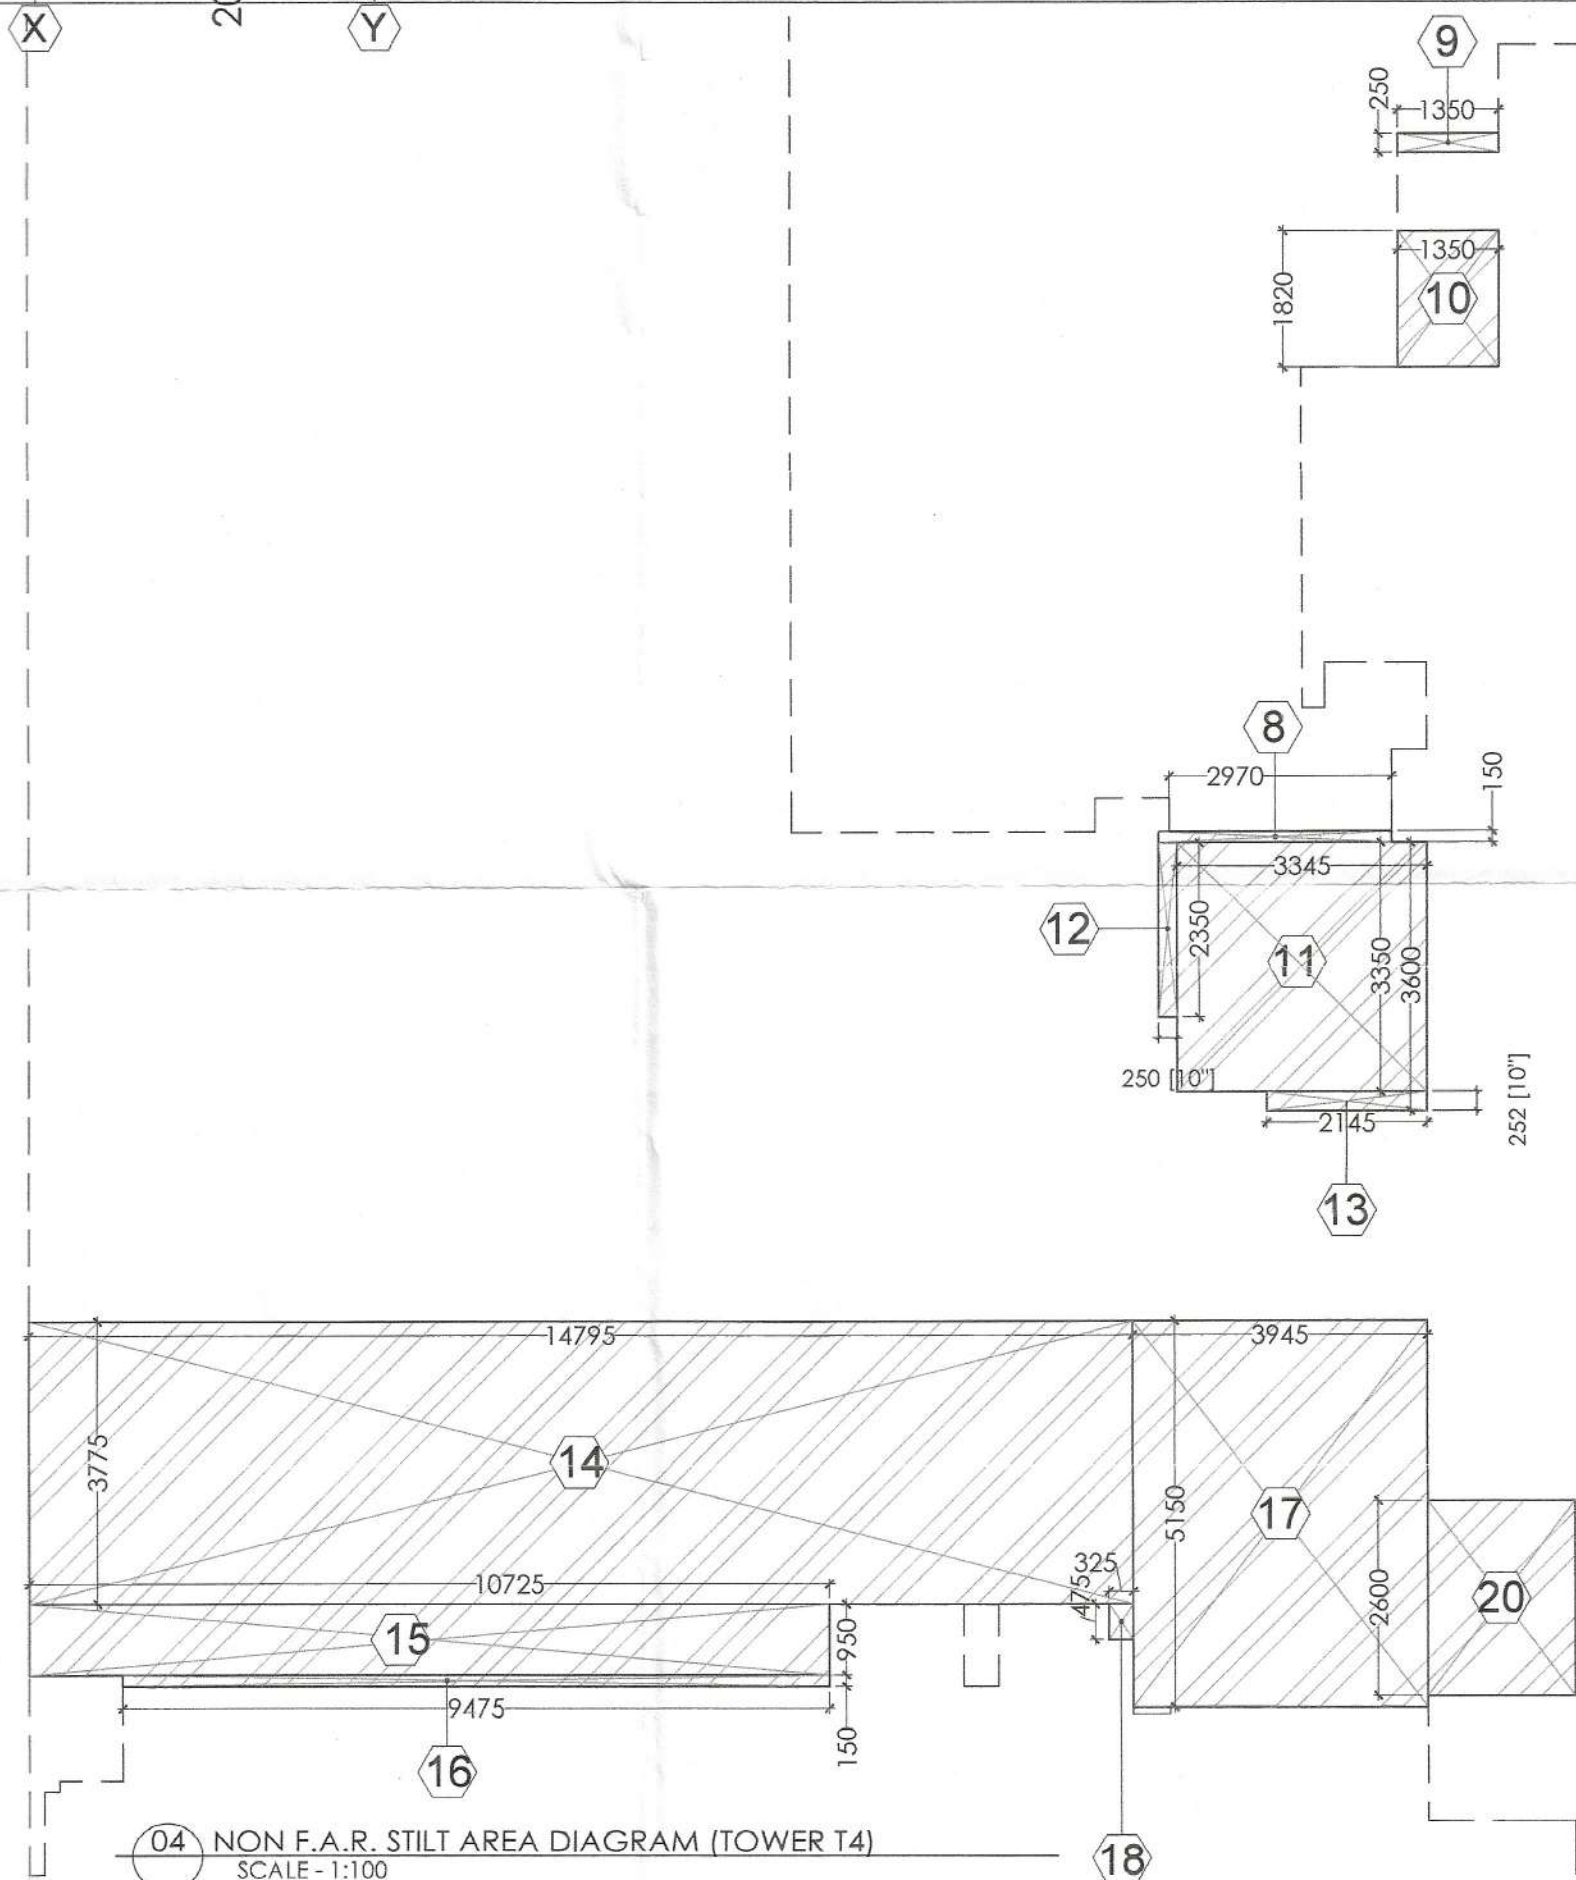

GROUND COVERAGE - TOWER T4				
S.NO.	WIDTH (M)	LENGTH(M)	NOS.	AREA (SqM)
ADDITIONS				
A	0.200	0.770	1	0.154
B	0.400	1.200	1	0.480
C	1.400	0.650	1	0.910
D	3.675	1.970	1	7.240
E	1.000	0.450	1	0.450
F	0.475	1.095	1	0.520
G	0.300	0.600	1	0.180
H	0.985	2.250	1	2.214
I	2.650	3.930	1	10.415
J	1.350	3.120	1	4.212
K	7.265	10.490	1	76.210
L	0.475	1.095	1	0.520
M	1.000	0.450	1	0.450
N	2.225	16.350	1	36.379
O	8.000	26.395	1	211.160
P	0.200	0.400	1	0.080
Q	0.400	0.075	1	0.030
R	1.250	1.325	1	1.656
S	10.725	1.100	1	11.798
T	0.325	0.475	1	0.154
U	16.140	1.375	1	22.193
V	1.970	1.525	1	3.004
W	7.925	2.070	1	16.405
X	3.760	0.200	1	0.752
Y	3.100	0.200	1	0.620
Z	0.500	0.090	1	0.045
A'	0.325	0.475	1	0.154
B'	2.725	1.100	1	2.998
D'	1.250	1.250	1	1.563
E'	0.200	0.150	1	0.030
F'	0.200	1.295	1	0.259
G'	0.470	1.100	2	1.034
H'	37.730	10.325	1	389.562
TOTAL GROUND COVERAGE OF T4				803.832

TOWER-T4 STILT (NON F.A.R.)				
S.NO.	WIDTH (M)	LENGTH(M)	NOS.	AREA (SqM)
ADDITIONS				
1	0.300	1.350	1	0.405
2	2.725	0.150	1	0.409
3	1.400	0.800	1	1.120
4	2.025	0.150	1	0.304
5	3.100	2.120	1	6.572
6	4.070	0.150	1	0.611
7	1.000	0.600	1	0.600
8	2.970	0.150	2	0.891
9	1.350	0.250	1	0.338
10	1.350	1.820	1	2.457
11	3.345	3.350	1	11.206
12	0.250	2.350	1	0.588
13	2.145	0.250	1	0.536
14	14.795	3.775	1	55.851
15	10.725	0.950	1	10.189
16	9.475	0.150	1	1.421
17	3.945	5.150	1	20.317
18	0.325	0.475	2	0.309
19	1.305	4.370	1	5.703
20	0.500	5.700	1	2.850
21	1.645	2.270	1	3.734
22	3.945	1.375	1	5.424
23	18.640	10.175	1	189.662
24	9.475	1.100	1	10.423
25	1.250	0.950	1	1.188
26	0.300	1.550	1	0.465
TOTAL AREA				333.570

This is a "PROVISIONAL BUILDING PLAN" approved only for the purpose of inviting objections from the general public.

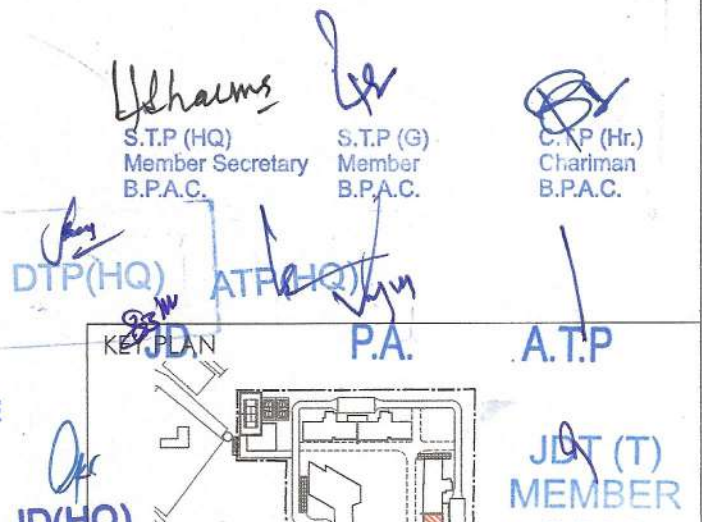

NOTES

DOOR/WINDOW SCHEDULE (TOWERS)						
S. NO.	DOOR NO. TAGS	WIDTH	UNIT	CIL	LOCATION	FIRE RATINGS
DOORS						
1	D2	1050	2400	0	Bedroom	
2	D3	900	2400	0	Kitchen	
3	D4	800	2400	0	Toilet	
4	D6	1200	2400	0	GF - H.R. Room	
5	D9	1250	2400	0	Staircase	
EXTERNAL DOORS						
6	SD1	2400	2400	0	M. Bedroom	
7	SD2	2025	2400	0	Bedroom	
8	SD3	1800	2400	0	Bedroom	
9	SD4	2730	2400	0	Bedroom	
10	SD5	3070	2400	0	Living/Dining	
11	SD6	3570	2400	0	Living/Dining	
12	SD7	4700	2400	0	M. Bedroom	
13	SD8	3475	2400	0	M. Bedroom	
14	SD9	3250	2400	0	M. Bedroom	
15	D5	1000	2400	0	WC	
16	D7	800	2400	0	WC	
17	D8	900	2400	0	Utility	
18	DW1	2475	2400	0	GF Kitchen	
WINDOWS						
19	W1	600	2400	1200	Toilet	
20	W1	3075	2400	1200	M. Toilet	
21	W2	900	2400	1200	Utility/Bedroom	
22	W3	1250	2400	1200	Staircase	
23	W4	1740	2400	1200	Staircase	
24	W4	2425	2400	1200	M. Toilet	
25	W7	700	2400	1200	Bedroom	
26	W8	1550	2400	1200	Staircase	
27	AD1	750	2400	1200	Toilet	
28	GD1	1800	2400	0	GF Lift Lobby	
29	G1	3380/16750/3380	5200	0	GF Lobby	
30	G2	2725	5200	0	GF Lobby	
31	G3	4070	5200	0	GF Lobby	
32	G4	450	5200	0	GF Lobby	
33	G5	2145	5200	0	GF Lobby	
34	G6	1840	5200	0	GF Lobby	
35	G7	2273/4400	5200	0	GF Lobby	
36	G8	5380/7675/6250	5200	0	GF Lobby	
37	G9	2500	5200	0	GF Lobby	
38	G10	1800	2600	0	M. Bedroom	
39	G11	6575/12020/10880	5200	0	GF Lobby	
40	G12	400	5200	0	GF Lobby	
41	G13	4000/1050	5200	0	GF Lobby	
42	G14	4695	5200	0	GF Lobby	
43	G15	6475/2470	5200	0	GF Lobby	

FIRE DOORS AND WINDOW						
S. NO.	DOOR NO. TAGS	WIDTH	UNIT	CIL	LOCATION	FIRE RATINGS
44	FD1	1500	2400	0	Entrance	1hr
45	FD2	1250	2400	0	Staircase/Fire Lobby	2hrs
46	FD3	1000	2400	75	MV Shaft	2hrs
47	FD4	900	2400	75	LV Shaft	2hrs
48	FD5	900	2400	0	Utility/Service	1hr
49	FD6	1000	2400	0	Utility	1hr
50	FD7	400	2400	75	AC Ref. Shaft	2hrs
51	FD8	900	2400	1200	Staircase	2hrs
52	FD9	1250	2400	1200	Staircase	2hrs
53	FD10	1740	2400	1200	Staircase	2hrs
54	FD11	900	2400	75	FHC Shaft	2hrs
55	FD12	1200	2400	75	FHC Shaft	2hrs

CLIENT

Birla Estates Pvt. Ltd. in collaboration with Barmalt India Pvt. Ltd.

PROOF CHECK CONSULTANT
Skeleton Consultants Pvt. Ltd.
2nd Floor, A-75, Sector 5, Noida, Uttar Pradesh-201301

GEO TECHNICAL CONSULTANT
Cengra Geotechnica Pvt. Ltd.
A-100, Sector 63, Noida, Uttar Pradesh-201309

STRUCTURES

WHITBY WOOD PRITAMDASANI, MUMBAI
Unit 1101 | Lodha Supremus | Powai, Andheri (East) | Mumbai-400072 | Maharashtra | India
T: +91-9820-186879
m.pritamdasani@whitbywood.com

MEP

SNC, SUNIL NAYYAR CONSULTING ENGINEERS LLP
206-206A & 305A-305B, 2nd & 3rd Floor
Sector 54 | Gurgaon-122002 | Haryana | India
T: +91-124-4803800
Email: sncgurgaon@snc.co.in

LANDSCAPE

SWA, LAGUNA BEACH
570 | Glensneyre Street | Laguna Beach | California-92651 | USA
T: +1.949.497.5471 | D: +1.949.607.0174 | www.swagroup.com

ARCHITECTS

Arcop Associates Pvt. Ltd.
Plot- 36B, Sec-32, Gurgaon-122001
Ph: 26242050, 26242169
Montreal, Toronto, New-Delhi, Boston

PROJECT

REVISED BUILDING PLAN OF GROUP HOUSING COLONY LICENCE NO 116 of 2011 AREA MEASURING 13.275 ACRES IN SECTOR-31 - 32A, GURGAON BEING DEVELOPED BY BIRLA ESTATES PVT LTD IN COLLABORATION WITH M/S BARMALT INDIA PVT. LTD.

ARCHITECTS SIGNATURE

OWNER'S SIGNATURE
For BIRLA ESTATES PVT. LTD.

DRAWING AUTHORIZED SIGNATORY
GROUP HOUSING COLONY (TOWER-T4)
GROUND COVERAGE AREA CALCULATIONS

DRAWING NO.

AR-T4-101.1