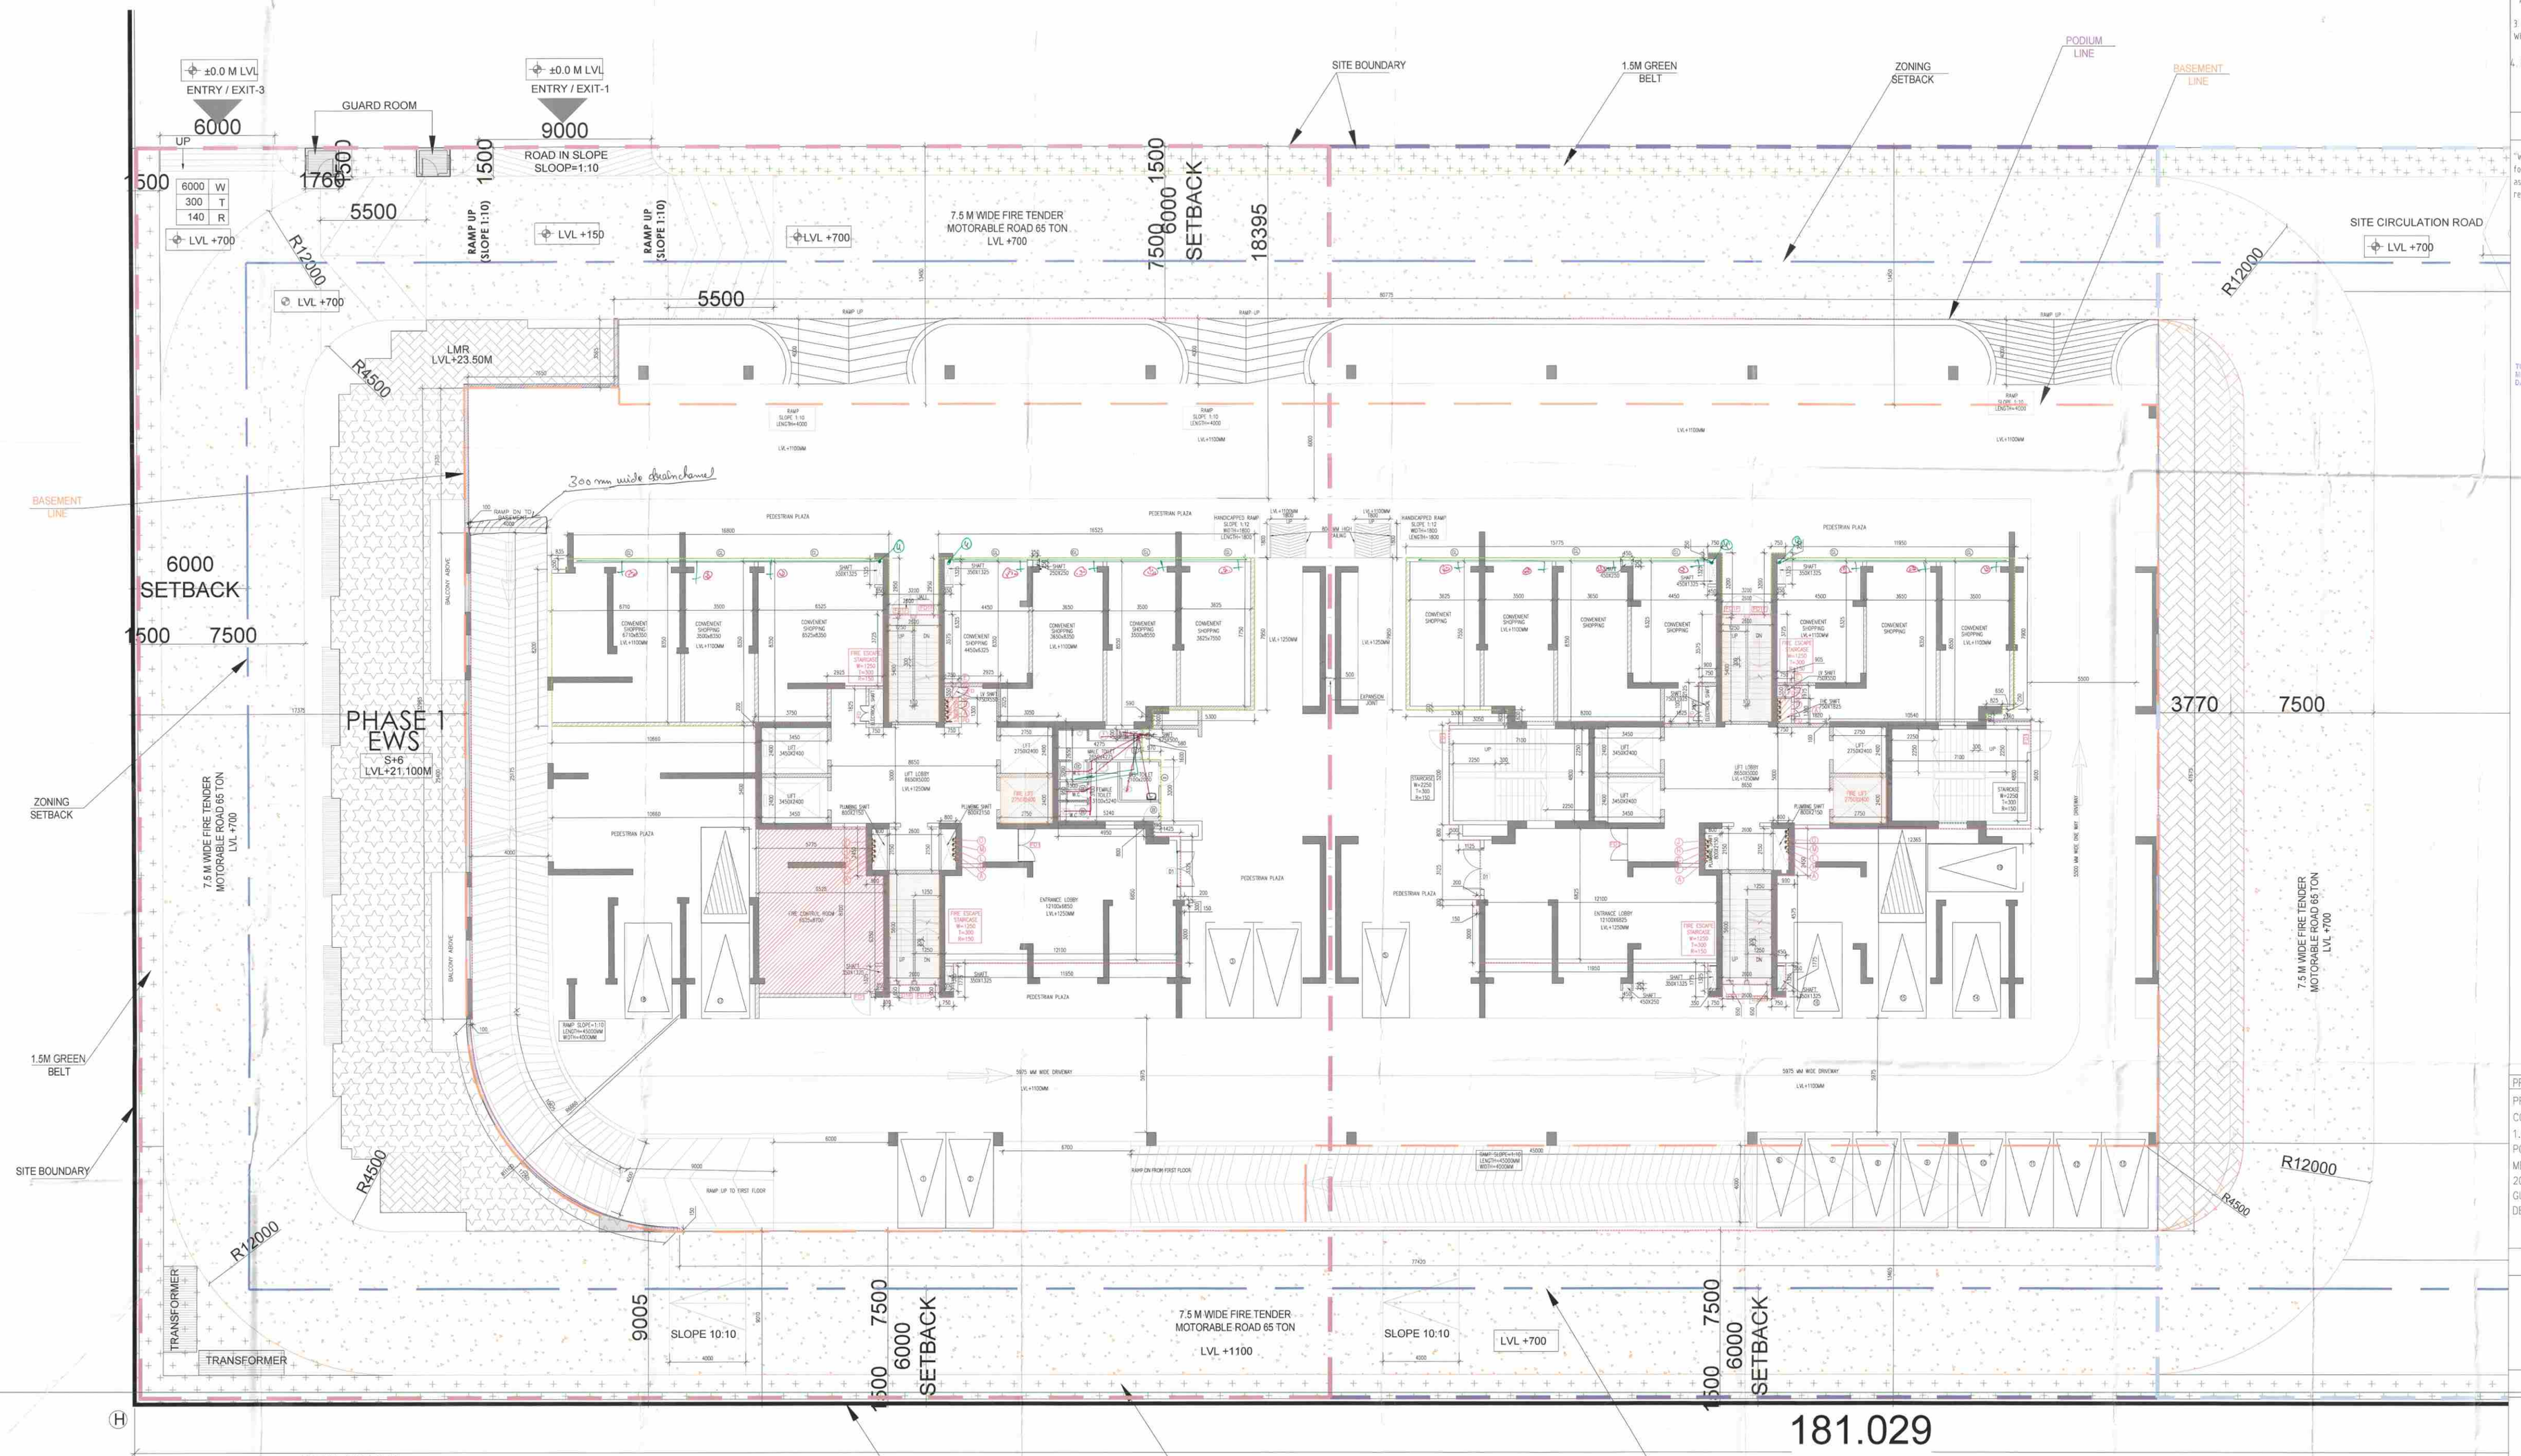

GROUND FLOOR PLAN
LVL+1250
NO OF CAR PARKING=19

FIRE FIGHTING LEGEND:-

S. No.	SYMBOL	DESCRIPTION
1.	A	80ø SPRINKLER DRAIN PIPE
2.	B	150ø SPRINKLER PIPE
3.	C	150ø HYDRANT PIPE
4.	D	CO2 FIRE EXTINGUISHER 4.5 Kg CAP (5) MARKED
5.	E	WATER CO2 FIRE EXTINGUISHER 9LTR CAP (5) MARKED

PLUMBING LEGEND:-

1	110 OD SOIL PIPE	
2	110 OD WASTE PIPE	
3	75 OD ANTI VENT PIPE	
4	DOMESTIC WATER SUPPLY PIPE	
5	FLUSHING WATER SUPPLY PIPE	
5	DOMESTIC WATER SUPPLY PIPE RISER	
5	FLUSHING WATER SUPPLY PIPE RISER	
R	110 OD RAIN WATER PIPE FOR BALCONY	
R1	160 OD RAIN WATER PIPE FOR TERRACE	
BD	BALCONY DRAIN	

Note :-

1. BUILDING HAS AUTOMATIC SPRINKLER SYSTEM WHEREVER REQUIRED BY NBC.
2. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVENT IS CODES FOR EARTH QUAKE RESISTANCE.
3. GROUND FLOOR SHALL BE MECHANICALLY LIGHT & VENTILATED WHEREVER & 100% POWER BACKUP.
4. BACK TO BACK PARKING FOR SINGLE UNIT OWNER ONLY.

Note :-

"We, hereby, undertake to pay EESDC for 33kV PPB @ Rs 31 Lakh per MVA as per notification dated 27th Sept 2023 regulation no. HERC/34/2016/2nd Amendment/2023"

B.T.P.(G) Member Secretary BPAC — B.T.P.(G) Member BPAC — C.T.P.(HR) Chairman BPAC

DTP(HQ) — AD — PA — ATP(HQ)

SANCTIONED TO BE READ WITH THIS OFFICE MEMO NO.: DATED:

Rajesh Dutt SO(HQ) — JD (HQ) Member BPAC

PROJECT:

PROPOSED BUILDING PLAN FOR MIX LAND USE COLONY (99.00% RESIDENTIAL COMPONENT + 1.00% COMMERCIAL COMPONENT) UNDER TOD POLICY DATED 09.02.2016 FOR AN AREA MEASURING 4.00 ACRES (LICENCE NO. 141 OF 2024 DATED 11.11.2024 IN SECTOR 88-A, GURUGRAM BEING DEVELOPERS PVT.

Checked and forwarded to Chief Engineer (HQ) HSVP, Panchkula only subject to comments in its forwarding letter No. 2014/3/2024 dt. 6-01-25

Superintending Engineer (HQ) for Chief Engineer-I HSVP, Panchkula

OWNER'S SEAL & SIGNATURE

ARCHITECT'S SEAL & SIGNATURE

Ar. Ravinder Kumar
CA/2012/55911
Mob.: 987 573

DEC.-2024. | Scale : 1:100

Drawing Title:- GROUND FLOOR PLAN

Drawing No:- 9.01