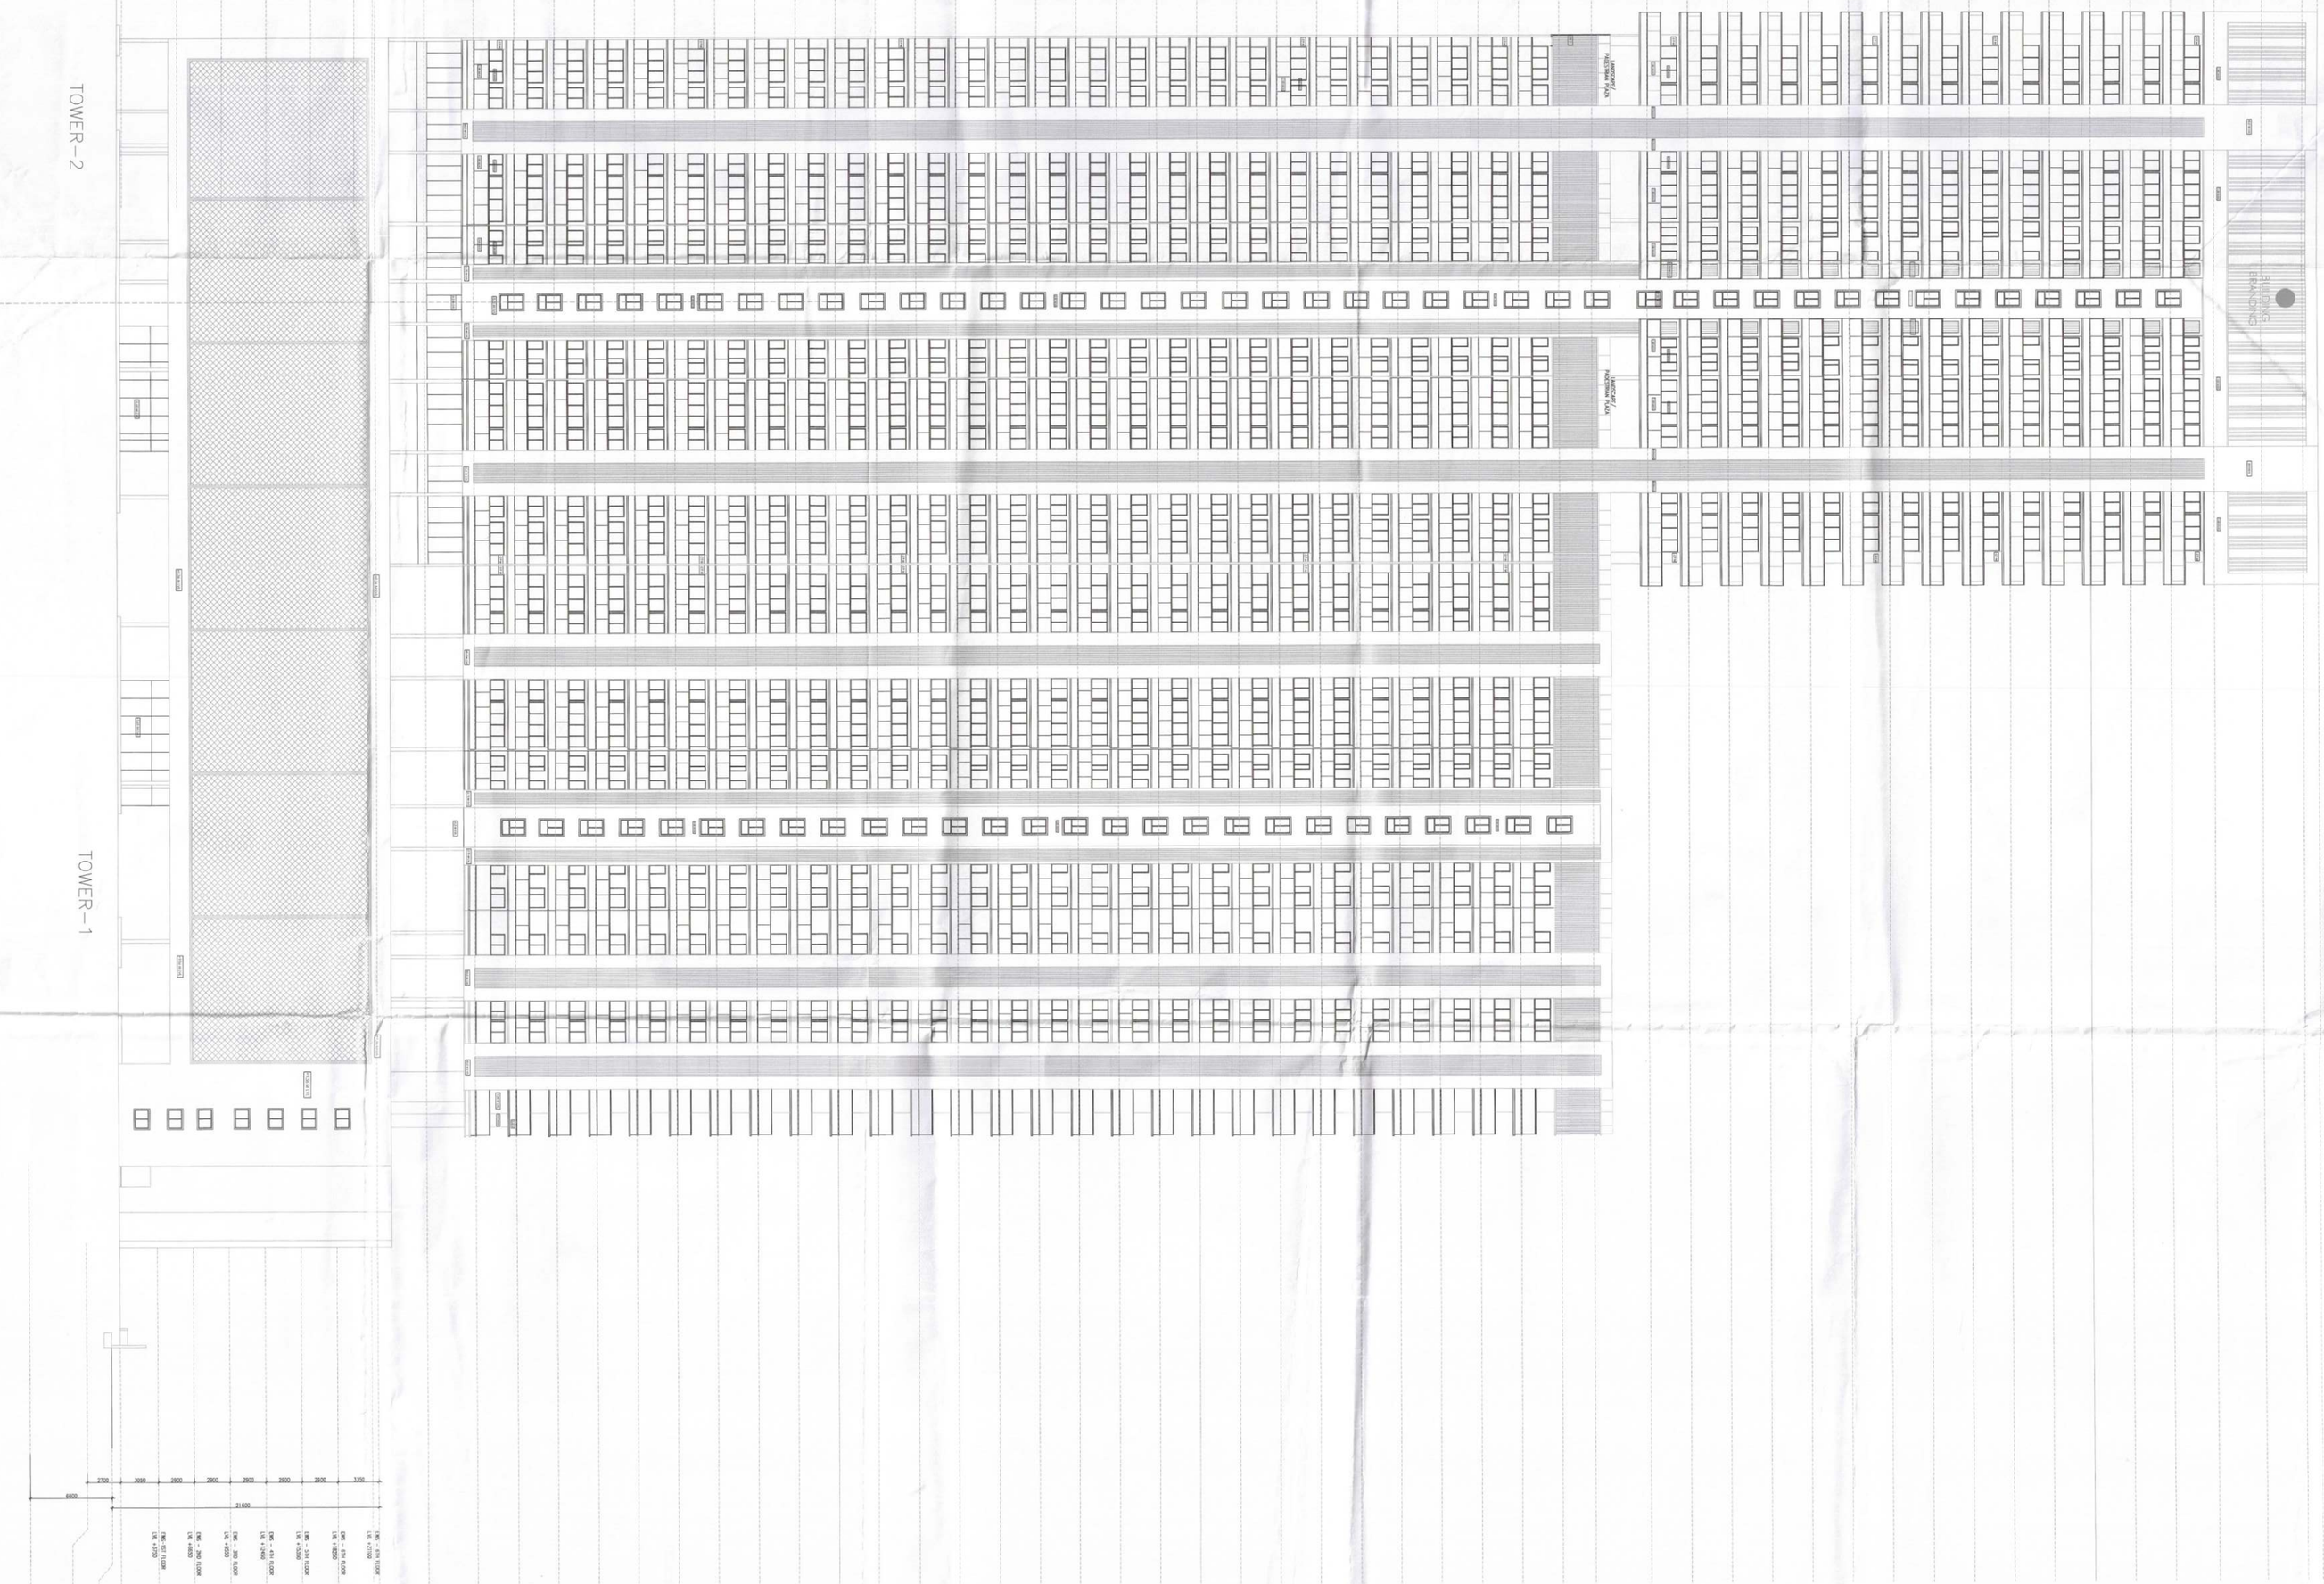

Note :-

1. BUILDING HAS AUTOMATIC SPRINKLER SYSTEM WHERE'VER REQUIRED BY NBC
2. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVENT IS CODES FOR EARTH QUAKE RESISTANCE.
3. WC SHALL BE MECHANICALLY LIGHT & VENTILATED WHEREVER REQUIRED

Note :-

"We, hereby, undertake to pay ESCOM for 33kV PPB @ Rs 31.4kh per MVA as per notification dated 27th Sept 2023 regulation no. KERC/31/2016/2nd Amendment/2023".

Lingaraju
Signature
Name:Gowrey
Member
BPAC

Ashwini
Signature
Member
BPAC

Chairman
BPAC

DTP(HO)

AD

FA

ATP

Jyothi (HO)
Member
BPAC

Rajesh Dale
SDO(HO)

SANCTIONED
TO BE READ WITH THIS OFFICE
MEMO NO.:
DATED :

OWNER'S SEAL
& SIGNATURE

ARCHITECT'S SEAL
& SIGNATURE

Ar. Ravishankar Kumar
CA/2012/55971
MOB.-9871004573

DEC.-2024. | Scale : 1:200

Drawing Title:- TOWER-1&2 ELEVATION - AA (WEST)

Drawing No:- EL-01

PROJECT:
PROPOSED BUILDING PLAN FOR MIX LAND USE COLONY (99.00% RESIDENTIAL COMPONENT + 1.00% COMMERCIAL COMPONENT) UNDER 100 POLICY DATED 09.02.2016 FOR AN AREA MEASURING 4.00 ACRES (LICENCE NO. 141 OF 2024 DATED 11.11.2024 IN SECTOR 88-A, GURUGRAM BEING DEVELOPED BY DEVASYA DEVELOPERS PVT. LTD.