


S.T.P. (HQ) Member Secretary B.P.A.C.
 S.T.P. (G) Member B.P.A.C.
 C.N.E. (HR) Chairman B.P.A.C.
 D.P.H. (HQ) Member B.P.A.C.
 A.T.P. (HQ) Member B.P.A.C.
 P.A. A.T.P.
 DINESH KUMAR P.A. (HQ)

Checked and found ok for Public Health (Internal) Service only subject to comments in In forwarding letter No. 3716-22 Dt. 26/1/25

Superintending Engineer for Civil Engineer-I H.S.V.P., Panchkula

NOTE:
 1. BUILDING HAS AUTOMATIC SPRINKLER SYSTEM WHEREVER REQUIRED BY NBC.
 2. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVANT IS CODES FOR EARTH QUAKE RESISTANCE.
 3. 100% POWER BACKUP MECHANICAL VENTILATED SHAFTS.

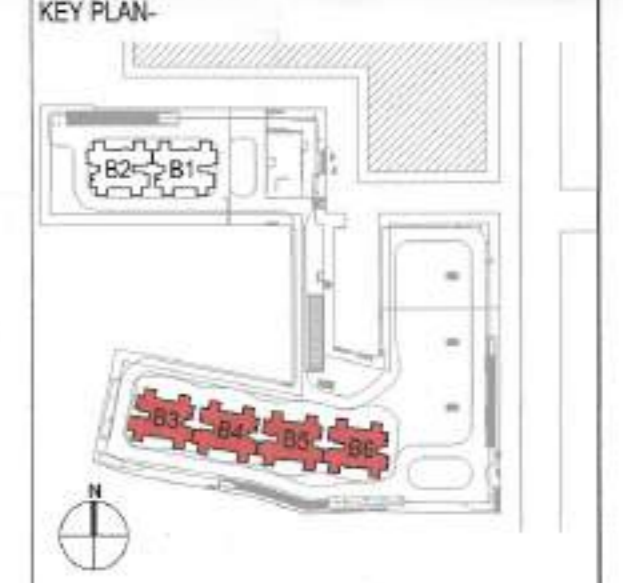

OWNER:
 M3M INDIA INFRASTRUCTURES PVT. LTD.

PROJECT:
 PROPOSED BUILDING PLAN OF GROUP HOUSING POCKET-B AREA MEASURING 0.1521 ACRES, PART OF INDUSTRIAL PLOTTED COLONY OVER AN AREA MEASURING 159.7975 ACRES LICENSE NO. 158 OF 2025 DATED 08.09.2025 IN THE REVENUE ESTATE OF VILLAGE BAS HARRA AND JHUNDI-SARAI ARABD. IN SECTOR M6, M10 AND M11 GURUGRAM MANESAR URBAN COMPLEX

ARCHITECTS:
STUDIO SYMBIOSIS
 INDIA | GERMANY | UK
 1301, TOWER 8, SKYMARK ONE
 SECTOR 28, INDIA, U.P. 20101, NOIDA
 TEL: +91 0120 4228979
 E-MAIL: INFO@STUDIOSYMBIOSIS.COM
 WWW.STUDIO-SYMBIOSIS.COM

OWNER'S SEAL & SIGNATURE:
 For M3M India Infrastructures Pvt. Ltd.
 (Signature)

ARCHITECTS SEAL & SIGNATURE:
 AMIT GUPTA
 Architect
 CA / 2004 / 083147

DATE: 31/12/25 SCALE: 1:100 DWG NO: PA-43846596-TE-01
 DWG TITLE: TERRACE FLOOR PLAN TOWER B3 B4 B5 B6

NON FAR AREA OF TOWER TYPE 1 AT MUMTY LVL


TAG	LENGTH (L) in Mts	WIDTH (W) in Mts	NO.S (N)	AREA (L x W x N)
A1	2.130	2.395	1	5.101
A2	1.585	4.055	1	6.427
A3	7.860	1.300	1	10.218
A4	7.110	6.825	1	48.526
A5	0.900	4.655	1	4.190
A6	3.265	4.055	1	13.240
A7	4.625	4.135	1	19.124
A8	3.730	6.200	1	23.126
A9	4.100	3.350	1	13.735
A10	2.860	0.100	1	0.286
A11	4.500	1.050	1	4.725
TOTAL (A)				148.698

NON FAR AREA OF TOWER TYPE 1 AT MACHINE ROOM & OHT LVL

TAG	LENGTH (L) in Mts	WIDTH (W) in Mts	NO.S (N)	AREA (L x W x N)
A1	2.130	2.395	1	5.101
A2	1.585	4.055	1	6.427
A3	7.860	1.300	1	10.218
A4	7.110	6.825	1	48.526
A5	4.085	4.055	1	16.565
A6	4.705	4.135	1	19.455
A7	3.730	6.200	1	23.126
TOTAL (B)				129.418

LEGEND:


S.N.	TITLE	Ø	CALL	NOTES
1	SLUING DOOR	3070	2500	± 00
2	SLUING DOOR	2540	2500	± 00
3	SLUING DOOR	3440	2500	± 00
4	SLUING DOOR	3410	2500	± 00
5	SLUING DOOR	3338	2500	± 00
6	SLUING DOOR	2990	2500	± 00
7	SLUING DOOR	3800	2500	± 00
8	SLUING DOOR	2700	2500	± 00
9	SLUING DOOR	2590	2500	± 00
10	SLUING DOOR	2440	2500	± 00
11	SLUING DOOR	1825	2500	± 00
12	SLUING DOOR	1475	2500	± 00
13	SLUING DOOR	1400	2500	± 00
14	FLUSH DOOR	1200	2500	± 00
15	FLUSH DOOR	1200	2500	± 00
16	FLUSH DOOR	800	2500	± 00
17	FIRE DOOR	1800	2200	± 00
18	FIRE DOOR	1500	2200	± 00
19	FIRE DOOR	1500	2200	± 100
20	FIRE DOOR	1200	2200	± 00
21	FIRE DOOR	300	2150	± 100
22	FIRE DOOR	100	2150	± 100
23	GLASS WINDOW	1100	2200	± 00
24	GLASS WINDOW	2000	2500	± 00
25	WINDOW	1500	1300	± 800
26	WINDOW	1075	1300	± 800
27	VENTILATOR	800	1200	± 1000
28	VENTILATOR	400	1200	± 1000

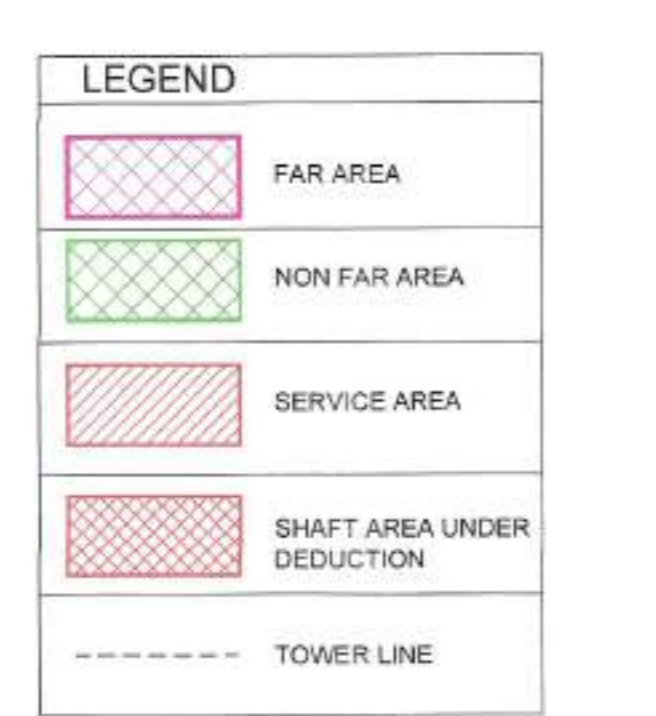


HORIZONTAL PIPE CONNECTIONS SHALL BE AS FOLLOWS:
 FROM WASH BASIN TO FT 320 PIPE
 FROM SINK TO FT 400 PIPE
 FROM FD TO FT 500 PIPE
 FROM FT TO VERTICAL STACK 1000 PIPE
 FROM WC TO VERTICAL STACK 1000 PIPE

PLUMBING LEGEND

S.NO.	DESCRIPTION
(A)	1500 FIRE PIPE LOWE ZONE BASEMENT TO 9th FLOOR
(B)	1500 FIRE PIPE MIDDLE ZONE 10th TO 23rd FLOOR
(C)	1500 FIRE PIPE HIGH ZONE 24th TO TERRACE LVL
(D)	1500 SPRINKLER PIPE LOWE ZONE BASEMENT TO 9th FLOOR
(E)	1500 SPRINKLER PIPE MIDDLE ZONE 10th TO 23rd FLOOR
(F)	1500 SPRINKLER PIPE HIGH ZONE 24th TO TERRACE LVL
(G)	1500 ALTERNATE SPRINKLER PIPE LOWE ZONE BASEMENT TO 9th FLOOR
(H)	1500 ALTERNATE SPRINKLER PIPE MIDDLE ZONE 10th TO 23rd FLOOR
(I)	1500 ALTERNATE SPRINKLER PIPE HIGH ZONE 24th TO TERRACE LVL
(K)	1500 FIRE DOWN COMER PIPE
(L)	800 DRAIN PIPE

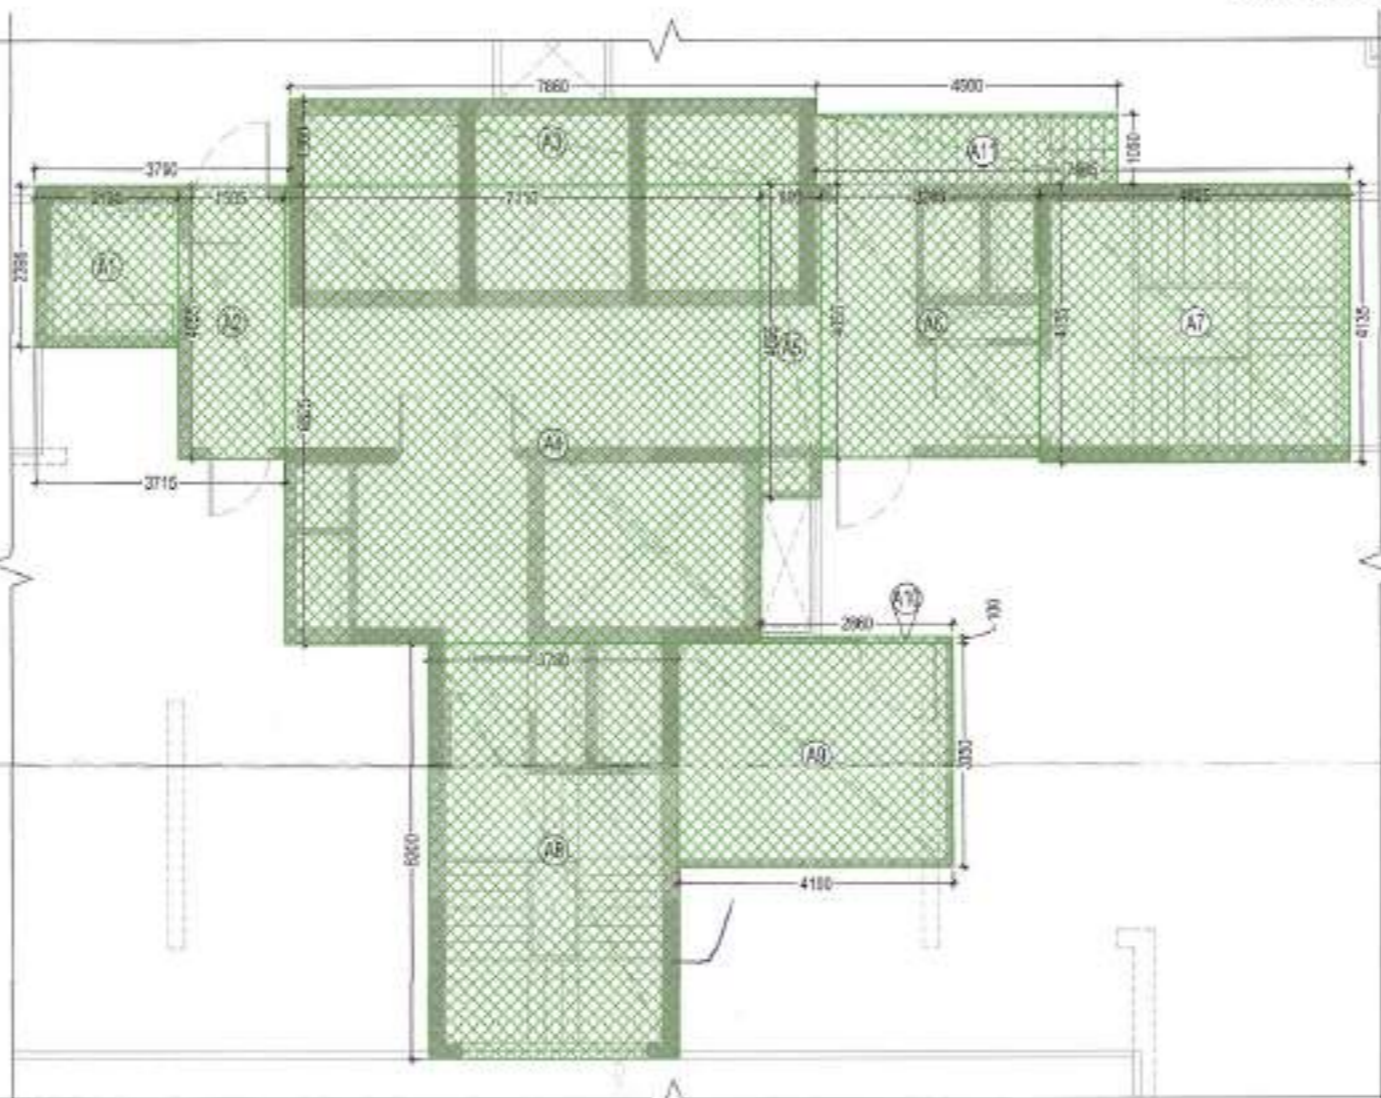

TOWER B3 B4 B5 & B6 TERRACE FLOOR AREA DIAGRAM

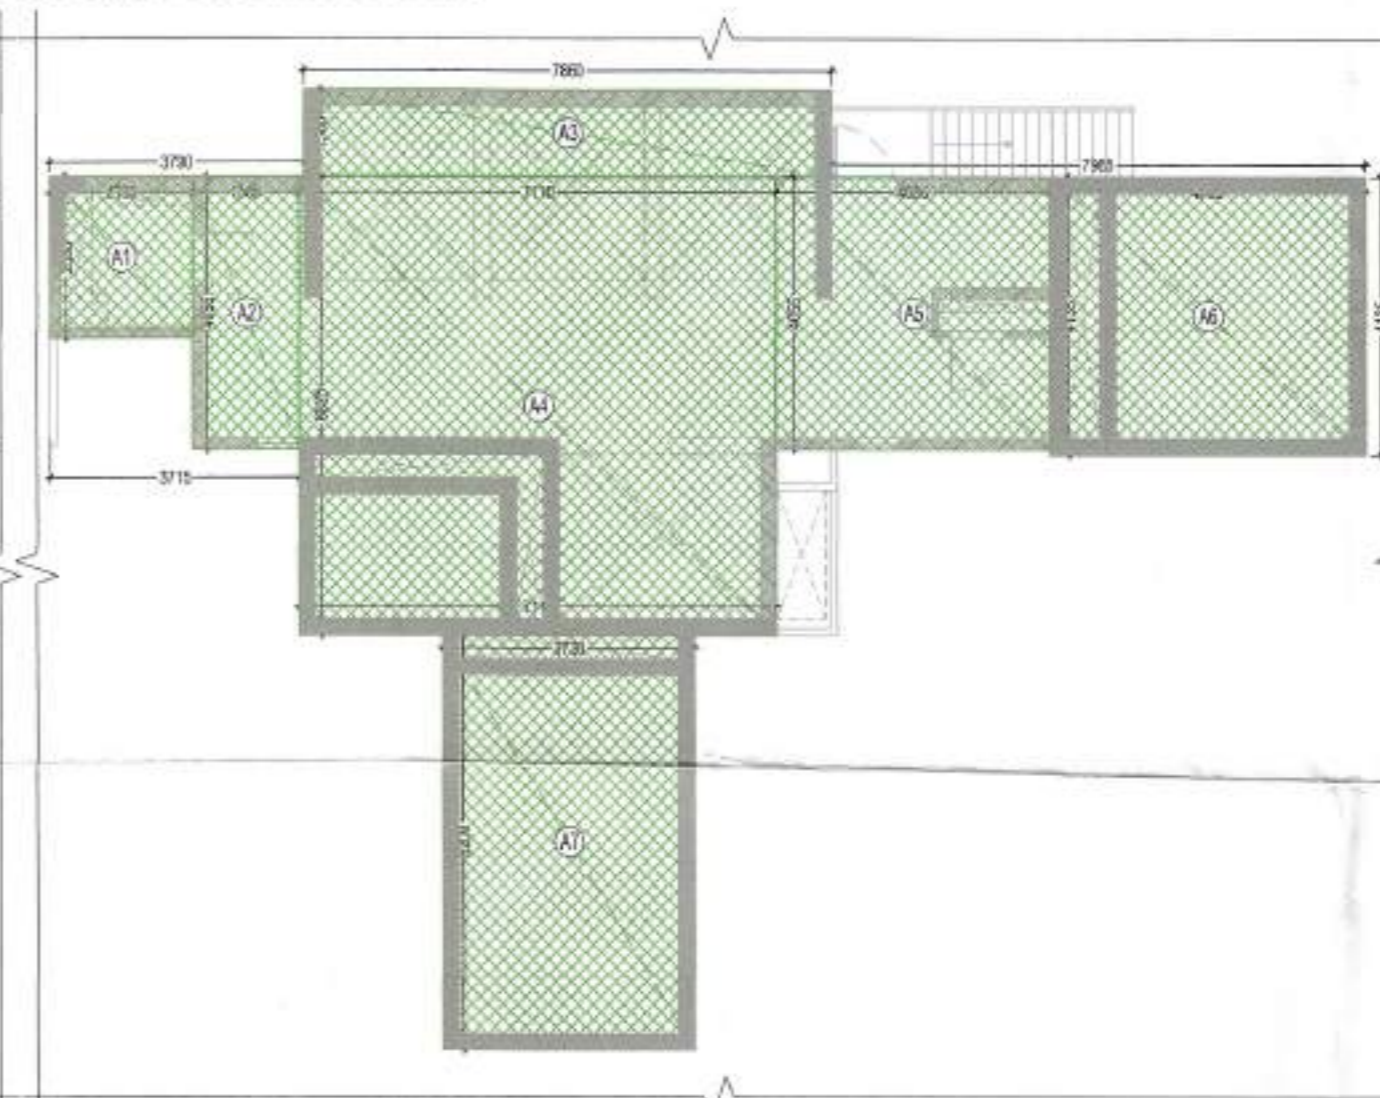

TOWER B3 B4 B5 & B6 MACHINE ROOM & OHT LEVEL AREA DIAGRAM

SANCTIONED TO BE READ WITH THIS OFFICE MEMO NO. 50032 DATED: 31/12/25