

TOP OF WATER TANK
TOS +142350

TOP OF MUMTY
TOS +135200

TERRACE
TOS +136050

36TH FLOOR
FFL LVL +132750

38TH FLOOR
FFL LVL +129450

37TH FLOOR
FFL LVL +128150

36TH FLOOR (REFUGE FLOOR)
FFL LVL +122850

35TH FLOOR
FFL LVL +119350

34TH FLOOR
FFL LVL +116250

33RD FLOOR
FFL LVL +112850

32nd FLOOR
FFL LVL +109650

31st FLOOR
FFL LVL +106350

30TH FLOOR
FFL LVL +103550

29TH FLOOR
FFL LVL +99750

28TH FLOOR
FFL LVL +96450

27TH FLOOR (REFUGE FLOOR)
FFL LVL +93150

26TH FLOOR
FFL LVL +89850

25TH FLOOR
FFL LVL +86550

24TH FLOOR
FFL LVL +83250

23RD FLOOR
FFL LVL +79950

22nd FLOOR
FFL LVL +76650

21st FLOOR
FFL LVL +73350

20TH FLOOR
FFL LVL +70050

19TH FLOOR
FFL LVL +66750

18TH FLOOR
FFL LVL +63450

17TH FLOOR (REFUGE FLOOR)
FFL LVL +60150

16TH FLOOR
FFL LVL +56850

15TH FLOOR
FFL LVL +53550

14TH FLOOR
FFL LVL +50250

13TH FLOOR
FFL LVL +46950

12TH FLOOR
FFL LVL +43650

11TH FLOOR
FFL LVL +40350

10TH FLOOR
FFL LVL +37050

9TH FLOOR
FFL LVL +33750

8TH FLOOR
FFL LVL +30450

7TH FLOOR
FFL LVL +27150

6TH FLOOR
FFL LVL +23850

5TH FLOOR
FFL LVL +20550

4TH FLOOR
FFL LVL +17250

3RD FLOOR
FFL LVL +13950

2nd FLOOR
FFL LVL +10650

1st FLOOR
FFL LVL +7350

STLT/GROUND LEVEL
FFL LVL +750

INTERNAL ROAD
FFL LVL +600


EXTERNAL ROAD
500

BASEMENT-1
FFL LVL -5250

BASEMENT-2
FFL LVL -9150

BASEMENT-3
FFL LVL -13050

BASEMENT-4
FFL LVL -16950

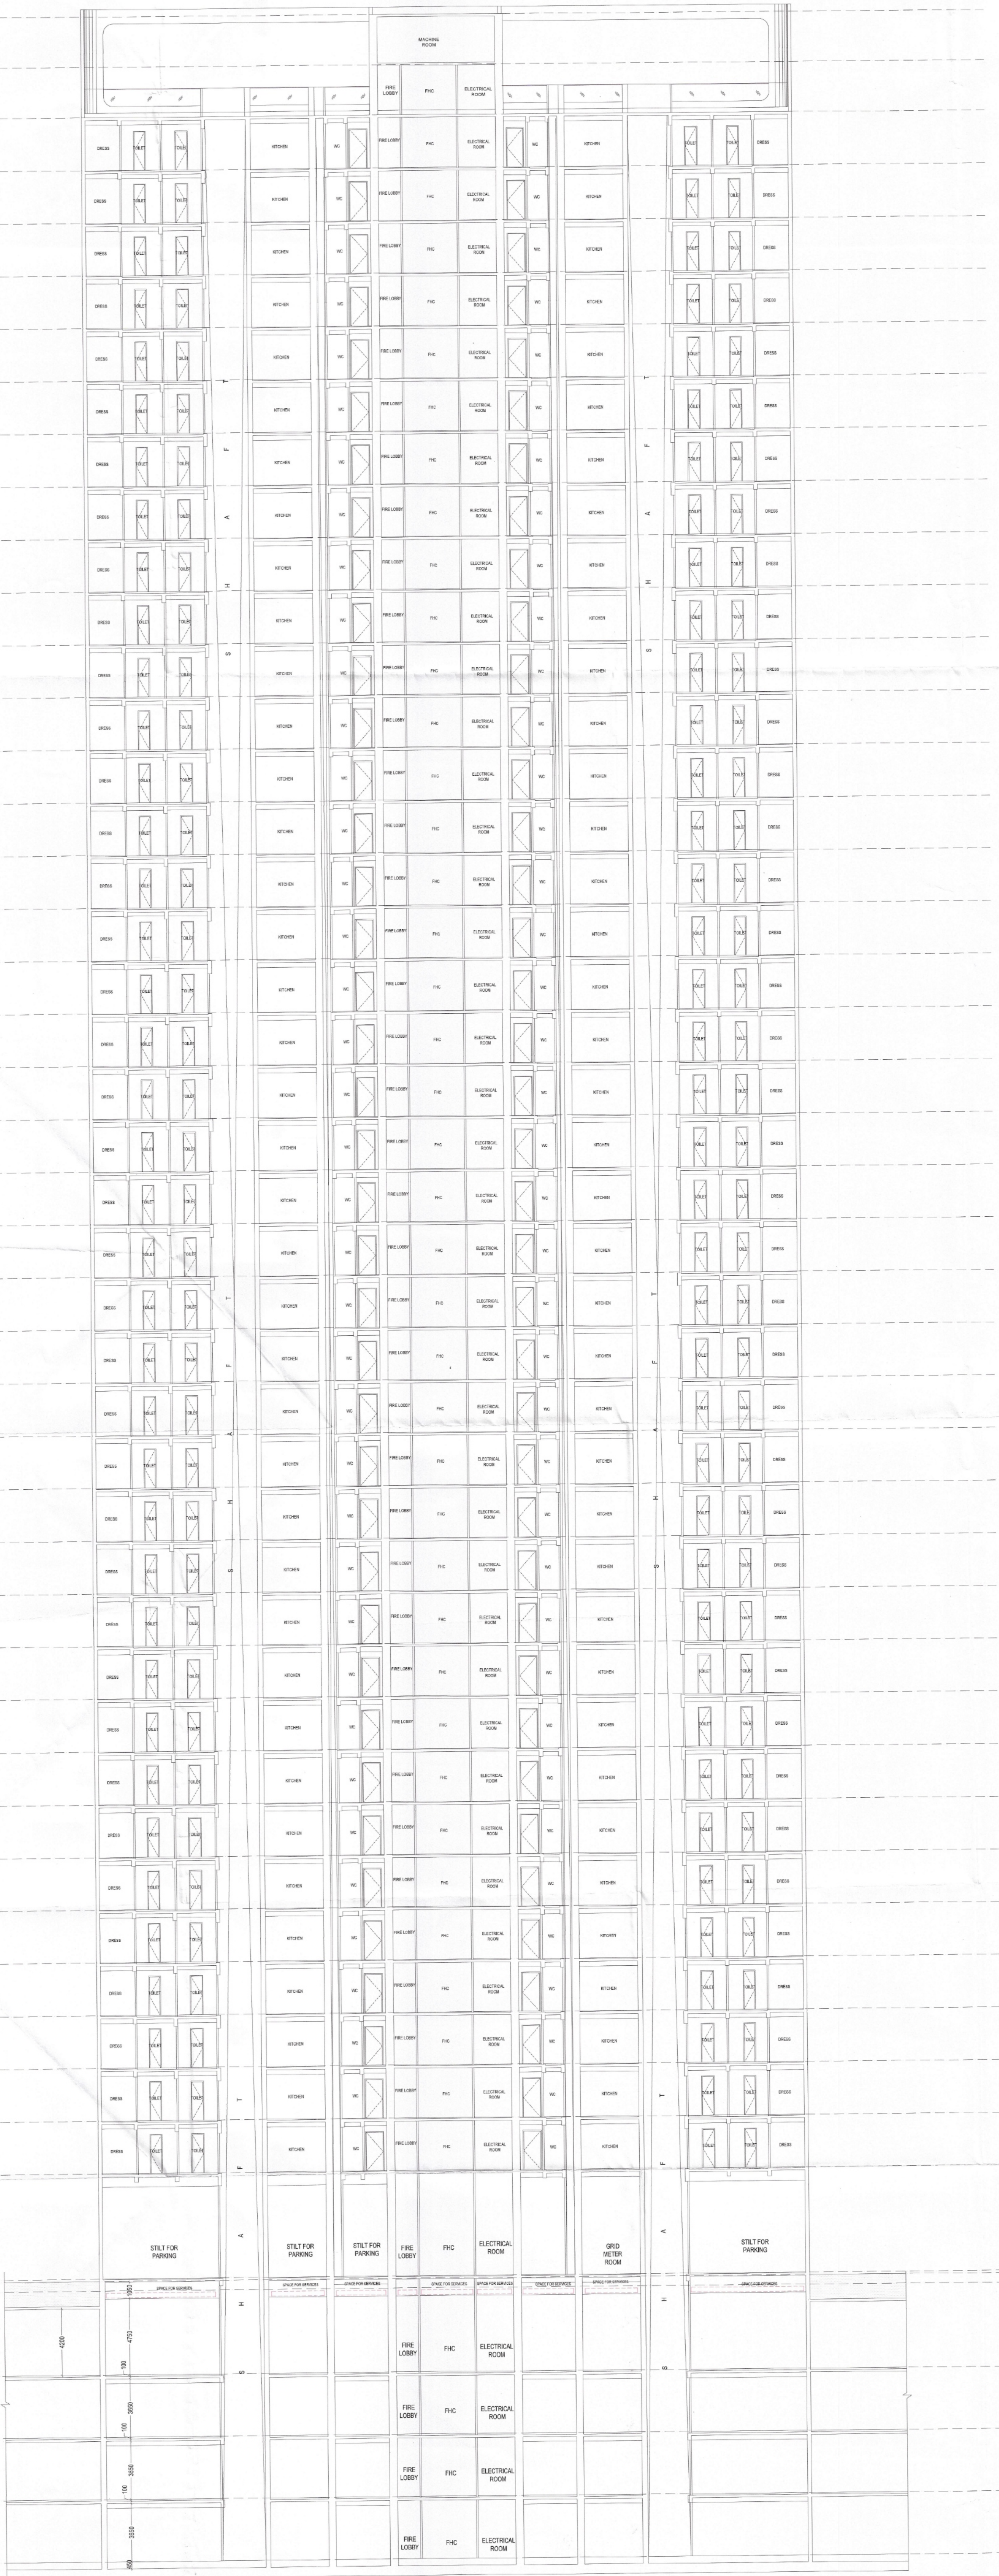

SECTION-2
TOWER-4

Member Secretary
S.T.P. (HQ)
B.P.A.C.

Member
S.T.P. (G)
B.P.A.C.

Chairman
C.A.P. (HQ)
B.P.A.C.

DTP (HQ)

PA

A.T.P.

ADP (HQ)

DINESH KUMAR
PA (HQ)

F.S.O. (HQ)
Member
B.P.A.C.

SANCTIONED
MEMO NO.:
DATED:

Note :-

AIR CONDITIONING SYSTEM IS BEING PROVIDED.
DC POWER BACKUP IS BEING PROVIDED.
TOILET ARE MECHANICAL VENTILATED.
ALL LIFTS SHALL HAVE POWER BACK-UP.
ALL ELECTRICAL INSTALLATION SHELL BE AS PER PROVISION OF RELEVANT CODE.
FIRE/FIGHTING/SAFETY PROVISIONS WILL BE AS PER RELEVANT CODE PROVISIONS.
BASEMENT AREA SHELL HAVE MECHANICALLY VENTILATED AS PER RELEVANT CODE.
ALL TOILETS ARE VENTILATED AS PER HARYANA BUILDING CODE 2017.
BUILDINGS HAS AUTOMATIC SPRINKLER SYSTEM WHEREVER REQUIRED BY RELEVANT CODE.
BUILDING WILL BE DESIGNED (STRUCTURES)AS PER RELEVANT I.S.CODES FOR EARTHQUAKE RESISTANCE.
SOLAR PANELS OF REQUIRED CAPACITY SHELL BE PROVIDED AS PER HARE DA/ZONING NORMS.
ALL HANDICAP RAMPS WITH RAILING.
ALL FIRE FIGHTING INSTALLATIONS SHELL BE AS PER PROVISION OF RELEVANT CODE.
THE RAINWATER HARVESTING SYSTEM SHELL BE PROVIDED AS PER CENTRAL GROUND WATER AUTHORITY NORMS.

PROJECT:

Proposed Building Plans for Phase-1 of Residential Colony under NILP Policy 2022, Licence No. 129 of 2025 Dated 23.07.2025 over an area measuring 11.35625 Acres in the Revenue Estate of Village Ullawas, Sector-60 & 63 A, Gurugram being Developed by Godrej Properties Ltd.

ASSOCIATE ARCHITECTS

ACPL DESIGN PVT. LTD.
E - 24, South Extension Part -1,
New Delhi, Delhi, India - 110049.

OWNER'S SEAL
& SIGNATURE

For Godrej Properties Ltd.
Authorised Signatory

ARCHITECT'S SEAL
& SIGNATURE

ACPL DESIGN PVT. LTD.
E - 24, South Extension Part -1,
New Delhi, Delhi, India - 110049.

MAY.-2026 Scale : 1:100

Drawing Title:- SECTION-2 TOWER-4

Drawing No:- SC-10