PLUMBING LEGEND:-

- RAIN WATER PIPE
- WASTE PIPE
- SOIL PIPE
- CWS... COLD WATER SUPPLY
- FWS... FLUSHING WATER SUPPLY

LEGEND FOR PLUMBING
(1) 110 OD uPVC SOIL & VENT PIPE
(2) 110 OD uPVC WASTE & VENT PIPE
(3) 80M ANTISPHONAGE PIPE
(4) DOMESTIC WATER SUPPLY(ON TIME PIPE
(5) FLUSHING WATER SUPPLY(ON TIME PIPE
(6) HOT WATER SUPPLY FROM SOLAR PANEL, (IN TIME PIPE) MASTER BED ROOM
(8) 160MOD RAIN WATER PIPE
(9) 110MOD RAIN WATER PIPE
(10) 50M uPVC WATER SUPPLY(BEER (DOMESTIC)
(11) 32M uPVC WATER SUPPLY(BEER (FLUSHING)
(12) 160 OD uPVC RAIN WATER PIPE FOR TERRACE
(13) 160 OD uPVC RAIN WATER PIPE FOR BALCONY
(14) 110 OD uPVC RAIN WATER PIPE FOR TERRACE

PLUMBING LEGEND
WASTE PIPE
SOIL PIPE
RW PIPE
FWS PIPE

NOTES ON FIRE FIGHTING SERVICES :

1. THIS DRAWING REPRESENTS ONLY A PLUMBING & FIRE FIGHTING DETAIL, FOR ARCHITECTURAL, STRUCTURAL AND OTHER SERVICES REFER RELEVANT DRAWINGS.
2. ALL DIMENSIONS SHOWN IN DRAWINGS ARE IN MM AND MUST BE CO-ORDINATED WITH THE ARCHITECTURAL DRAWINGS.
3. THE EXACT LOCATION OF SPRINKLERS AS SHOWN IN THE DRAWING MAY BE ADJUSTED IF REQUIRED, AS PER SITE CONDITION.
4. THE LOCATION OF SPRINKLER MAY VARY AS PER ARCHITECTURAL CO-ORDINATION DRAWING. THE SPRINKLERS SHALL BE GENERALLY INSTALLED 3.5 M.C/C TO COVER AN AREA OF APP.12.5 SQ. M.
5. PLEASE CO-ORDINATE THIS DRAWING WITH ALL OTHER RELEVANT DRAWINGS FOR ALL THE SERVICES.
6. THE SPRINKLER SHALL BE INSTALLED GENERALLY AS PER NBC GUIDELINES OR ANY OTHERS RELEVANT CODES & STANDARDS. IT SHALL BE THE RESPONSIBILITY OF THE EXECUTING AGENCY TO CHECK THE SITE CONDITION ACCORDINGLY
7. THE SPRINKLER INSTALLATION SHALL BE IN COMPLETE COMFORMANCE WITH CODE IS:15105 2002 & OTHER RELEVANT GUIDELINES
8. Sprinkler shall be provided to cover an average area of 12 sq. mts with a max. distance of 4 mts. center/center. Every FHC shall be consisting of as per IS the following
   1- 63mm dia. single headed Hydrant Valve.
   2- 2nos. 63mm dia. 15mts long RL. Hose reel.
   3- 20mm dia 36.5mt first aid hose reel with 5mm bore nozzle.
   4- 63mm dia. male and female INST coupling.
   5- 20mm dia. branch pipe

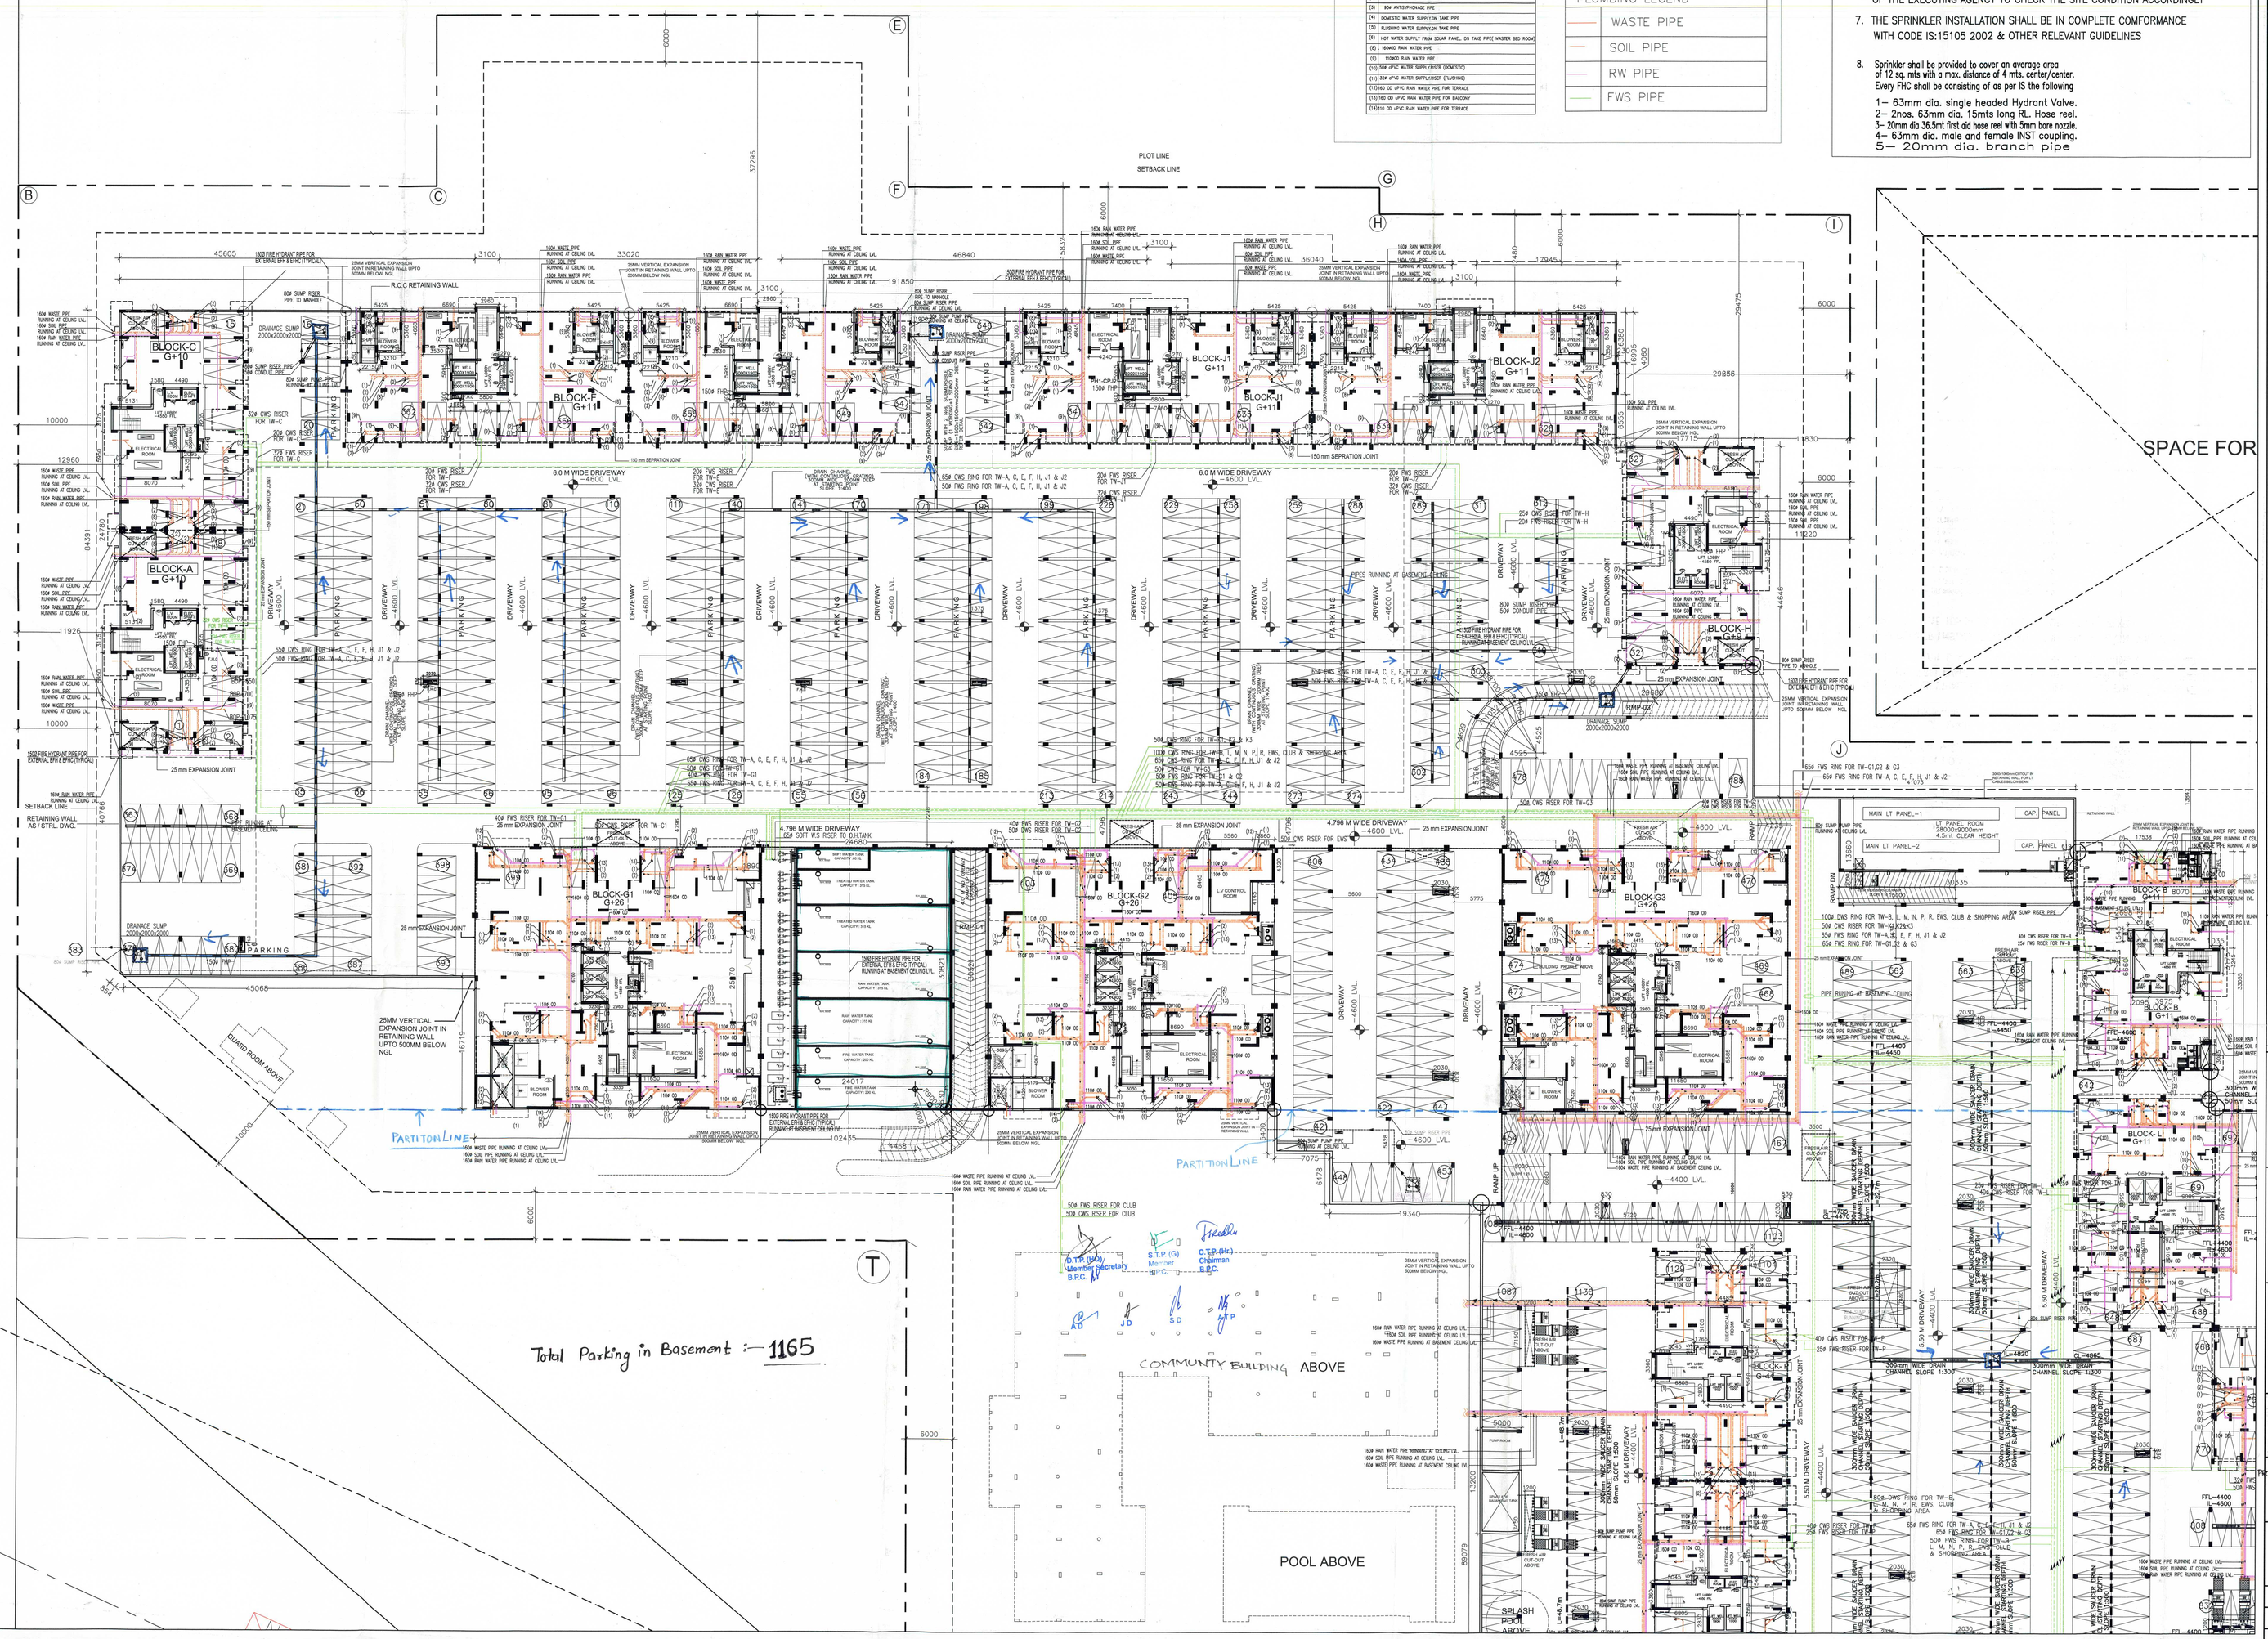

Total Parking in Basement :- 1165

PLUMBING LEGEND:-

- RAIN WATER PIPE
- WASTE PIPE
- SOIL PIPE
- CWS... COLD WATER SUPPLY
- FWS... FLUSHING WATER SUPPLY

1..... SOIL PIPE
2..... WASTE PIPE.
8..... 160MOD RAIN WATER PIPE
9..... 110MOD RAIN WATER PIPE
COP.... CLEAN OUT PLUG

Notes

- Dimensions are not to be scaled.
- Dimensions are not to be scaled.
- All Dimensions Are In MM
- All windows & ventilators are openable
- All walls are 230/115 thk. Brick Wall

Issues

No.	Date	By	Description

Revisions

KEY PLAN



DOOR WINDOW SCHEDULE

S.NO	LEGEND	CILL (MM)	LINTEL (MM)	WIDTH (MM)	HEIGHT (MM)
1	D	-	2150	1000	2150
2	FD1	-	2150	1000	2150
3	FD2	-	2150	900	2150
4	RS1	-	2400	2000	2400
5	D1	-	2400	2400	2400
5	D2	-	2400	1500	2400

Owner's Signature

Architect's Signature

Manish Kr. Bagga Architect
Council of Architecture
Registration No. CA/05/18626

Architects
Ar Associates Pvt. Ltd.
Plot No-36, Sector-32, Gurgaon
HARYANA - 122001
INDIA
Ph.: +91-124-4595500 , 4371200
Fax: +91-124-4595550

Checked and found ok for Public Health (Internal) Services only subject to comments in building letter No. BEN/OC 582 Dt. 9/10/12
Superintending Engineer
Hemu Panchkula

Clients
M/s Selene Constructions
F-60 , Malhotra Building, II Floor ,
Cannaught Place, New Delhi-110001
& Vindhyachal Land Development Ltd.

Job Title
PROPOSED BULDING PLAN OF REVISED GROUP HOUSING AT SECTOR-103 , FALLING IN REVENUE ESTATE OF VILLAGE DAULATABAD THESIL &DIST. GURGAON,HARYANA

Drawing Title
BASEMENT PLAN
(PART-1)

SANCTIONED
to be read in conjunction with memo No. 36133 Dt. 18/04/13

Job No.		Drawing No.
Drawn	Checked	AR-A-03
Date 04.07.2012	Scale 1:200	Revisions