

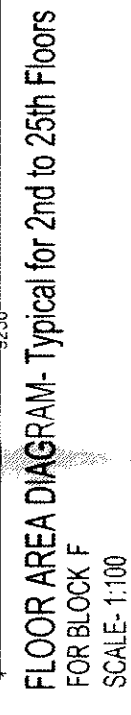
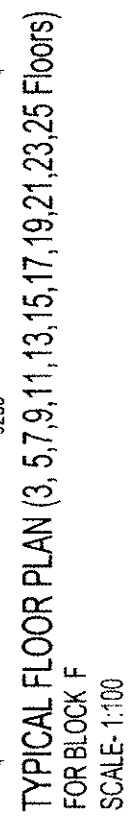


1. ALL LIFTS SHALL HAVE 100% POWER BACK-UP.
2. ALL ELECTRICAL INSTALLATIONS SHALL BE AS PER PROVISIONS OF NBC.
3. VENTILATION IN 15 AIR CHANGES PER HOUR FOR NBC PROVISIONS 12-15 AIR CHANGES PER HOUR FOR NORMAL OPERATION OR 40 CHANGES PER HOUR FOR OPERATION IN CASE OF FIRE
4. FIRE-FIGHTING / SAFETY PROVISIONS WILL BE AS PER RELEVANT NBC PROVISIONS
5. BUILDING STRUCTURE DESIGNED EARTH QUAKE RESISTANT
6. ALL RUMPS ARE 110 SLIP FOR CARS & 120 FOR HANDICAPPEDS WITH UNLESS SPECIFIED
7. 200 mm WIDE (AO) BLOCKS SHALL BE USED FOR INTERNAL WALLS & 100 mm WIDE (AO) BLOCKS SHALL BE USED FOR EXTERNAL WALLS
8. KITCHEN & TOILETS EXHAUST FAN PROVIDED / MECHANICALLY INT & VENTILATED.

TOTAL FLOOR AREA FOR

FLOOR AREA DIAGRAM- 20th Floor
FOR BLOCK F
SCALE- 1"=100'



To be read in conjunction with Memo No 9636 Dtd 6/1/67

5 P.C.

Architects Signature: _____

96
ul p

C. Sante

John Wiley & Sons, Inc.

developed by MATHGORT ESTATES PVT. LTD.

100

Form	SR	Revisions
Date	Scale	