


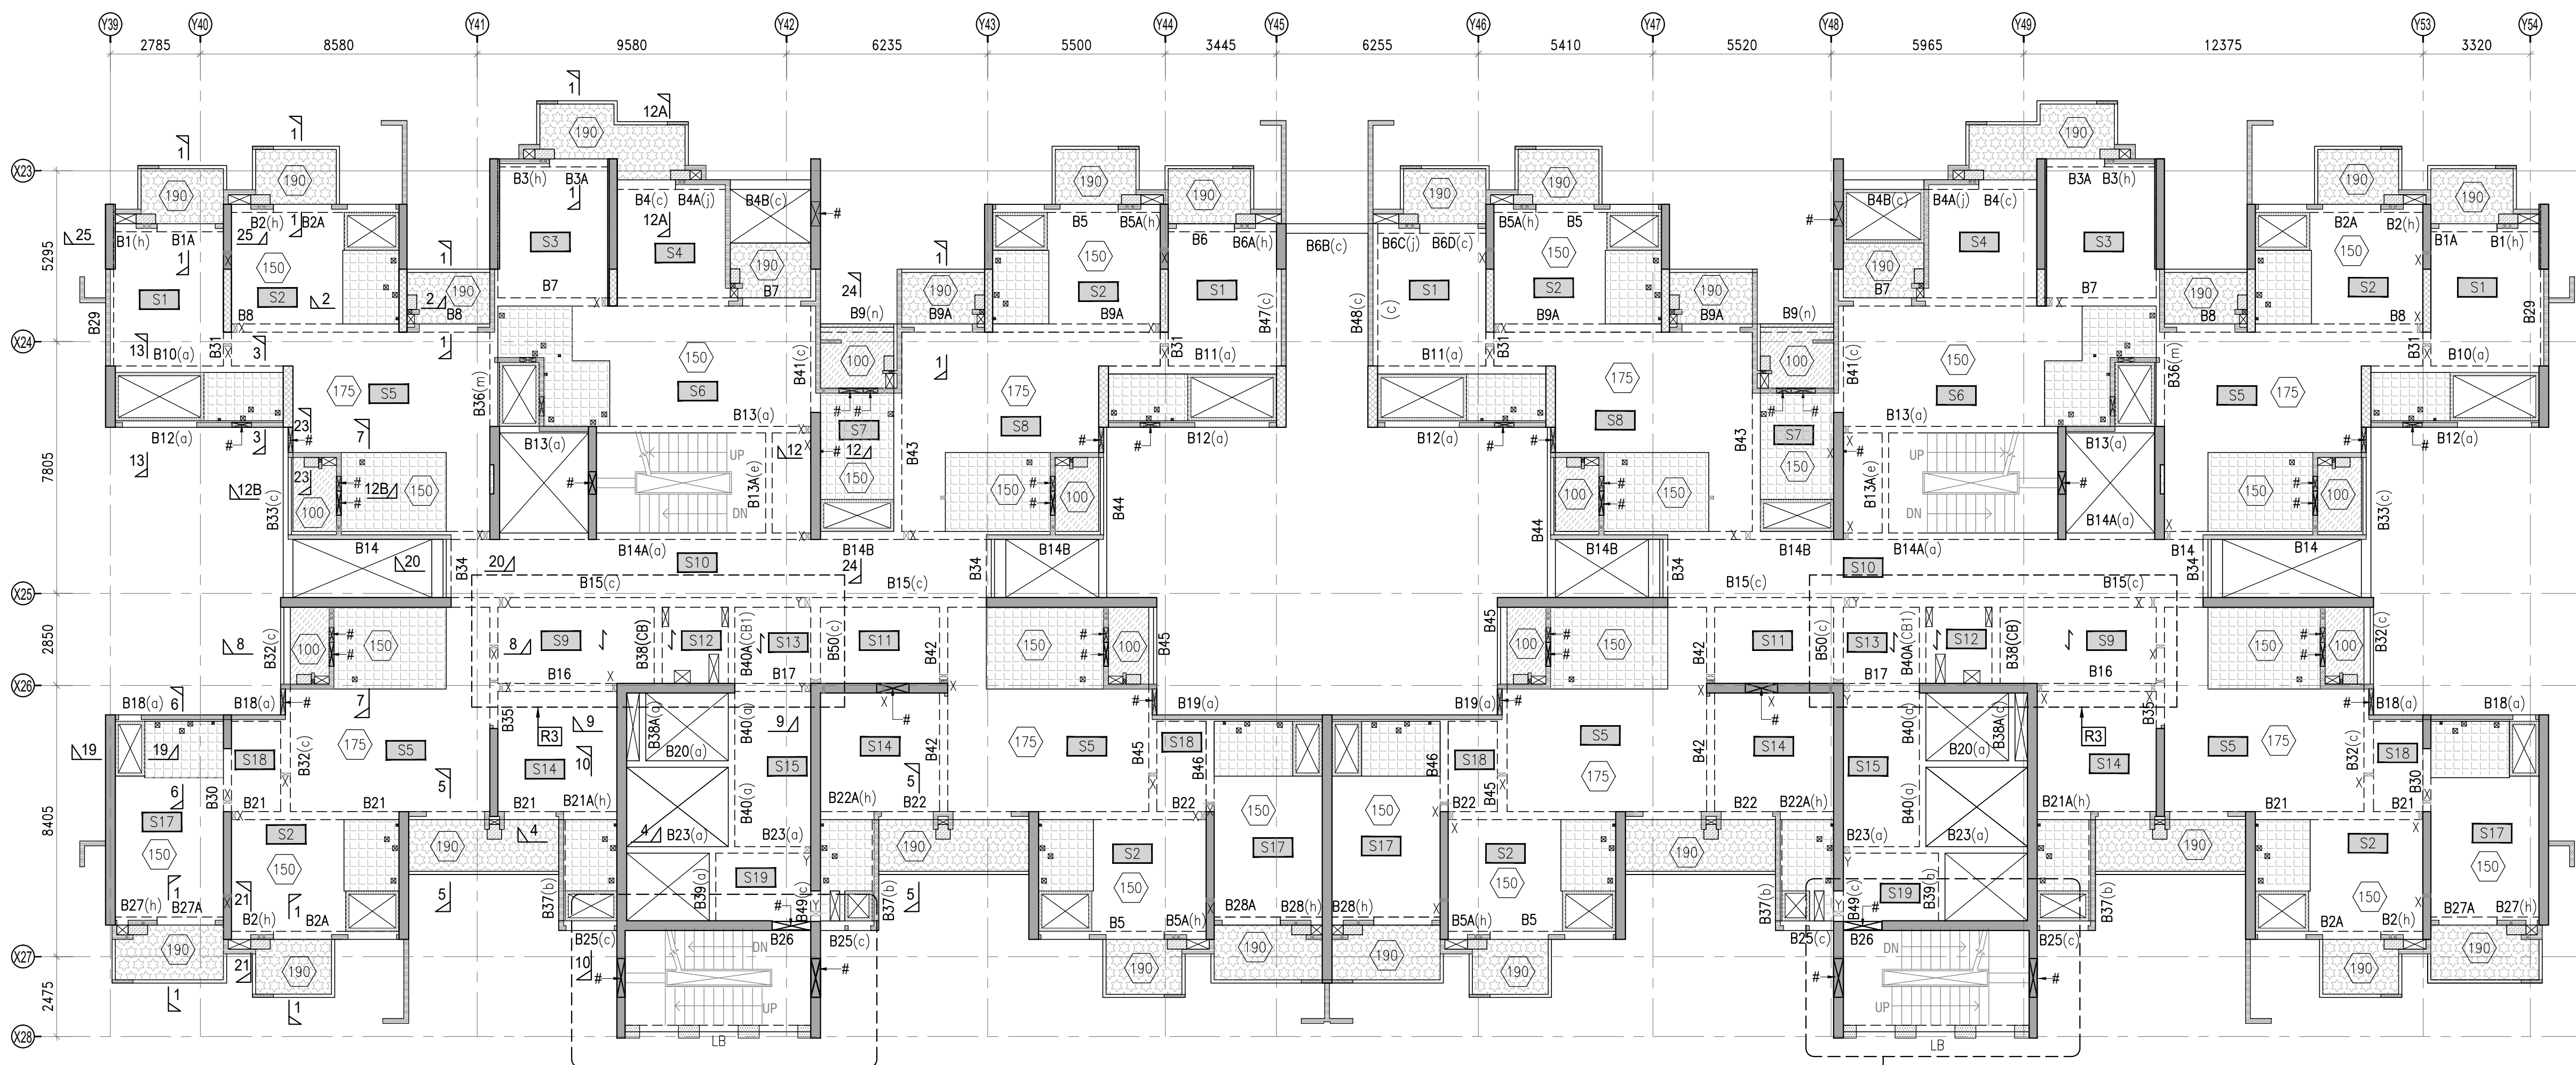

FOR STAIR DETAIL REFER
DWG. NO:-5182-22-302

6TH,7TH,8TH,12TH,13TH,14TH,19TH,22ND,23RD,24TH,
28TH,29TH & 30TH FLOOR FRAMING PLAN
(SCALE 1:125)

FOR STAIR DETAIL REFER
DWG. NO:-5182-22-309

	HATCH INDICATE COLUMN THROUGH FOUNDATION TO TERMINATION.
	HATCH INDICATE COLUMN/SHEAR WALL TERMINATE.
	HATCH INDICATE STUB COLUMN.

	HATCH INDICATE 25MM TOILET/KITCHEN SUNK
	HATCH INDICATE 50MM BALCONY SUNK
	HATCH INDICATE 50MM ADDITIONAL LOCALIZED SUNK
	HATCH INDICATE 175MM BALCONY SUNK
	HATCH INDICATE RCC LEDGE SLAB PROJECTION
	HATCH INDICATE 75MM SUNK

	HATCH INDICATE NON STRUCTURAL WALLS/ELEVATION ELEMENTS
	MARKED INDICATE OPENING IN RCC WALL , SHEAR WALL & BEAM
	HATCH INDICATE NON STRUCTURAL WALLS TO BE TERMINATED AT TOP OF RAILING LEVEL AS/ ARCH.

SCHEDULE OF BEAM SIZE :-

MARK	BEAM SIZE
(a)	200X600
(b)	200X575
(c)	300X600
(e)	200X525
(f)	250X425
(g)	300X575
(h)	250X500
(j)	300X500
(k)	200X425
(l)	300X425
(m)	250X600
(n)	250X525
(CB)	250X125
(CB1)	200X125

ALL BEAM SIZE SHALL BE 250X600 (U.N.O)
ALL SLAB SHALL BE 125MM THICK (U.N.O)

SPECIAL NOTES:-

- ONLY CUTOUTS AND SLEEVES IN FRAMING PLAN ARE APPROVED BY STRUCTURAL CONSULTANT. LOCATION AND SIZE OF CUTOUT & SLEEVES SHALL BE CONFIRMED WITH RELEVANT ARCHITECTURAL AND SERVICE DRAWINGS. ANY DEVIATION SHALL BE BROUGHT IN NOTICE OF STRUCTURAL CONSULTANT.
- MILD STEEL CIRCULAR SLEEVE SHALL BE PROVIDED (IF REQUIRED) IN BEAMS AT THE TIME OF CASTING ONLY.
- ADDITIONAL REINFORCEMENT SHALL BE PROVIDED NEAR SLAB & BEAM OPENING AS PER GIVEN DETAILS
- BEAMS SHALL BE PLACED TO COLUMN FACE OR AS PER MASONRY WALL LAYOUT GIVEN IN ARCHITECTURAL DRAWING OR AS PER DIMENSIONS GIVEN IN FRAMING PLAN. ALL SECONDARY BEAMS SHALL BE PLACED EQUALLY IN BETWEEN PRIMARY BEAMS (UNLESS MENTIONED).
- ALL SUNKEN AREAS AND SUNKEN DEPTH SHOWN ARE BASED ON INPUTS FROM ARCHITECTURAL DRAWINGS AND SERVICE CONSULTANTS. ALL SUNKEN AREAS SHALL BE FILLED WITH LIGHT WEIGHT MATERIAL OF DENSITY NOT MORE THAN 1000KG/M³.

- DOWEL BARS FOR ELEVATION FEATURE/ FUTURE CONSTRUCTION SHALL BE PROVIDED WHILE CASTING WITH PROPER SHEAR KEY.
- FOR THE PURPOSE OF LOADING MASONRY UNIT CONSIDERED AS LIGHT WEIGHT AAC BLOCKS - CUMULATIVE DENSITY OF 1000KG/M³.
- BASED ON ARCHITECTURAL DRAWINGS MASONRY LAYOUT HAS BEEN SHOWN ON FRAMING PLAN FOR REFERENCE ONLY. ANY DEVIATION SHALL BE BROUGHT IN NOTICE OF STRUCTURAL CONSULTANT
- PROVIDED 2-T12 (T&B) IN SLABS UNDERNEATH MASONRY WALLS WHEREVER NO BEAM IS PROVIDED.
- ALL MASONRY WALL ERECTION SHALL BE DONE AS PER DRAWING No.-XXXX-XX-XXX
- CONSTRUCTION MATERIAL SHALL NOT BE STACKED ON FLOOR SLAB BEYOND LIVE LOAD CAPACITY OF SLAB.
- PRE CAMBER IN SHUTTERING SHALL BE PROVIDED AS MENTIONED IN FRAMING PLAN
- AT BEAM / DROP PANEL - COLUMN / SHEAR WALL JUNCTION CONCRETE GRADE OF COLUMN SHALL BE USED AT OFFSET OF 600 MM ALL AROUND COLUMN / SHEAR WALL FACE.

- ALL CONSTRUCTION JOINTS SHALL BE PLANNED BY SITE TEAM AND SHALL BE SEND TO STRUCTURAL CONSULTANT FOR APPROVAL PRIOR TO EXECUTION. NO CONSTRUCTION JOINTS SHALL BE PROVIDED FOR CANTILEVER PROJECTIONS
- CONTRACTOR TO EVALUATE LOADING FROM UPPER FLOOR (DURING ITS CASTING) AND PROVIDE REQUIRED PROPOS TO LOWER SLAB LEVELS ACCORDINGLY.
- FLOOR SLAB AND BEAM DESIGNED FOR FOLLOWING LOADING:
 - A. LIVE LOAD AS PER IS : 875 (LATEST REVISION)
 - B. FLOOR FINISH THICKNESS - 50MM
 - C. ADDITIONAL LOADING CONSIDERED AS PER SHADED AREA AS MENTIONED IN FRAMING PLAN.
 - D. NO EARTH FILL.
 - E. NO FIRE TENDER LOADING.

GENERAL INSTRUCTION & NOTES:-

- ALL DIMENSIONS SHOWN ARE IN MM. (UNLESS MENTIONED).
- ALWAYS FOLLOW WRITTEN DIMENSIONS ONLY. DO NOT MEASURE ANY DIMENSION.
- THIS DRAWING SHALL BE READ WITH GENERAL NOTES ISSUED IN DRAWING No.-XXXX-XX-XXX
- Fe 550D COMPLIANCE TO IS : 1786 (LATEST REVISION) SHALL BE USED FOR ALL REINFORCEMENT BARS.
- FOR CONCRETE WORK USE CONCRETE GRADE OF M30 COMPLIANCE TO IS : 456 (LATEST REVISION) (UNLESS MENTIONED).
- INDICATES SLAB THICKNESS -
 INDICATES SLAB MARKING FOR R/F. DETAILS
- U/T INDICATES PARTIALLY OR FULLY UPTURN BEAM
- FOR SLAB REINFORCEMENT DETAILS REFER DRAWING No.-5182-22-611A
- FOR BEAM REINFORCEMENT DETAILS REFER DRAWING No.-5182-22-711A/B/C...
- STAIRCASE/RAMPS DETAILS SHALL BE REFERRED FROM RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- ALL LEVEL MENTIONED IN FRAMING PLAN SHALL BE CROSS CHECKED WITH RELEVANT ARCHITECTURAL DRAWINGS.

R3	REVISED AS/MARKED	29.12.2020
R2	REVISED AS/MARKED	25.09.2020
R1	REVISED GENERALLY	09.07.2019
R0	GOOD FOR CONSTRUCTION	30.11.2018
REV. NO.	DESCRIPTION	DATE

PROJECT :-
CORNER WALK (PHASE-2)
AT SECTOR- 74, GURUGRAM

CLIENT :-

Our Expertise. Your Joy. M3M INDIA LTD.

PRINCIPAL ARCHITECT :-

ISO 9001:2008
ACPL Design Ltd
www.acplonline.com
E: contact@acplonline.com F: +91 11 24634089

PHASE-2

DRAWING TITLE	6TH,7TH,8TH,12TH,13,14TH,19TH, 22ND,23RD,24TH,28TH,29TH & 30TH FLOOR LVL. FRAMING PLAN
DRAWING NO. :-	5 1 8 2 2 2 5 1 1 A
SCALE:	AS SHOWN
DATE:	29.12.2020
SHEET NO. :-	01 OF 02
DRAWN BY:	SSB
DESIGNED BY:	RAR
APPROVED BY:	AGU
STATUS :-	GOOD FOR CONSTRUCTION
REVISION NO. :-	R3

STRUCTURAL CONSULTANT :-

C-486, GROUND FLOOR,
C.R. PARK, NEW DELHI - 110019
P:011-40455638/39 E:info@perceptiveideas.org
PERCEPTIVE IDEAS CONSULTING ENGINEERS PVT. LTD.