
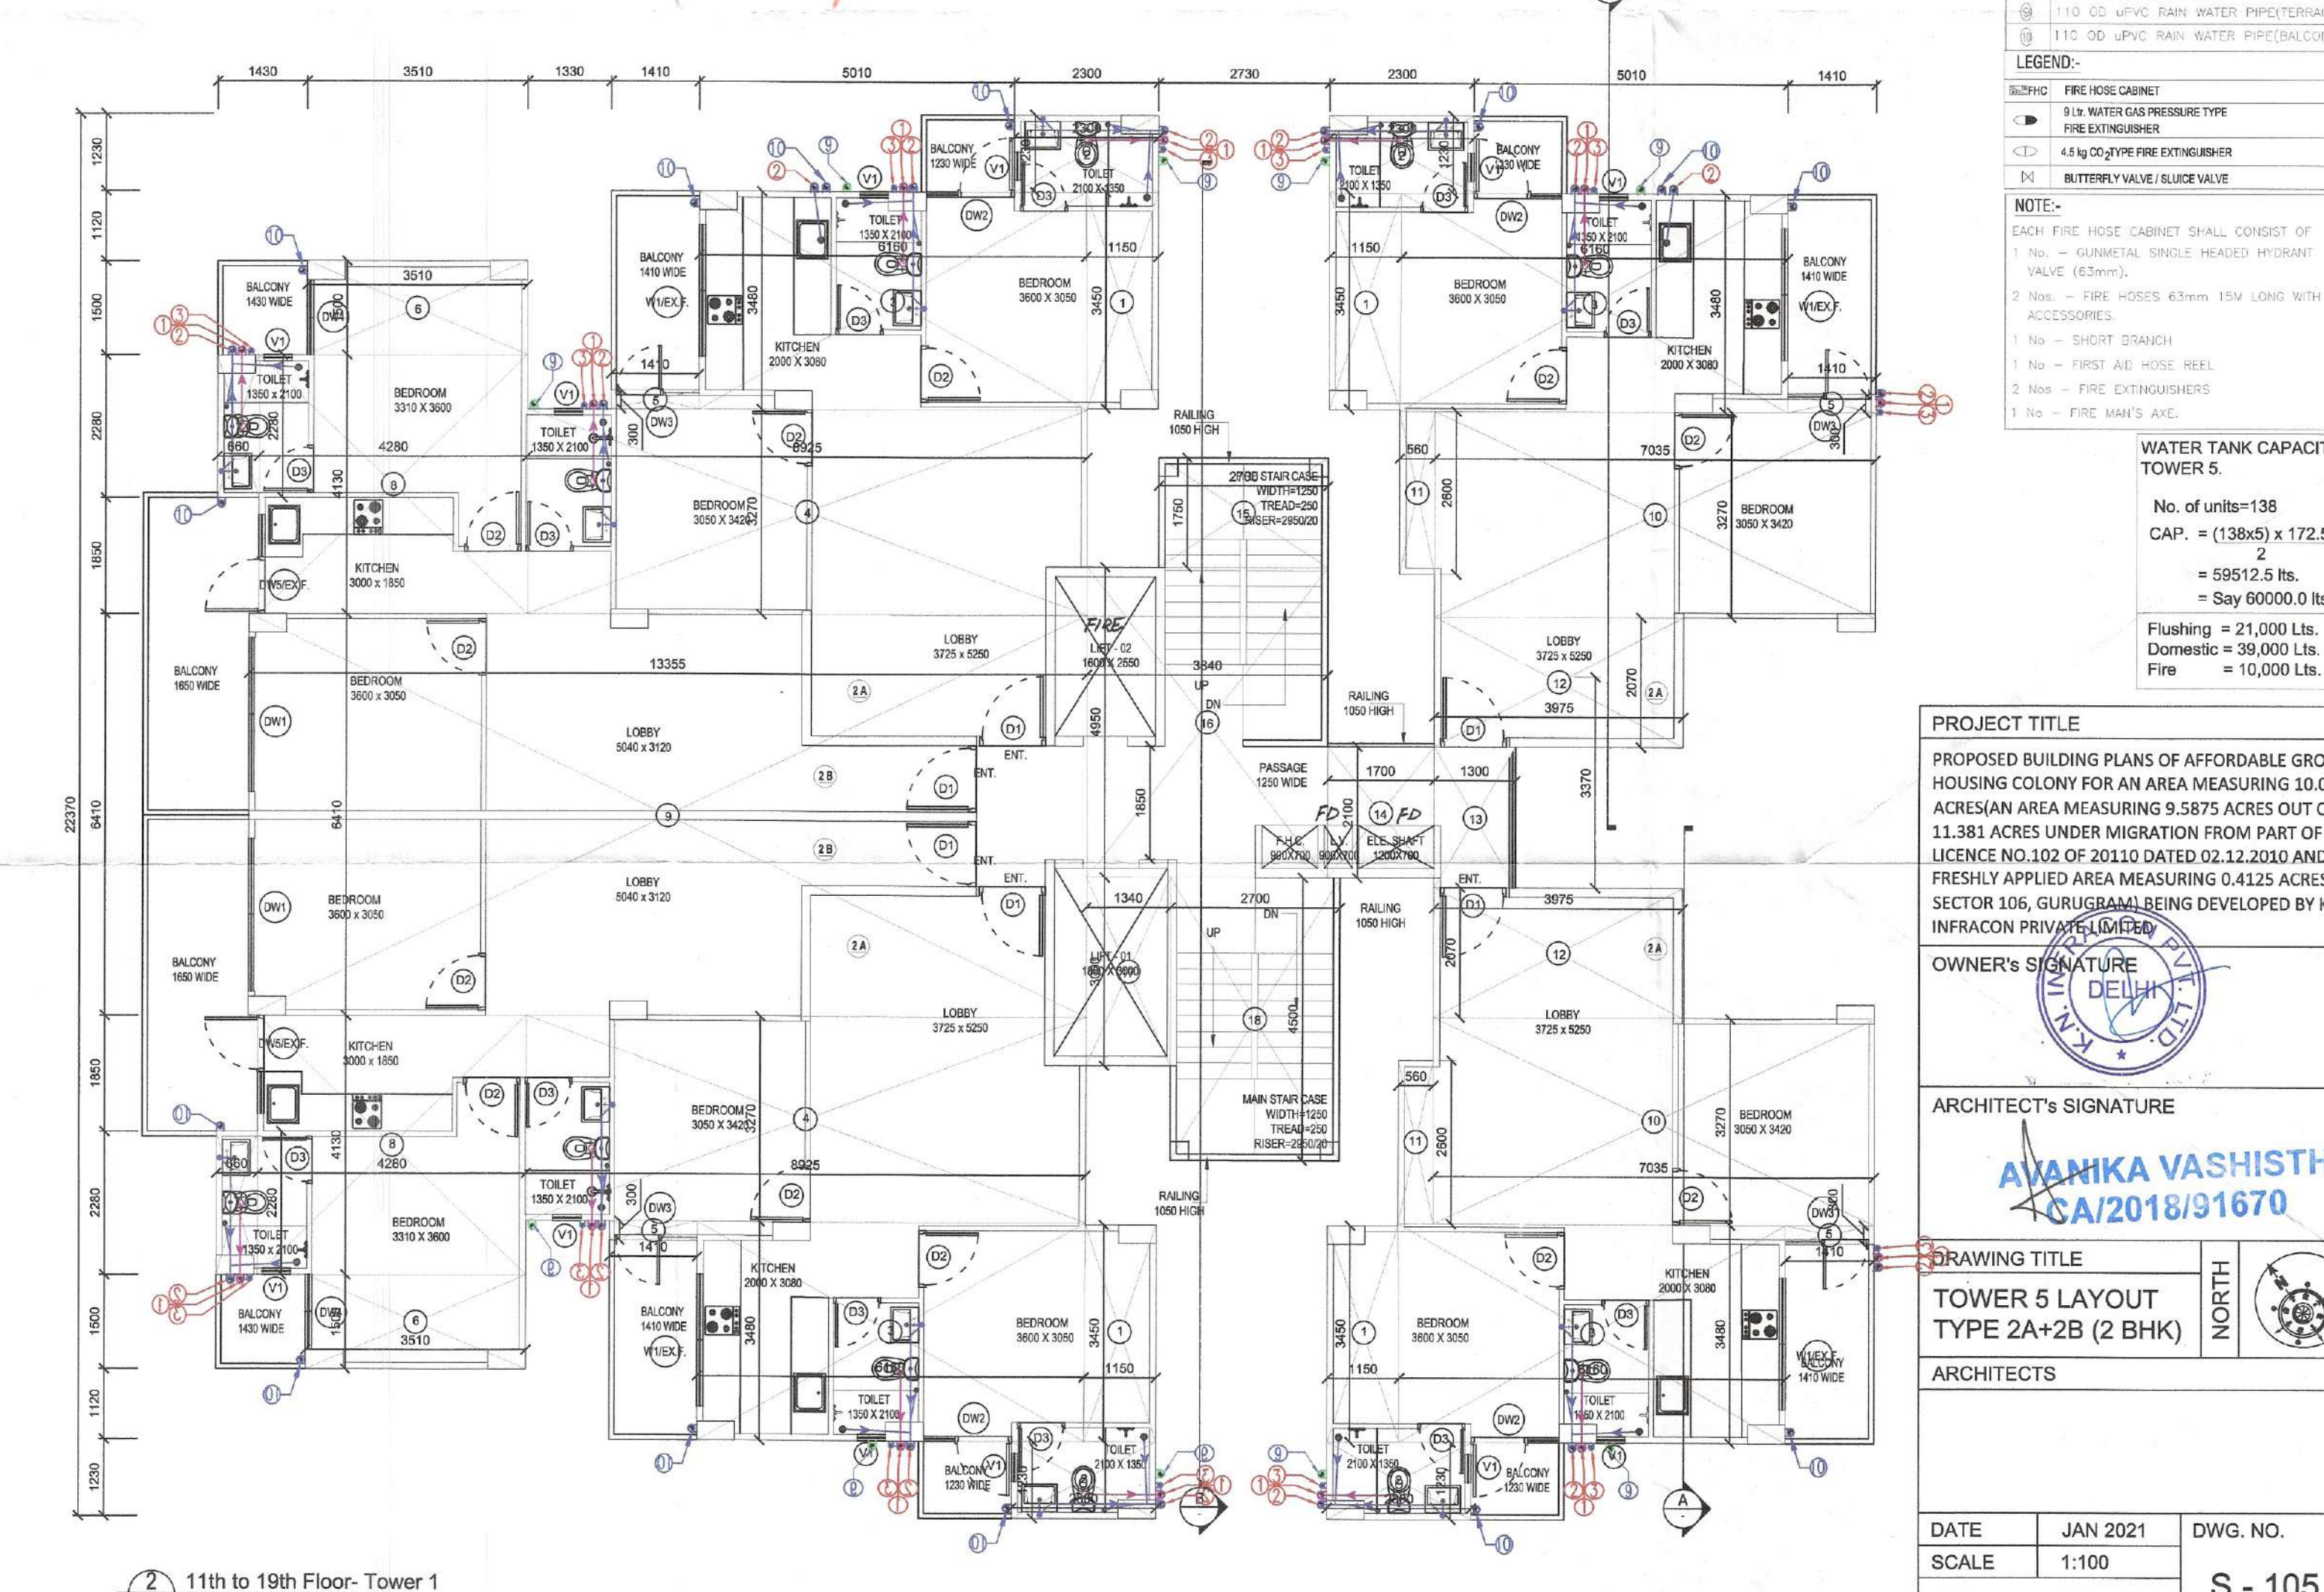
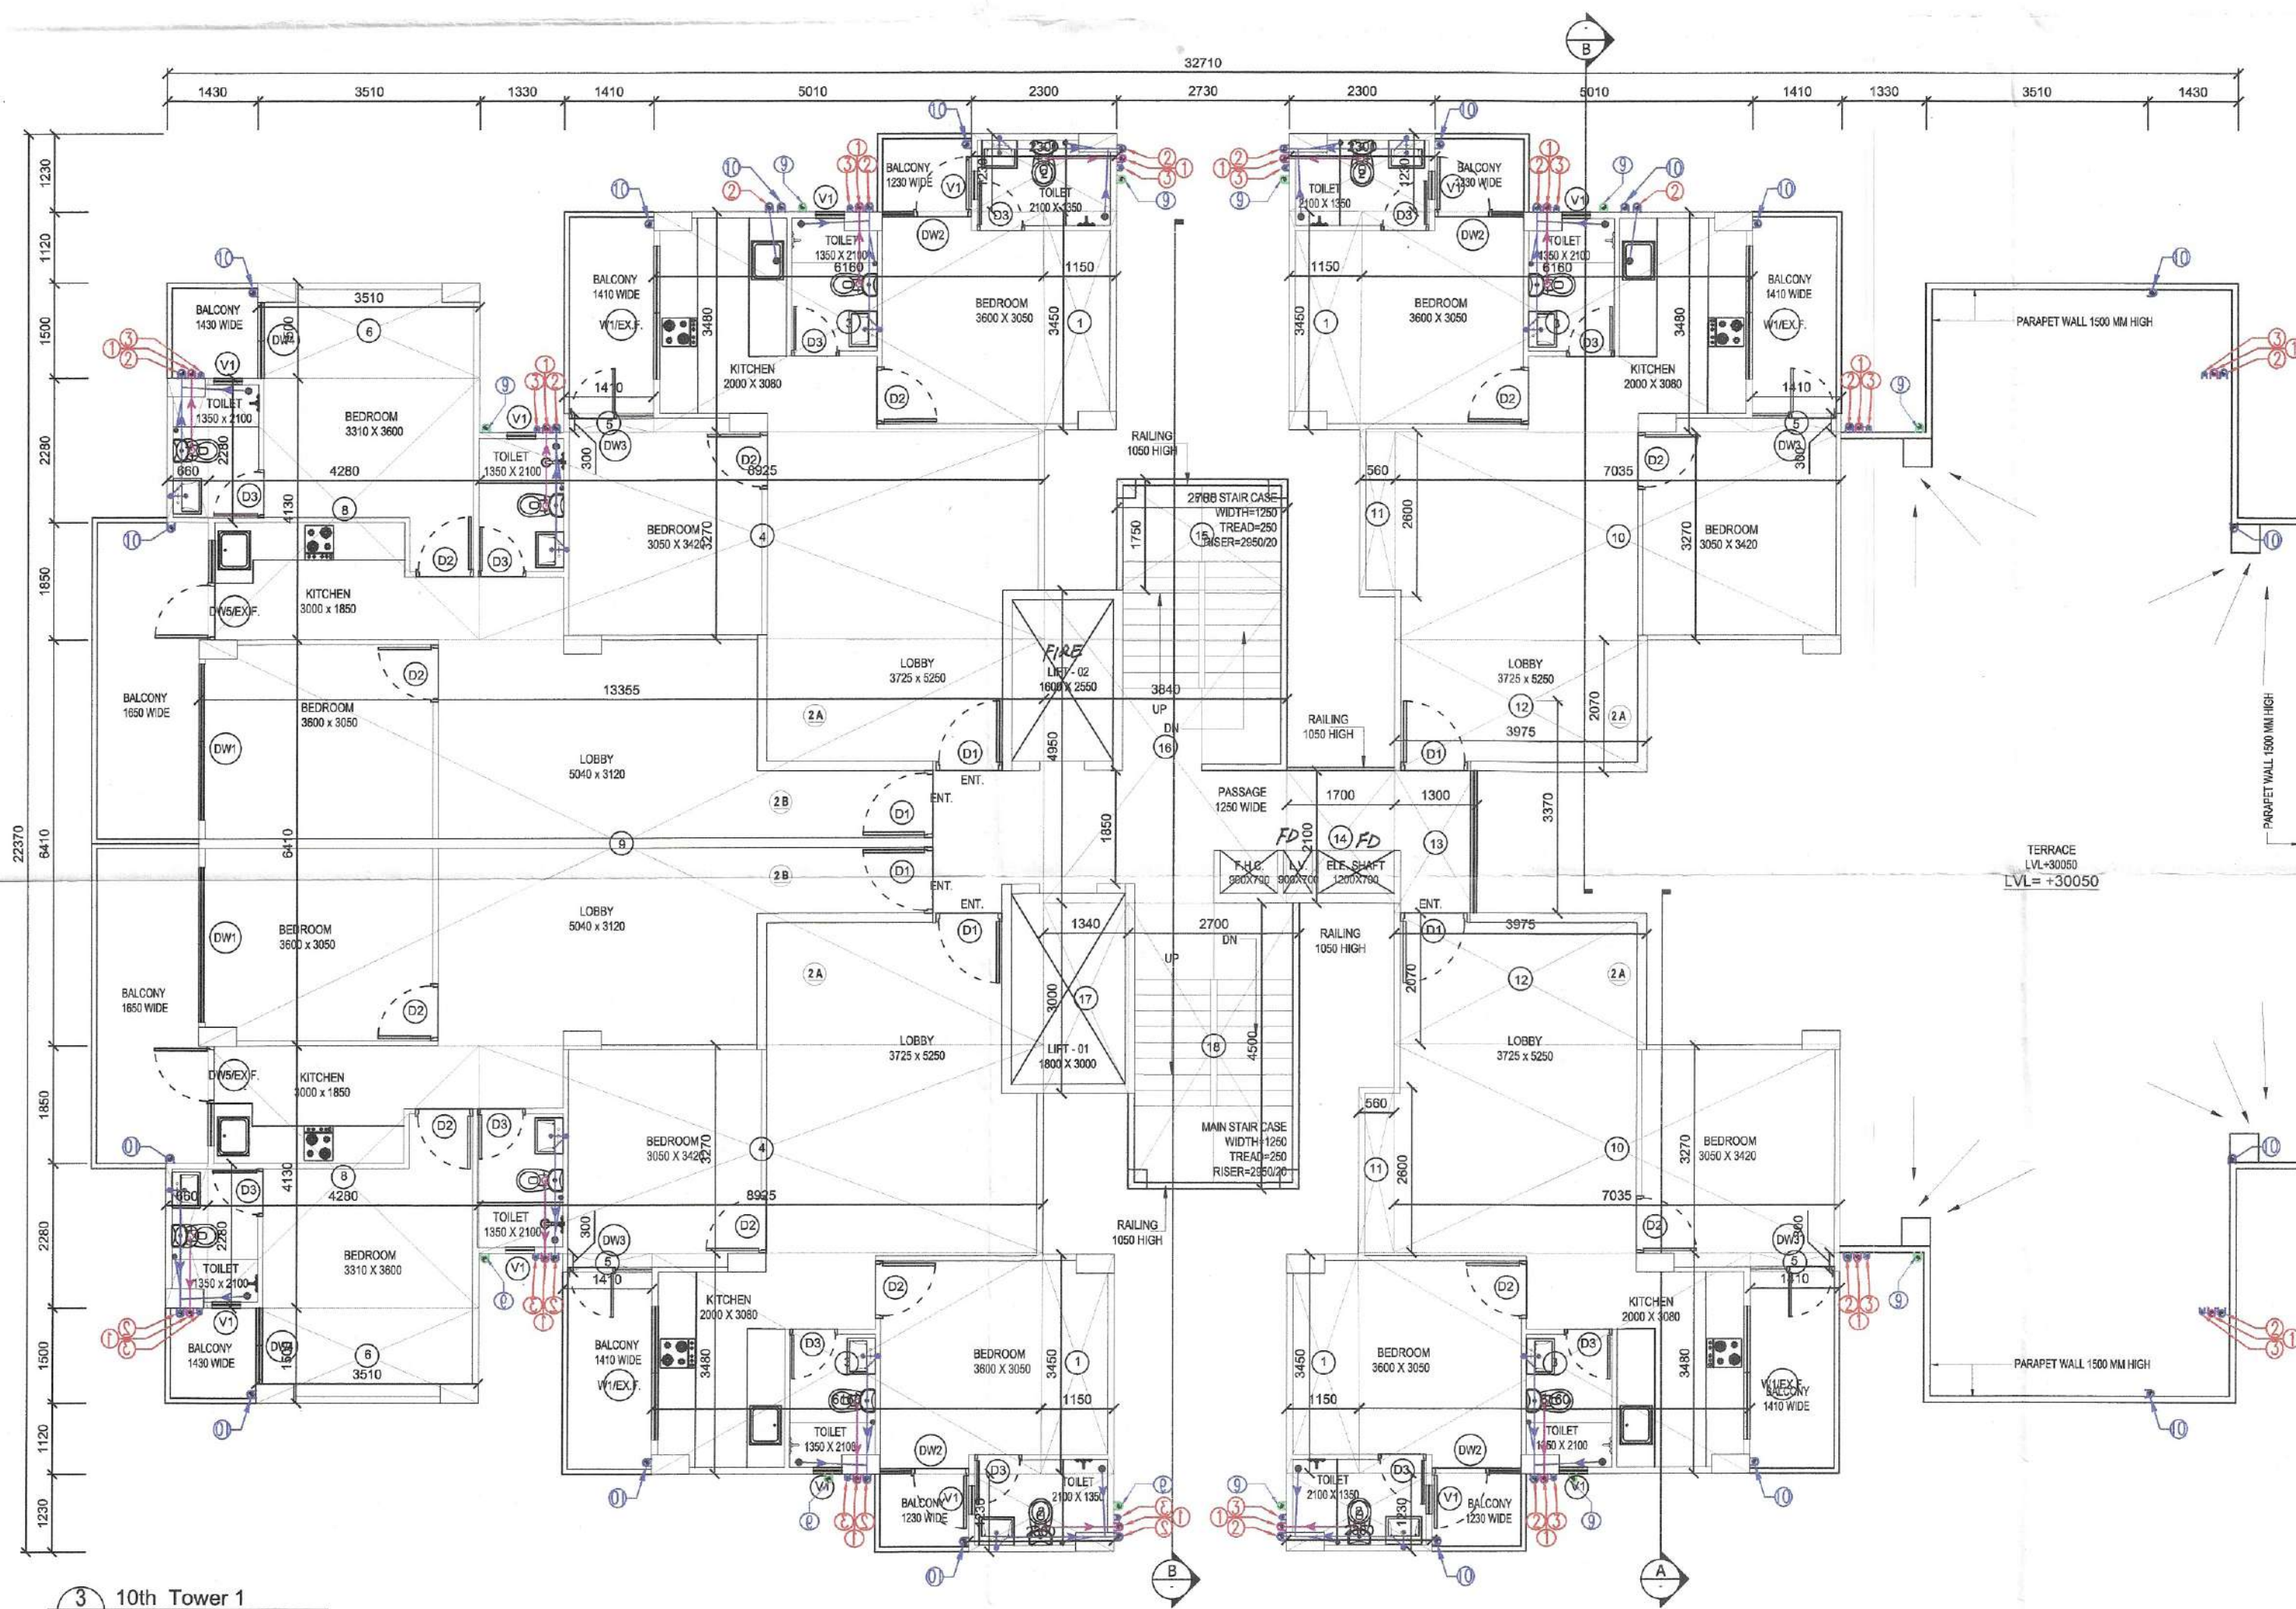
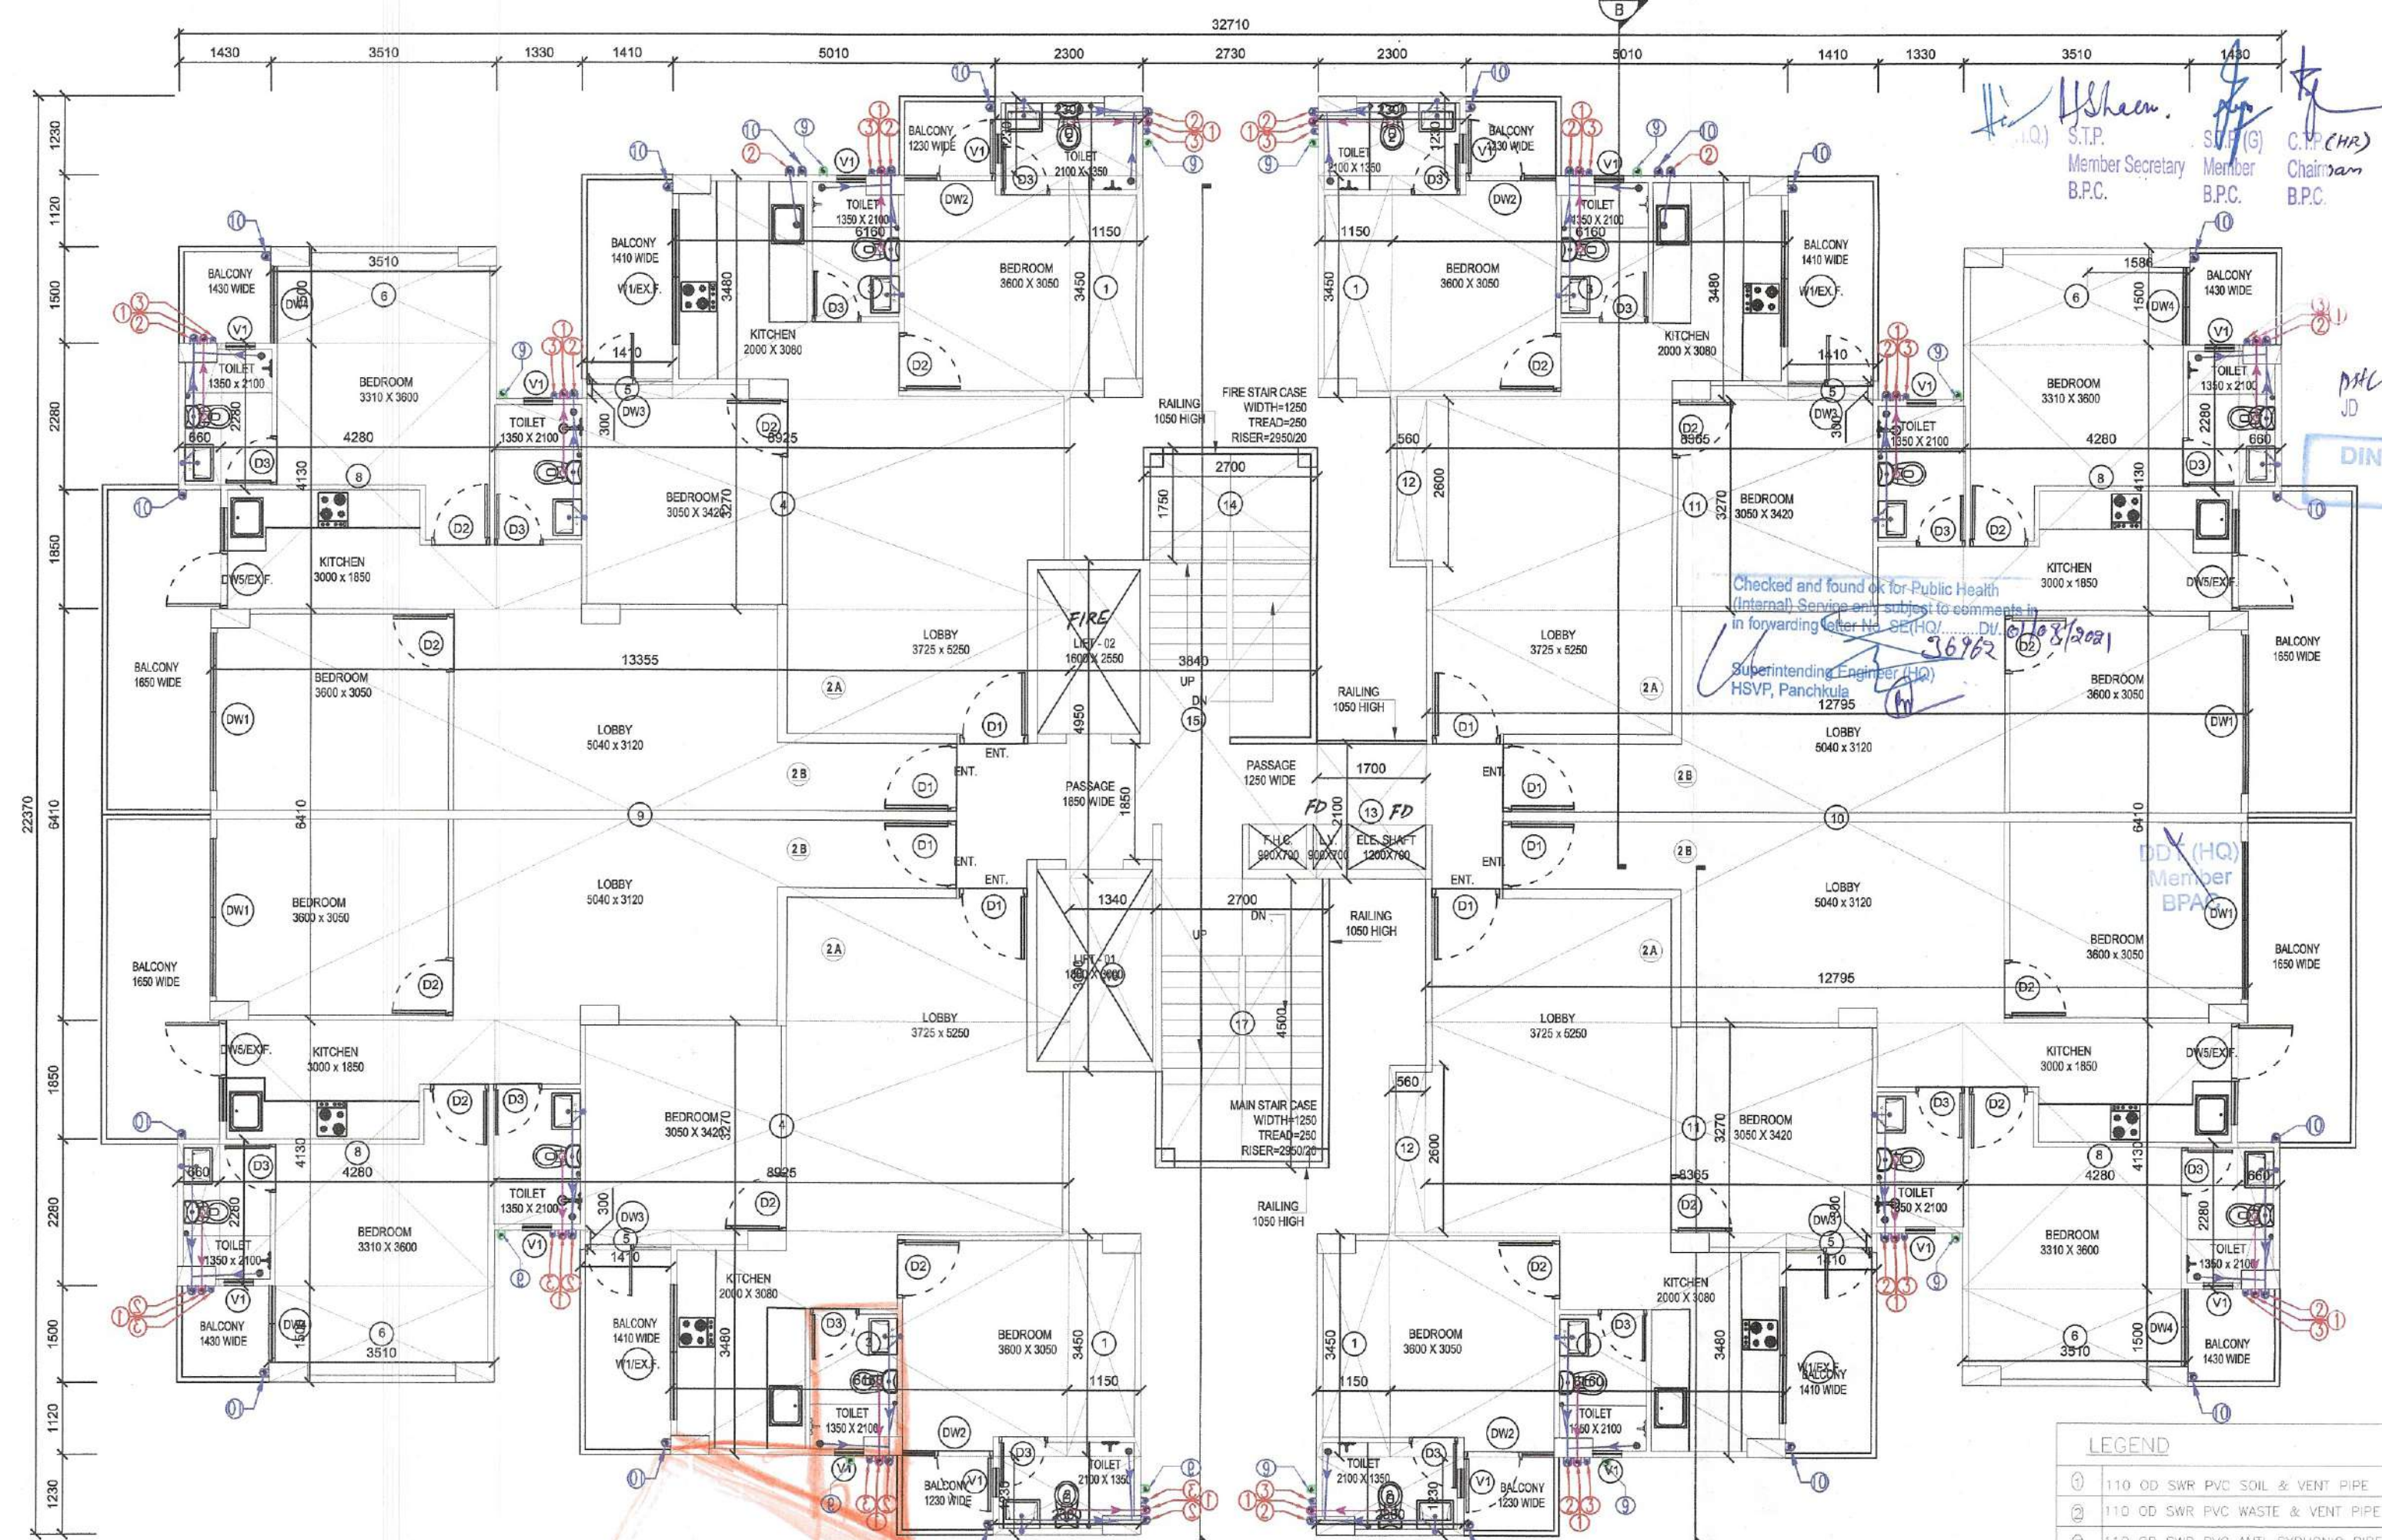


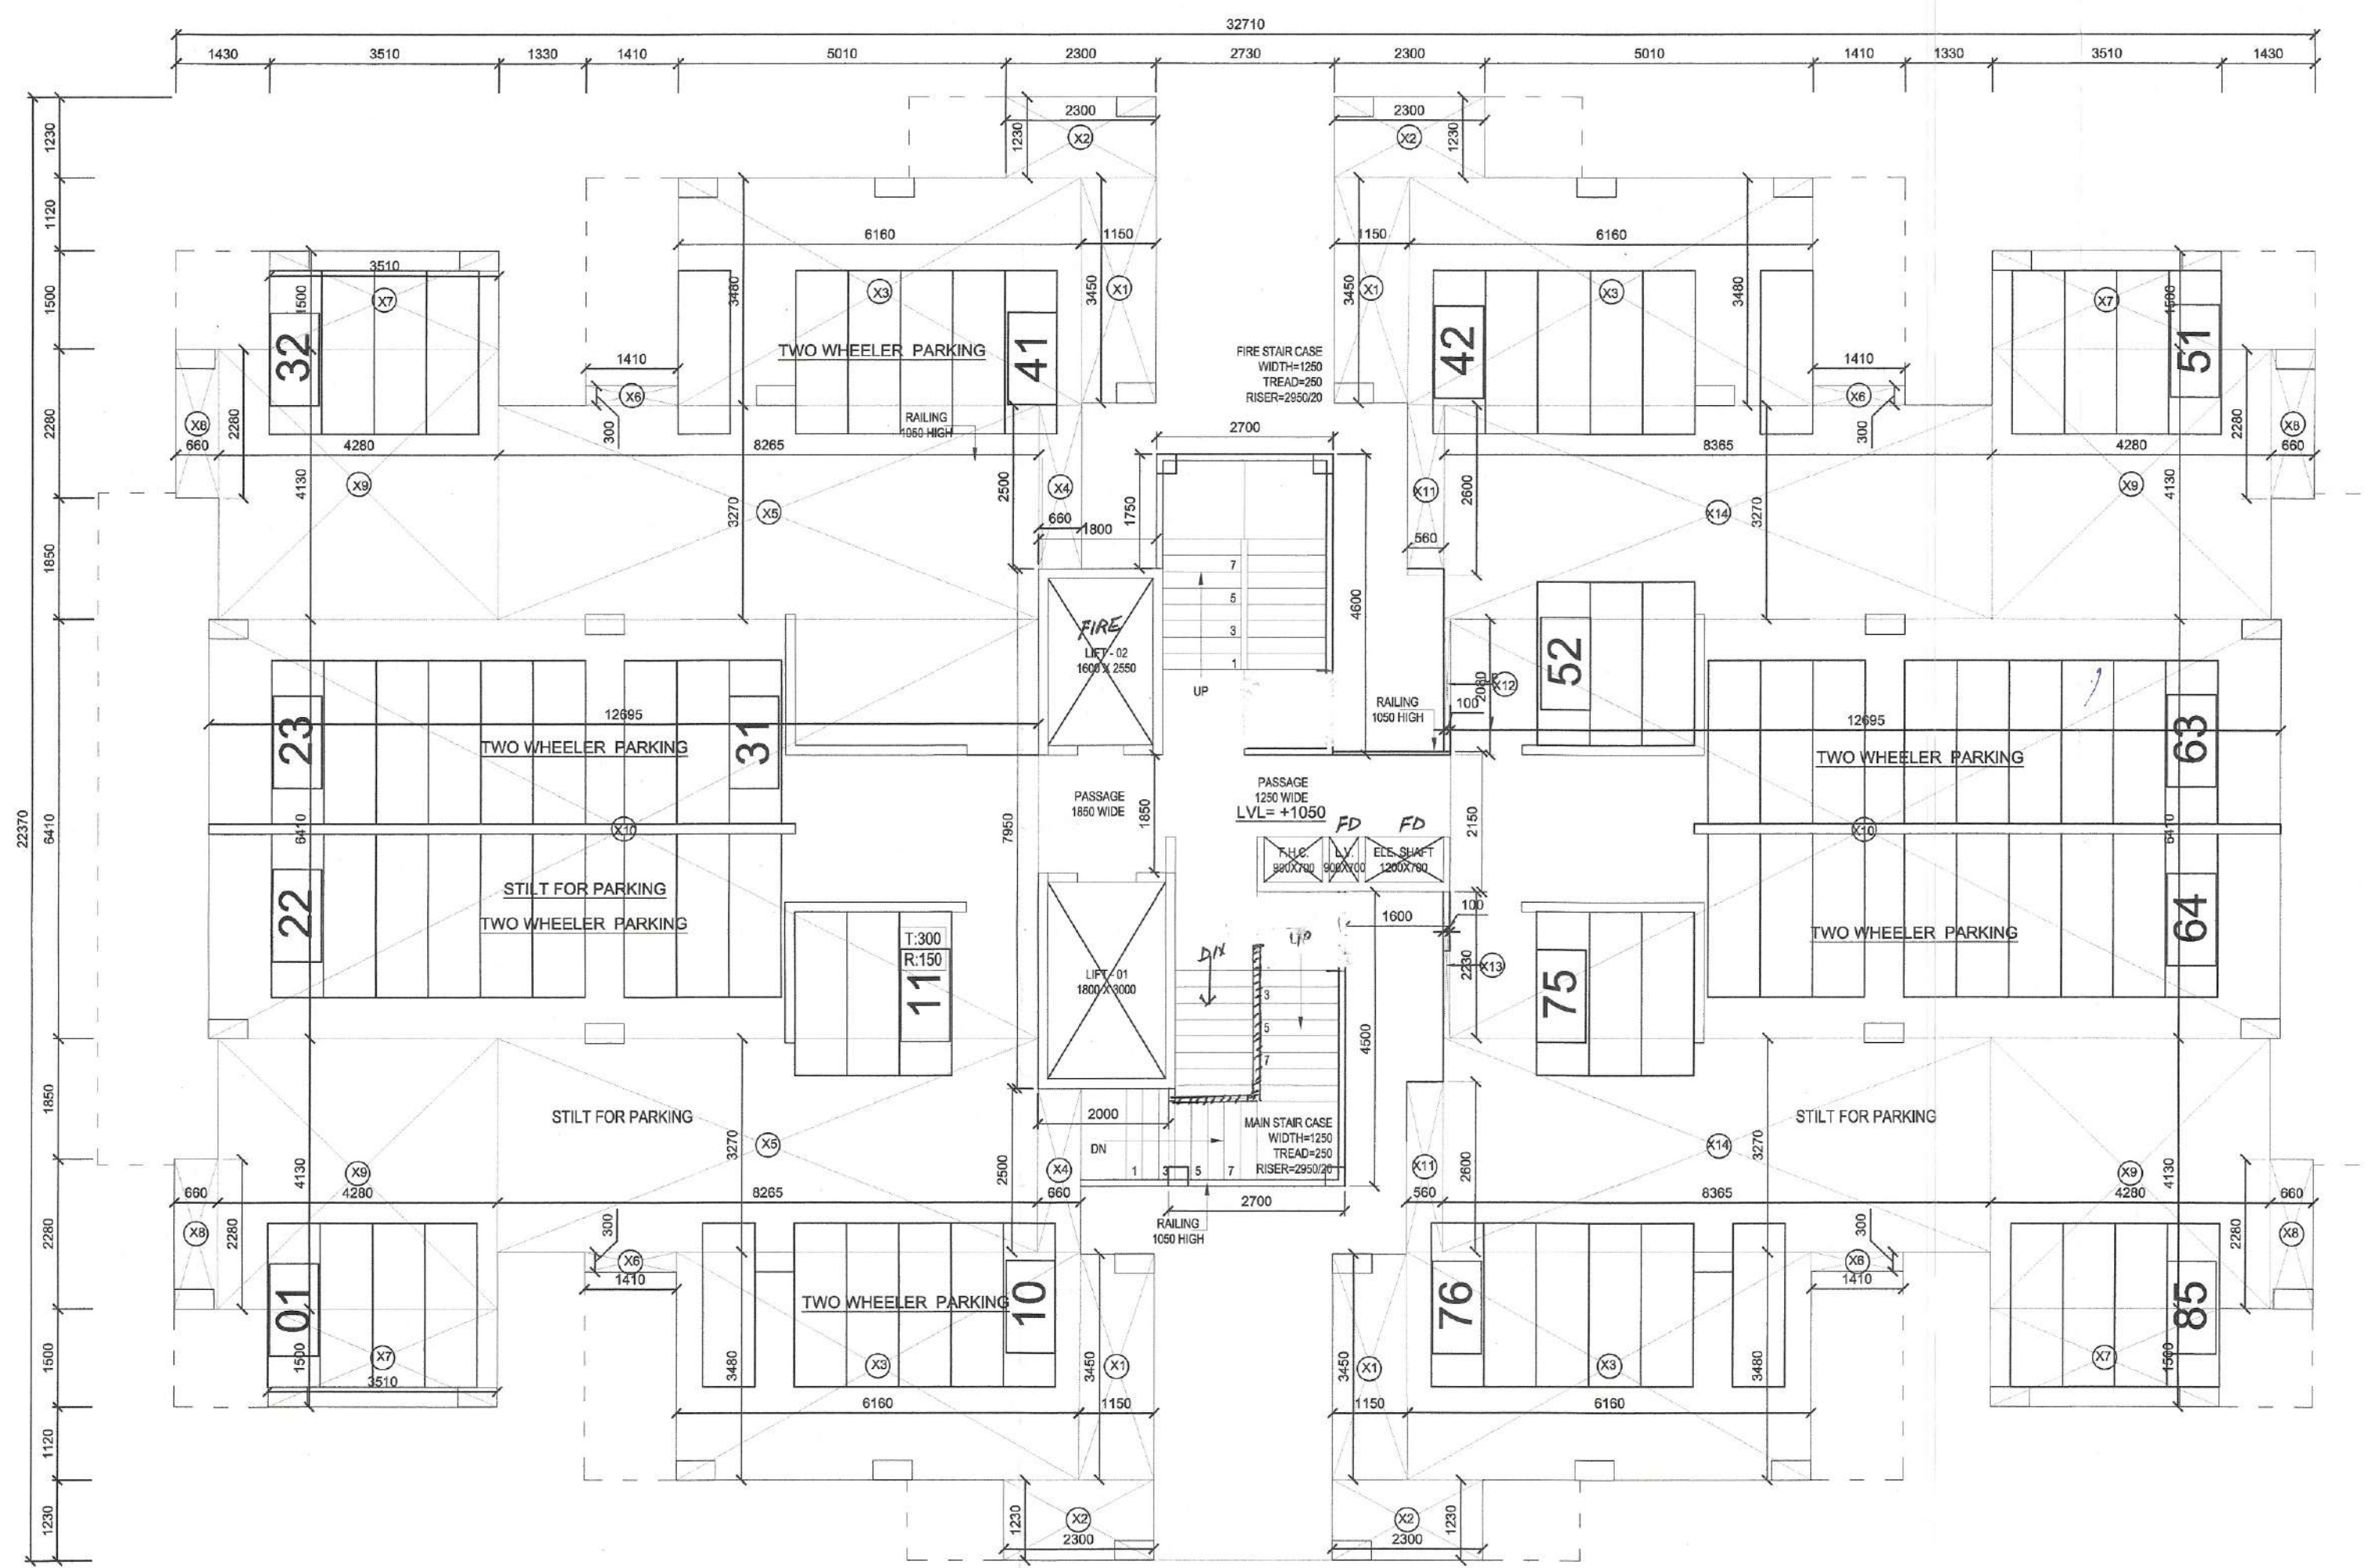

LEGEND

①	110 OD SWR PVC SOIL & VENT PIPE
②	110 OD SWR PVC WASTE & VENT PIPE
③	110 OD SWR PVC ANTI-SIPHONING PIPE
④	50P CWS RISER TO O.H.T. FILLING TANK
⑤	50P FWS RISER TO O.H.T. FILLING TANK
⑥	DOMESTIC WATER SUPPLY DN. TAKE PIPE
⑦	FLUSHING WATER SUPPLY DN. TAKE PIPE
⑧	110 OD W.P.V. RAIN WATER PIPE (PERIMETER)
⑨	110 OD W.P.V. RAIN WATER PIPE (BALCONY)

LEGEND:-

⑩	110 OD W.P.V. RAIN WATER PIPE (BALCONY)
⑪	110 OD W.P.V. RAIN WATER PIPE (BALCONY)
⑫	110 OD W.P.V. RAIN WATER PIPE (BALCONY)
⑬	110 OD W.P.V. RAIN WATER PIPE (BALCONY)
⑭	110 OD W.P.V. RAIN WATER PIPE (BALCONY)

NOTE:-

- Each fire hose cabinet shall consist of:
 - No. - GASKETED SINGLE HEADED INSTEAD VALVE (65mm).
 - No. - FIRE HOSES 65mm 15M LONG WITH ACCESSORIES.
 - No. - SHORT SPOON.
 - No. - FIRST AID KIT.
 - No. - FIRE EXTINGUISHERS.
 - No. - FIRE MAN'S KEY.

WATER TANK CAPACITY TOWER 5

No. of units=138

CAP. = (138x5) x 172.5

= 59612.5 lts.

= Say 60000.0 lts.

Flushing = 21,000 Lts.

Domestic = 39,000 Lts.

Fire = 10,000 Lts.

PROJECT TITLE

PROPOSED BUILDING PLANS OF AFFORDABLE GROUP HOUSING COLONY FOR AN AREA MEASURING 10.0 ACRES/AN AREA MEASURING 9.5875 ACRES OUT OF 11.381 ACRES UNDER MIGRATION FROM PART OF LICENCE NO.102 OF 20110 DATED 02.12.2010 AND FRESHLY APPLIED AREA MEASURING 0.4125 ACRES IN SECTOR 106, GURUGRAM BEING DEVELOPED BY K.N. INFRACON PRIVATE LIMITED.

OWNER'S SIGNATURE

[Signature]

ARCHITECT'S SIGNATURE

[Signature]

DRAWING TITLE

TOWER 5 LAYOUT
TYPE 2A+2B (2 BHK)

ARCHITECTS

AVANIKA VASHISTH
CA/2018/91670

DATE

JAN 2021

SCALE

1:100

DWG. NO.

S - 105