


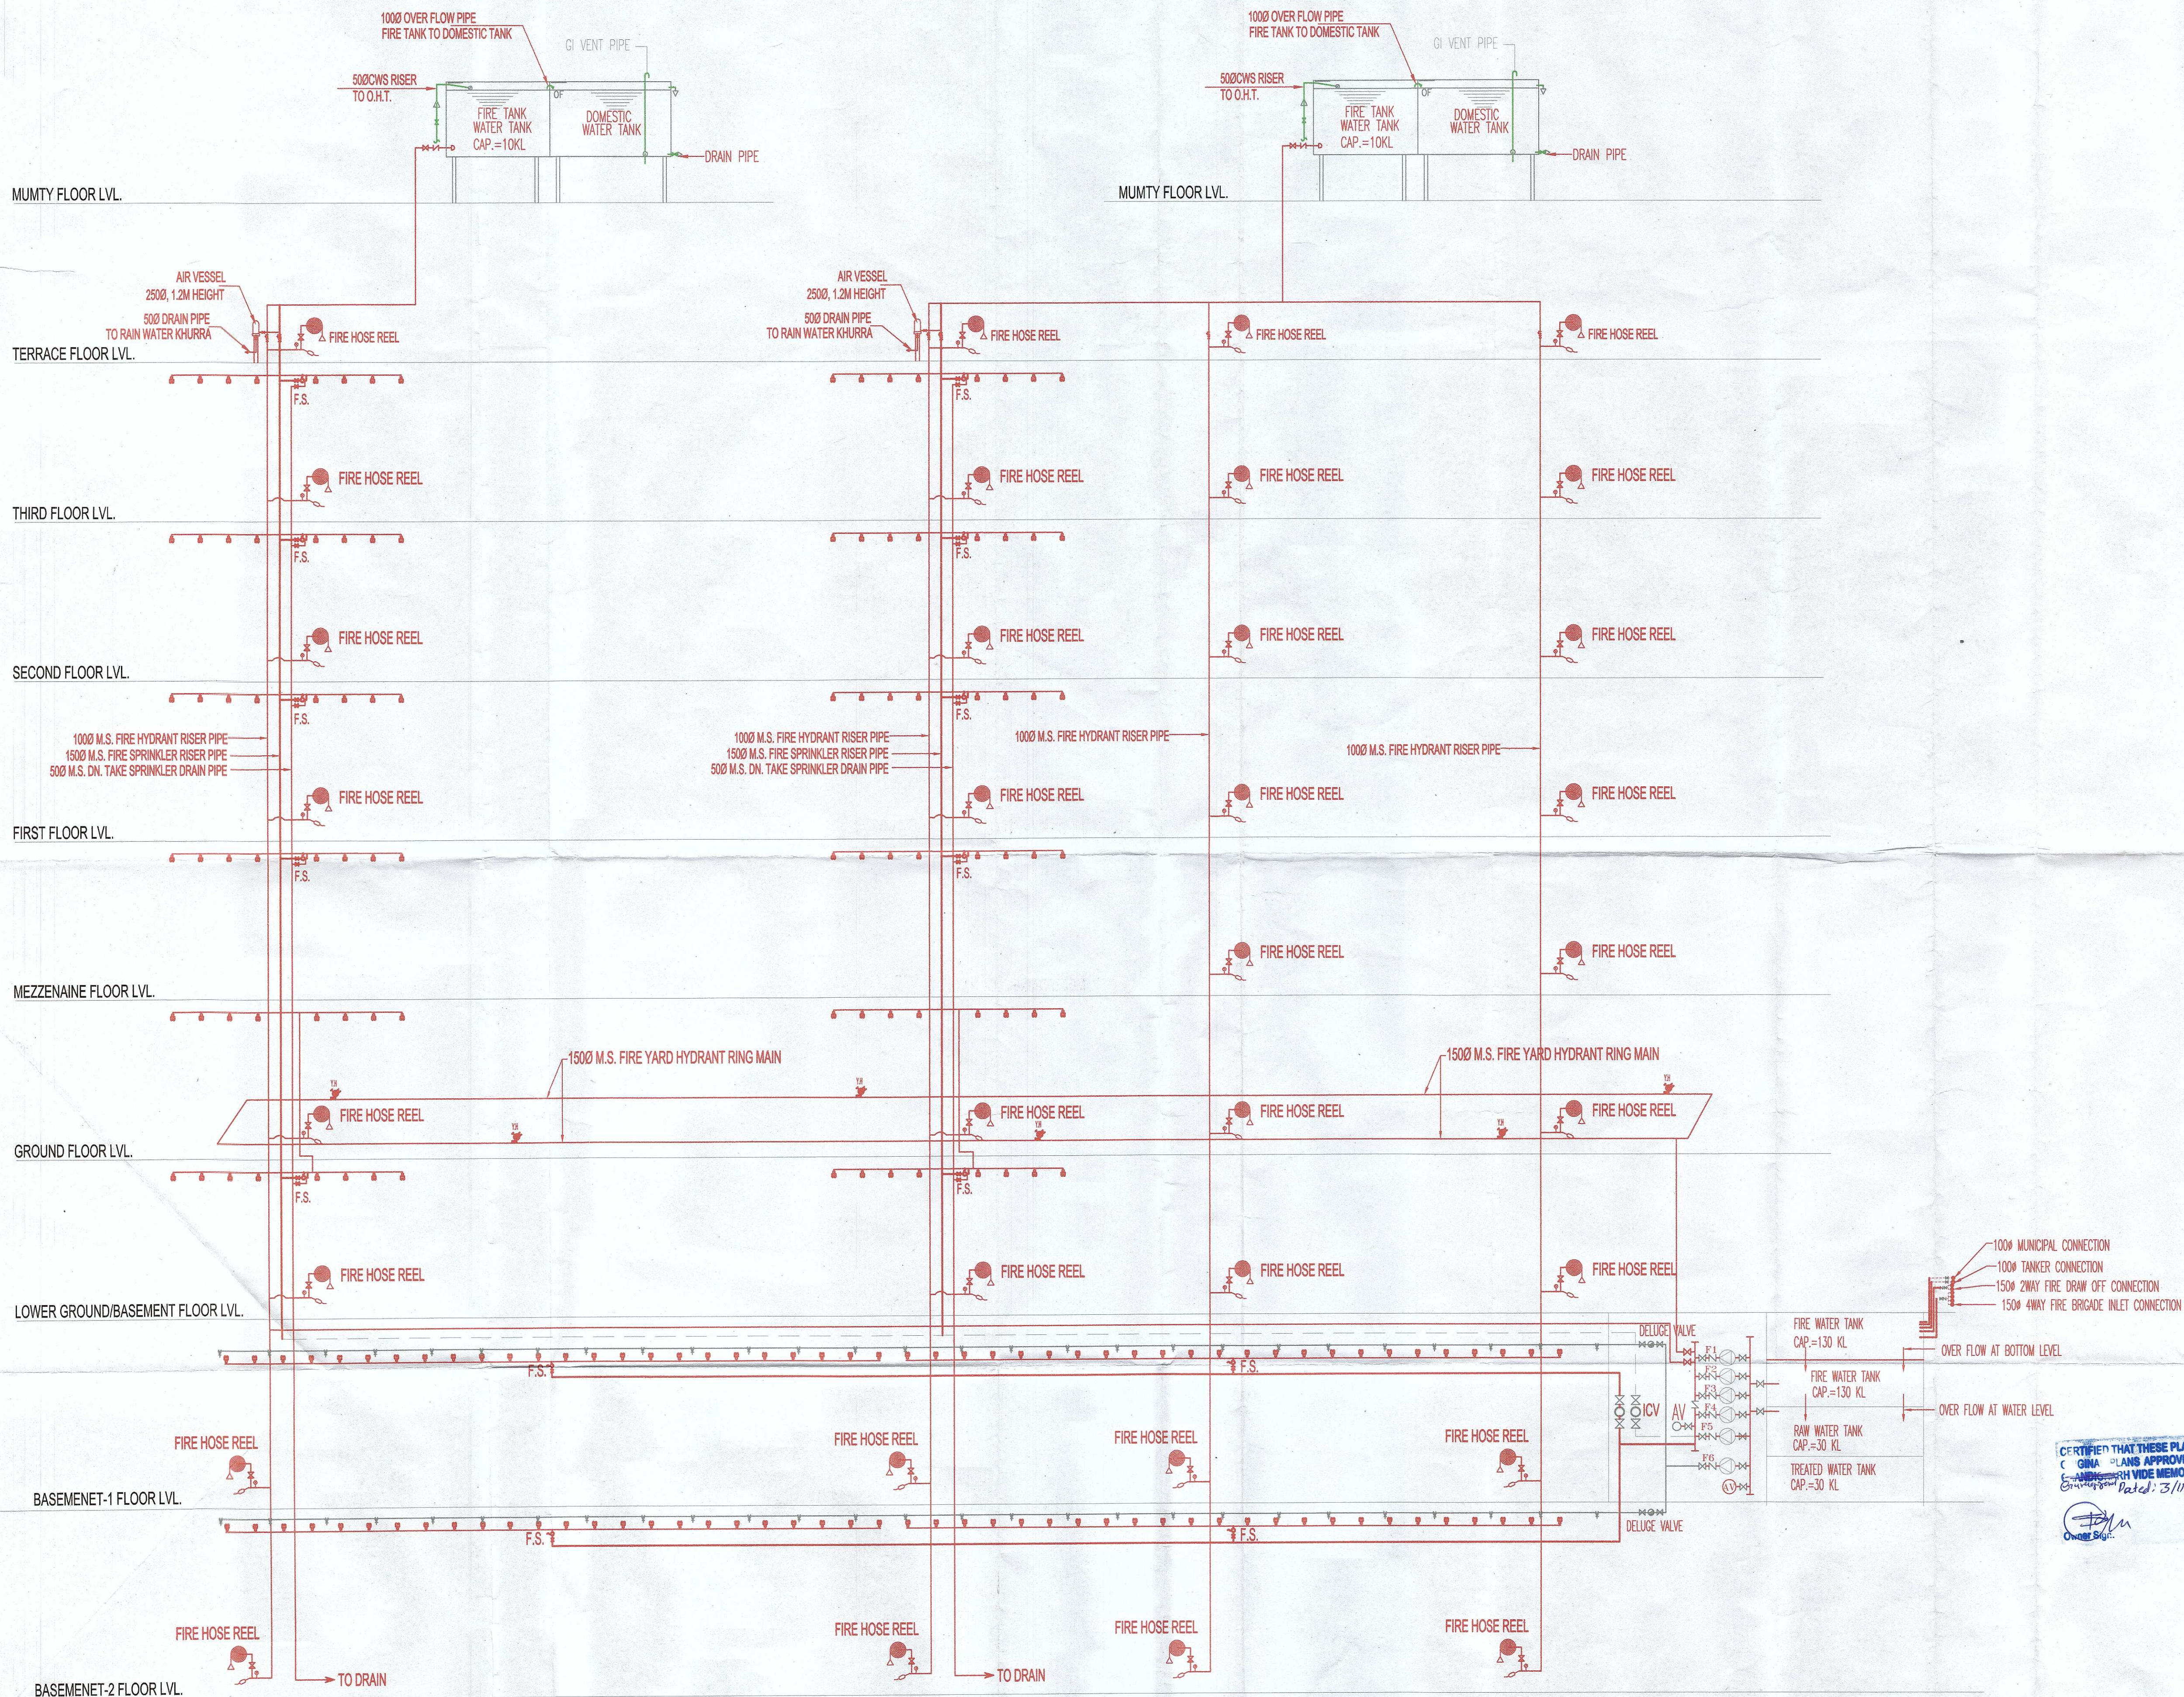

SCHEDULE OF FIRE PUMPS		
SL.NO.	DESCRIPTION	DES.NO.
1	DIESEL ENGINE DRIVEN PUMP 2280 LPM @ 75m HEAD	F1
2	MAIN FIRE HYDRANT PUMP (ELECTRICAL) 2280 LPM @ 75m HEAD	F2
3	JOCKEY PUMP (ELECTRICAL) FOR HYDRANT 180 LPM @ 75m HEAD	F3
4	JOCKEY PUMP (ELECTRICAL) FOR SPRINKLER 180 LPM @ 75m HEAD	F4
5	MAIN FIRE SPRINKLER PUMP (ELECTRICAL) 2280 LPM @ 75m HEAD	F5
6	WATER CURTAIN FIRE PUMP 900 LPM @ 50m HEAD	F6
7	AIR RELEASE VALVE	ARV

LEGEND:-	
	FIRE HOSE CABINET
	UPRIGHT TYPE SPRINKLER
	PENDENT TYPE SPRINKLER
	SIDE WALL SPRINKLER
	9 Ltr. WATER GAS PRESSURE TYPE FIRE EXTINGUISHER
	4.5 kg CO ₂ TYPE FIRE EXTINGUISHER
	BUTTER FLY VALVE
	FLOW INDICATING SWITCH

NOTE:-
EACH FIRE HOSE CABINET SHALL CONSIST OF
1 No. - GUNMETAL SINGLE HEADED HYDRANT
2 Nos. - FIRE HOSES 63mm 15M LONG WITH ACCESSORIES.
1 No. - SHORT BRANCH
1 No. - FIRST AID HOSE REEL
2 Nos. - FIRE EXTINGUISHERS
1 No. - FIRE MAN'S AXE.

V Consulting
Fire Consultant
(Fire Fighting, Electrical & Ventilation)
B-50, Basement
Somi Nager, New Delhi

CERTIFIED THAT THESE PLANS ARE AS PER
C.G.M.A. PLANS APPROVED BY DD-108, STP
CHANDIGARH VIDE MEMO No. 5377
Dated: 3/11/21

Owner's Sign:
Architect's Sign:

GIAN P. MATHUR
Architect
B. Arch., M.A. I.I.A.
CA No. 3769
ARCHITECT'S SIGN

OWNER'S SIGN
PROJECT:-
APPROVAL OF BUILDING PLAN OF COMMERCIAL SITE
ADMEASURING 1.425 ACRES IN BLOCK-H FALLING IN THE
RESIDENTIAL PLOTTED COLONY OF AREA MEASURING 199.063
ACRES (Licence no 102 TO 114 of 2004 Dated 27.07.2004) IN
SECTOR - 57, GURUGRAM MANESAR URBAN COMPLEX BEING
DEVELOPED BY, M/s. PARYAPT INFRASTRUCTURE PVT. LTD.