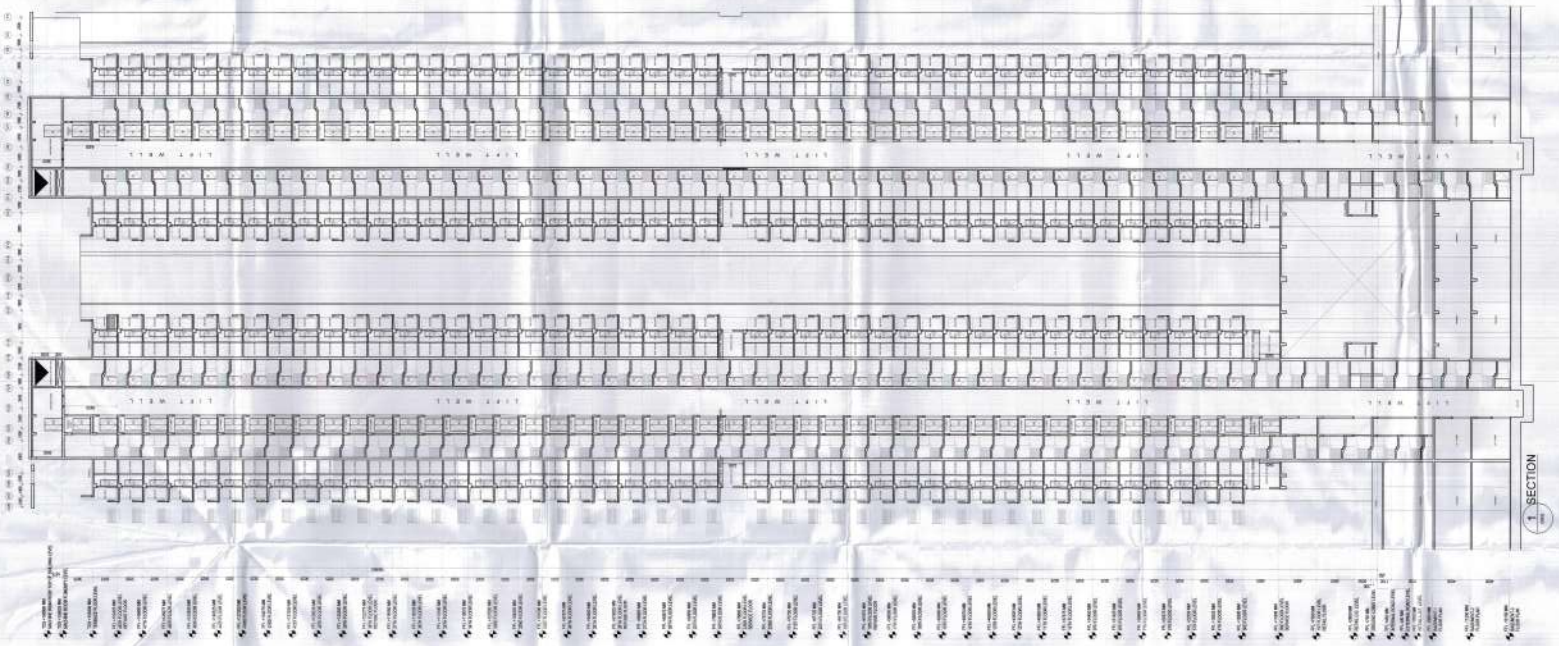

NOTES:

- ALL LIFTS SHALL HAVE SEMI POWER BACK UP
- ALL ELECTRICAL WIRING SHALL BE AS PER PROVISION OF NBC
- FIRE FIGHTING / SAFETY PROVISIONS WILL BE AS PER REQUIRED NBC REQUIREMENT
- ALL DOORS SHALL BE OF FIRE RESISTANT TYPE AS PER NBC REQUIREMENT
- ALL TOILETS ARE VENTILATED AS PER NBC AND NOT BEING LEAK TIGHT
- BUILDING WILL BE AUTOMATIC SPRINKLER SYSTEM WHEREVER REQUIRED BY NBC
- BUILDING WILL BE PROVIDED WITH LIFTS AND AN AUTOMATIC LIFT CARRIER FOR EMERGENCY USE (STRETCHER)
- ALL HIGH RISE BUILDING ARE INTERCONNECTED THROUGH CORRIDOR / BRIDGES
- SOLAR PANELS OF REQUIRED CAPACITY SHALL BE PROVIDED ON ROOF TOP AS PER MEDICAL DOCUMENTATION
- ALL DOORS, WINDOWS, PARTITIONS AND MASONRY WORK IN WETTING OF THE ROOMS IN RESIDENTIAL APARTMENTS EXCLUDED IN U.K. AND WETTER APPROPRIATE IS OPTIONAL ON INTERNAL SIDE OF THE WALL ONLY.
- ALL HANDICAP FACILITIES REQUIRED.

KEY PLAN

ORIENTATION

PRINCIPAL ARCHITECT

ISO 9001:2008

ACPL

ACPL Design Ltd

Architecture Management Planning

PROJECT:

REVISED BUILDING PLANS OF MIXED LAND USE COLONY (70% RESIDENTIAL + 30% COMMERCIAL) MEASURING 14.41125 ACRES (LICENCE NO. 15 OF 2017 DATED-02.05.2017) UNDER TOD POLICY DATED 08.02.2016 IN SECTOR-85, GURUGRAM BEING DEVELOPED BY MANGLAM MULTIPLEX PVT. LTD.

OWNER/AUTH. SIGNATURE | ARCHITECTS SIGNATURE

DRAWING TITLE:

SECTION - 1
(TOWER - 4 & 5)

DRAWING NO. A-43 | SCALE - 1:200

"IT IS A TRADITIONAL BUILDING PLAN" is meaning for the purpose of making enquiries from the general public

AT (HQ)

TO BE KEPT WITH THE OFFICE
BD NO. 34-JCD
DATED: 6/09/2018

Area Officer Estate
(HQ)