

1. BUILDING HAS AUTOMATIC SPRINKLER SYSTEM WHEREVER REQUIRED BY NBC.
2. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVANT IS CODES FOR EARTHQUAKE RESISTANCE.

| Door tag | Typology   | Fire Rating | Fire Weib | Masonry Height | Masonry Cill Height | Masonry Max. Unit Height |
|----------|------------|-------------|-----------|----------------|---------------------|--------------------------|
| D1       |            | NA          | 3200      | 2400           |                     | 2400                     |
| D2       | Flush      | NA          | 800       | 2300           | 100                 | 2400                     |
| D3       |            | NA          | 1600      | 2400           |                     | 2400                     |
| D4       |            | NA          | 25150     | 2400           |                     | 2400                     |
| F01      |            | 2           | 25150     | 2400           |                     | 2400                     |
|          |            | 2           | 25150     | 2400           |                     | 2400                     |
|          |            | 2           | 25150     | 2400           |                     | 2400                     |
|          |            | 2           | 2600      | 2400           |                     | 2400                     |
|          | Metal door | 2           | 2600      | 2400           |                     | 2400                     |
| F02      |            | 2           | 12100     | 2400           |                     | 2400                     |
| F03      |            | 2           | 12100     | 2400           |                     | 2400                     |
| F04      |            | 2           | 12100     | 2400           |                     | 2400                     |
| F05      |            | 2           | 13500     | 2300           | 100                 | 2400                     |
| F06      |            | 2           | 13500     | 2300           | 100                 | 2400                     |
| G01      | Glass      | NA          | 1200      | 2400           |                     | 2400                     |
| G02      | door       | 2           | 2000      | 2400           |                     | 2400                     |

PROPOSED COMMERCIAL COLONY AREA  
MEASURING 6.525 ACRES (LICENSE NO. 79 OF 2012  
DATED 17/08/2012 & LICENSE NO. 11 OF 2013 DATED  
12/03/2013) IN SECTOR 106, GURGRAM BEING  
DEVELOPED BY ELAN AVENUE LTD.(FORMELY  
KNOWN AS AIRMID DEVELOPERS LTD.)

[illegible]

For Elan Avenue Ltd.


ARCHITECT'S SEAL

Scale : 1:150.

[illegible]

1ST FLOOR

T-03

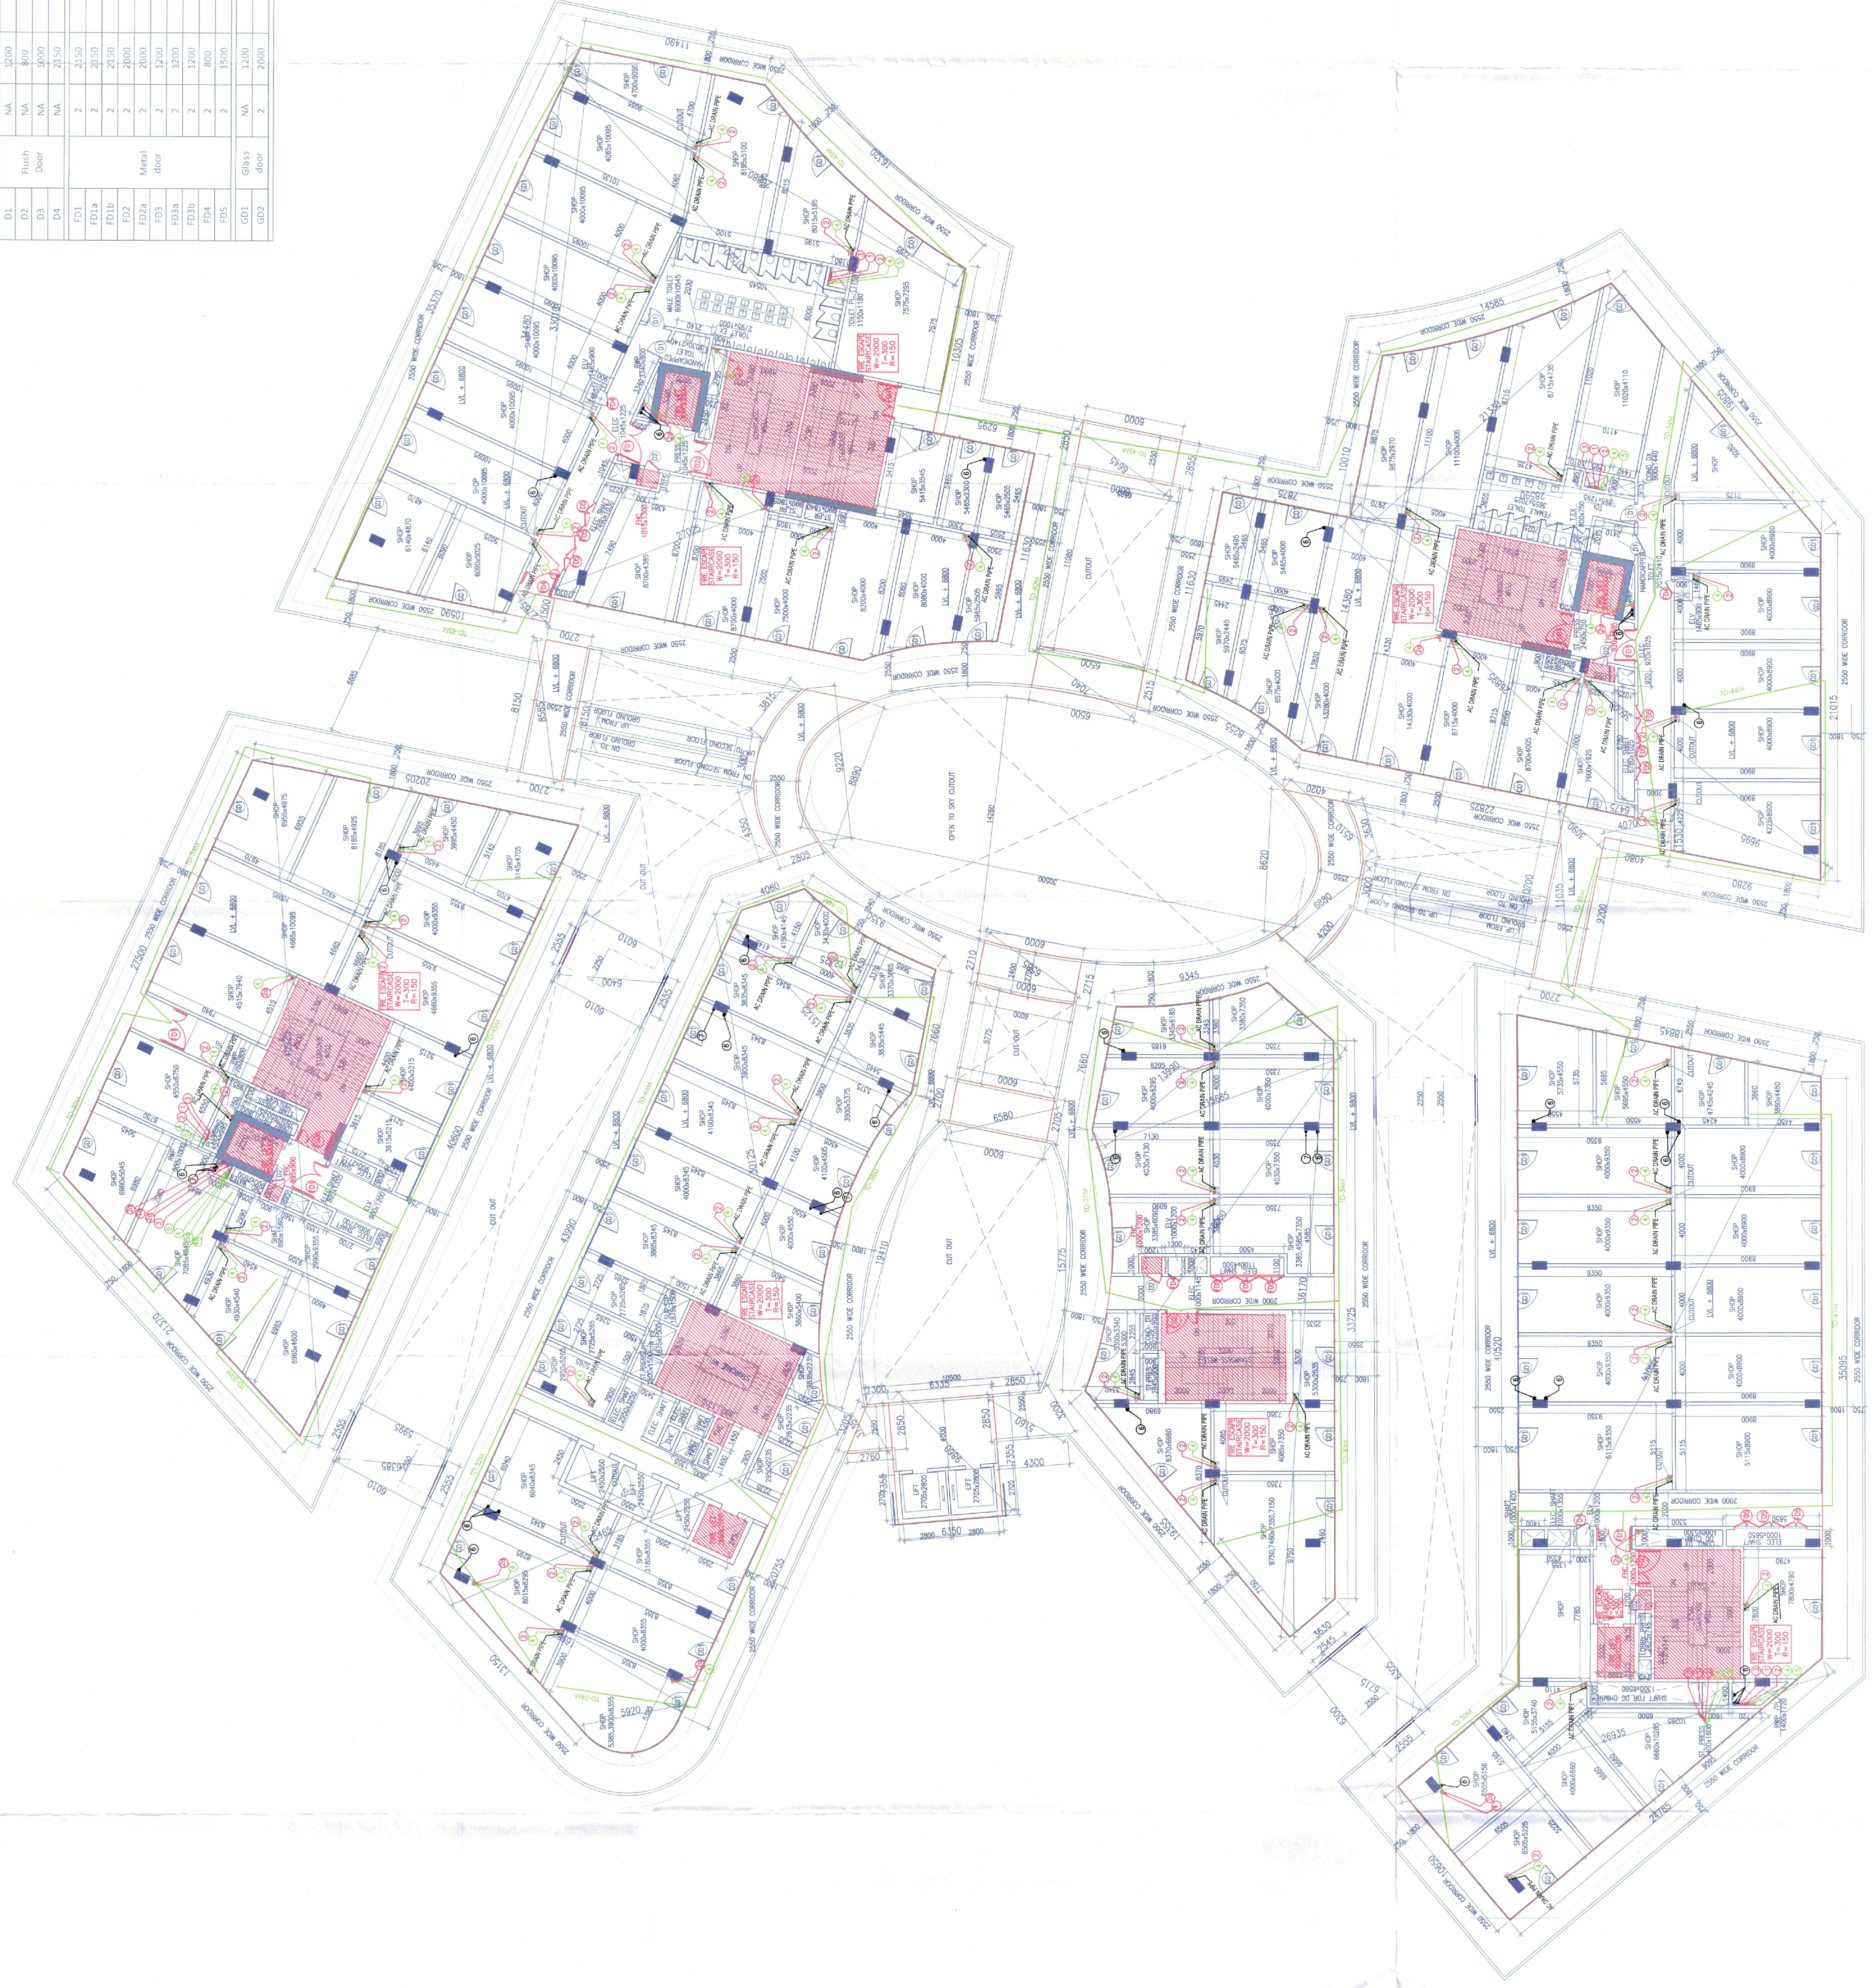

FIRST FLOOR PLAN

LVL + 6800

REQUIRED STAIRCASE WIDTH 1ST FLOOR CALCULATION:-  
 Retail area (4588 sqm @ 1 person / 6 sqm) = 764.67  
 Required staircase width for Retail @ 10mm/person for  
 Proposed staircase width for Retail = 14000MM.

[illegible]