

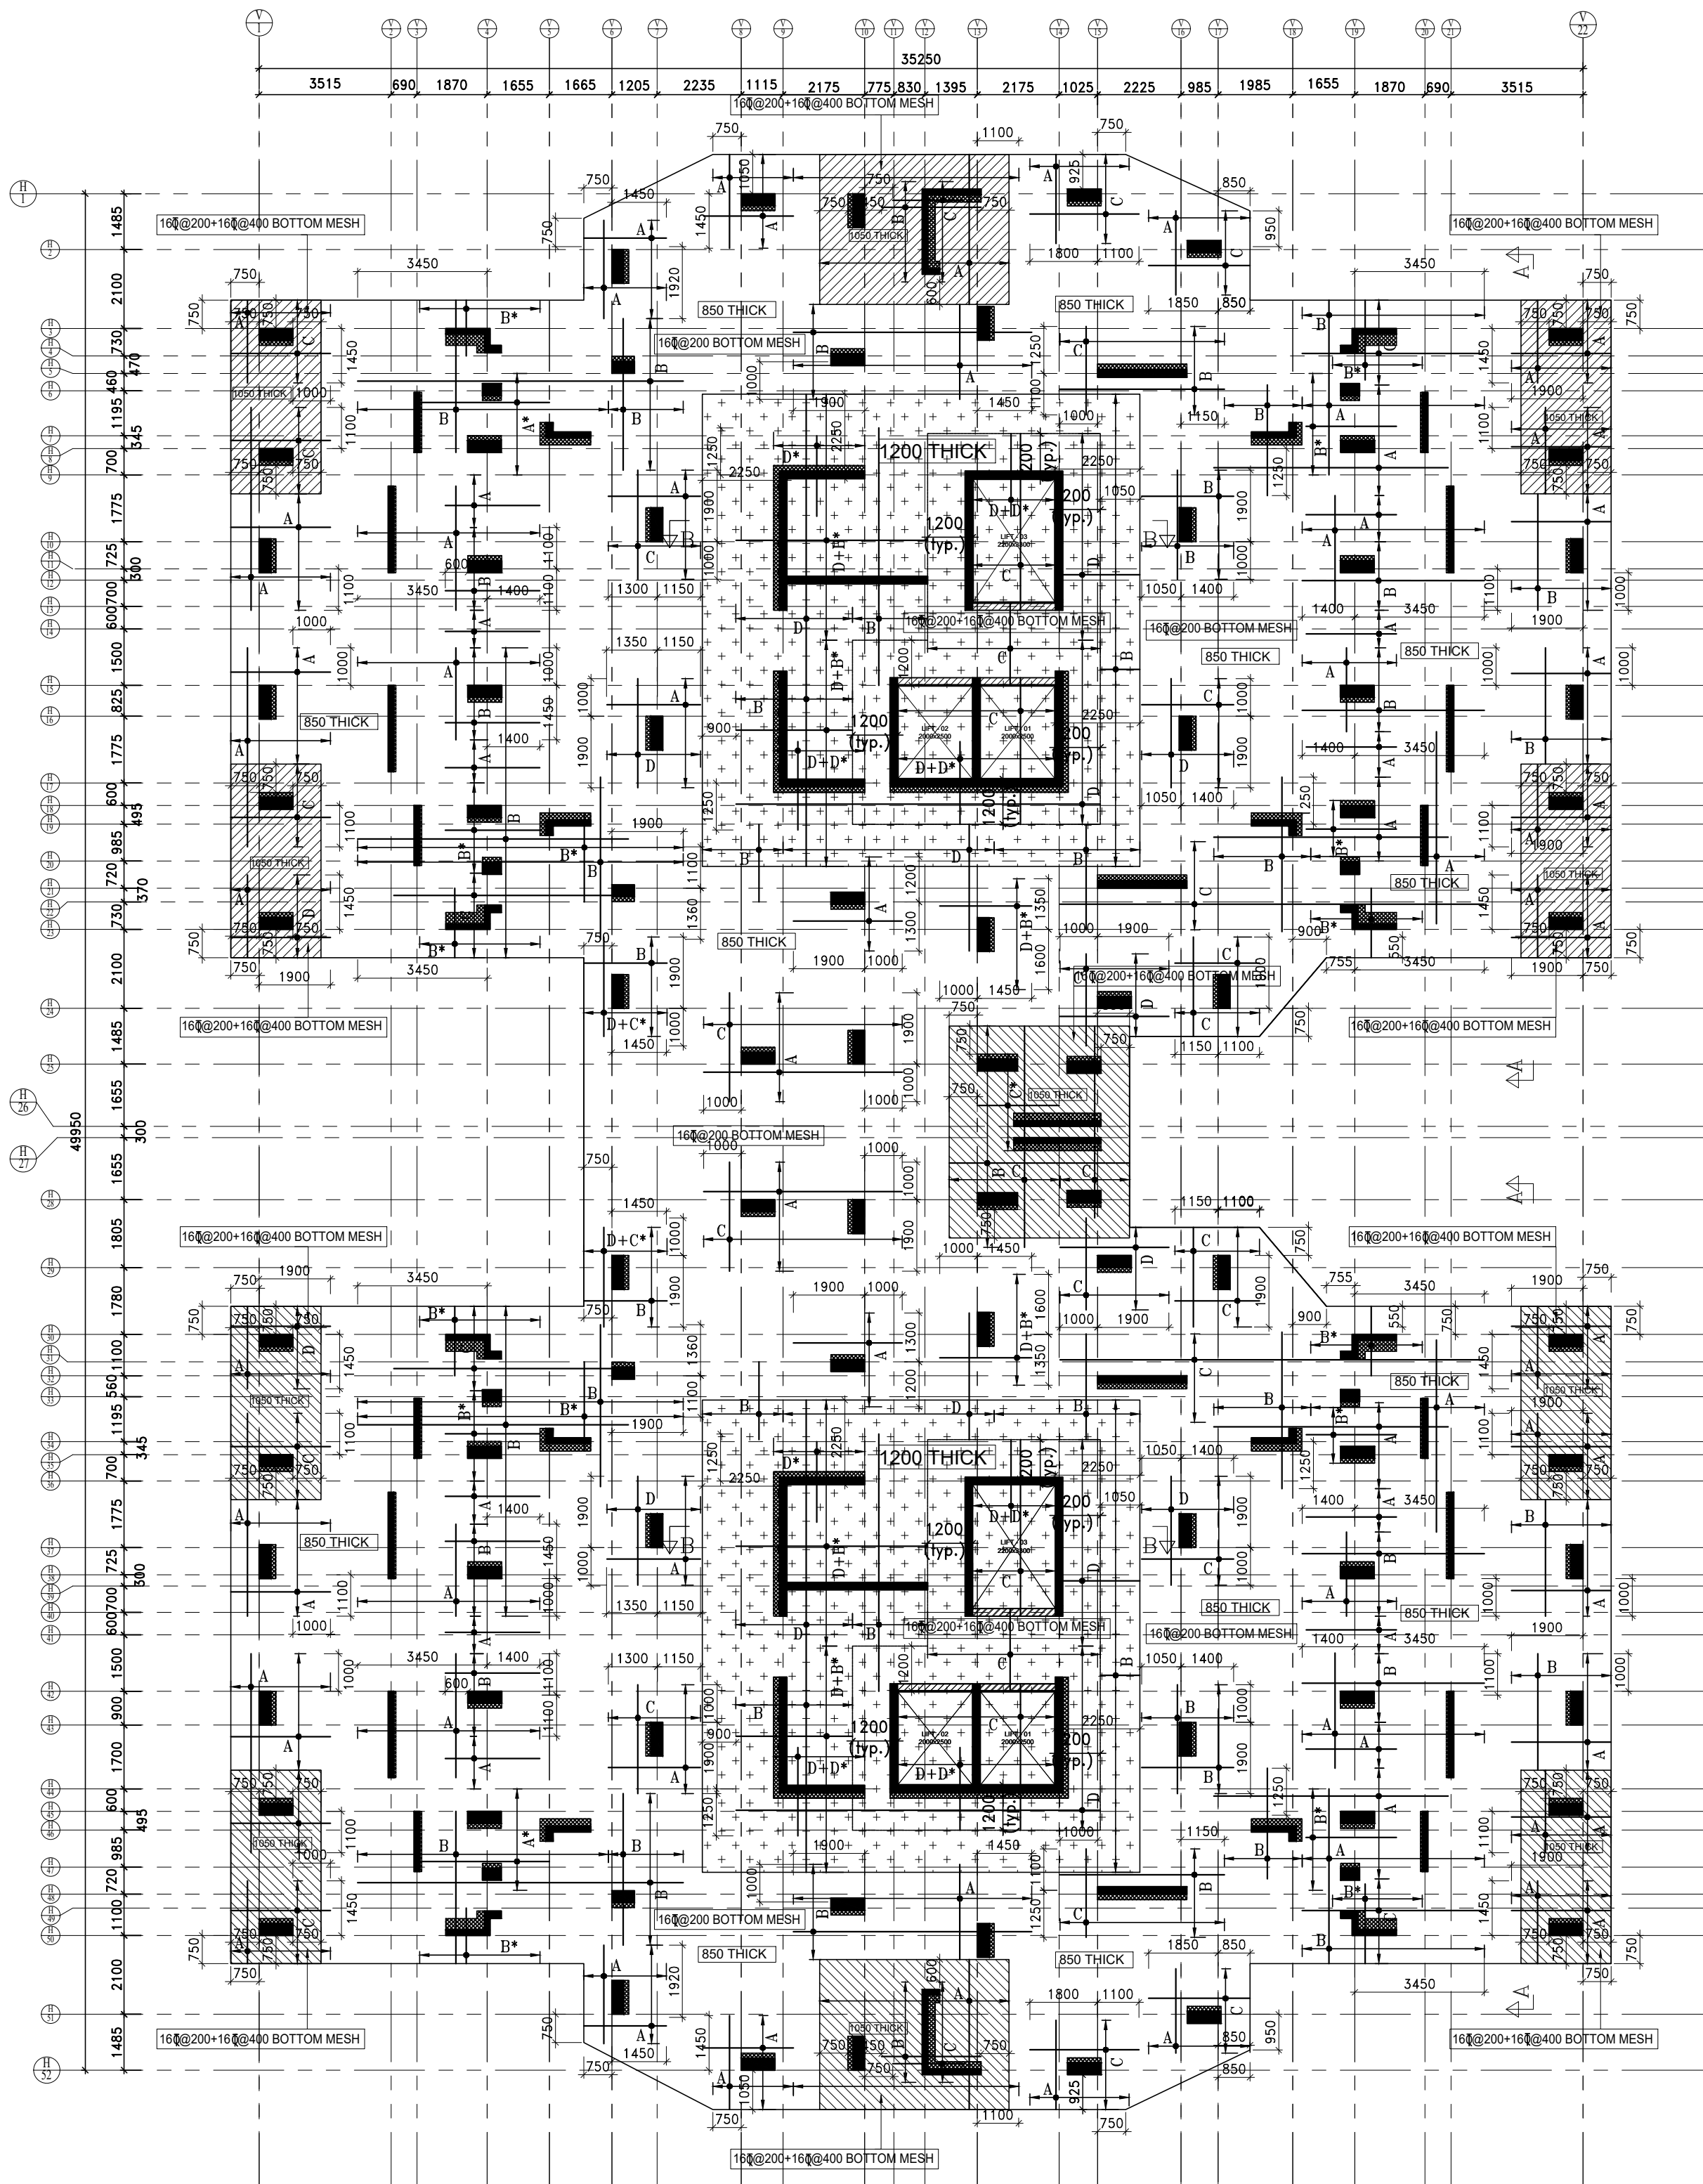


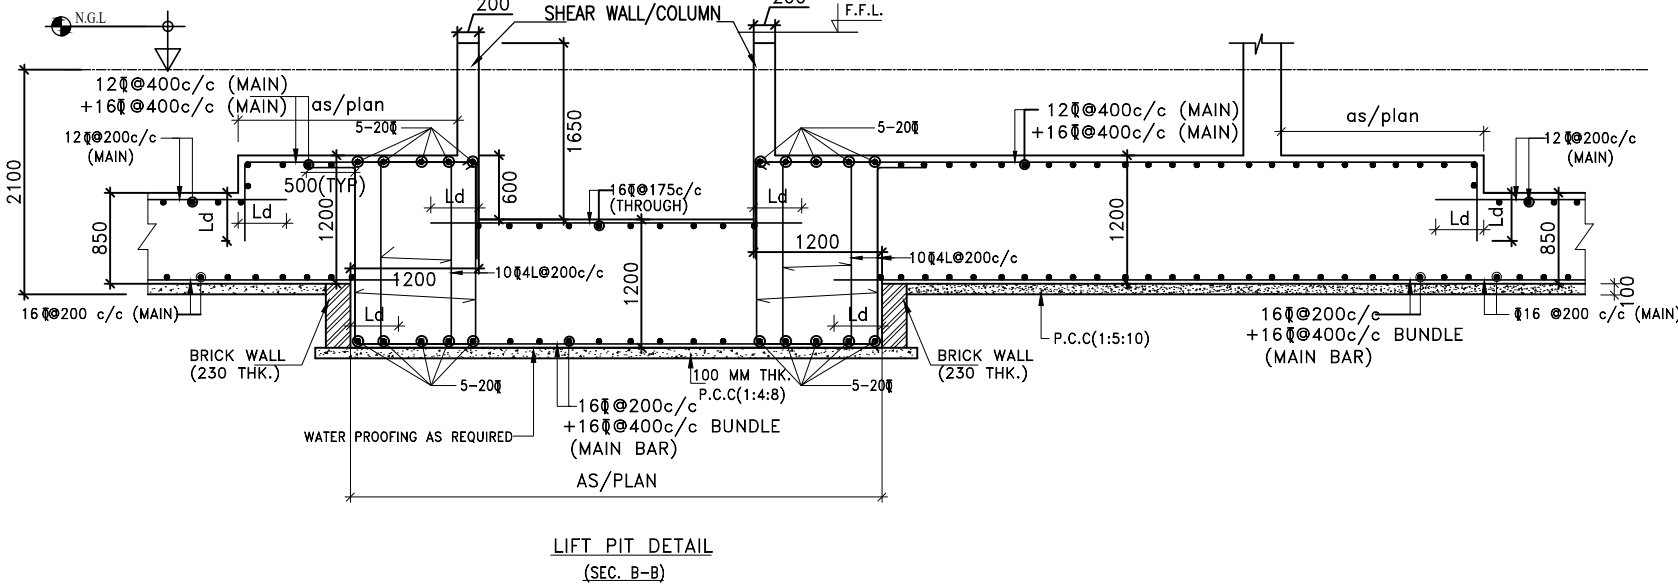

RAFT REF. DETAILS AT BOTTOM LVL.(TOWER-A&B)
(SHOWING EXTRA BOTTOM REINFORCEMENT ONLY)
(GRADE OF CONCRETE SHALL BE M-30)

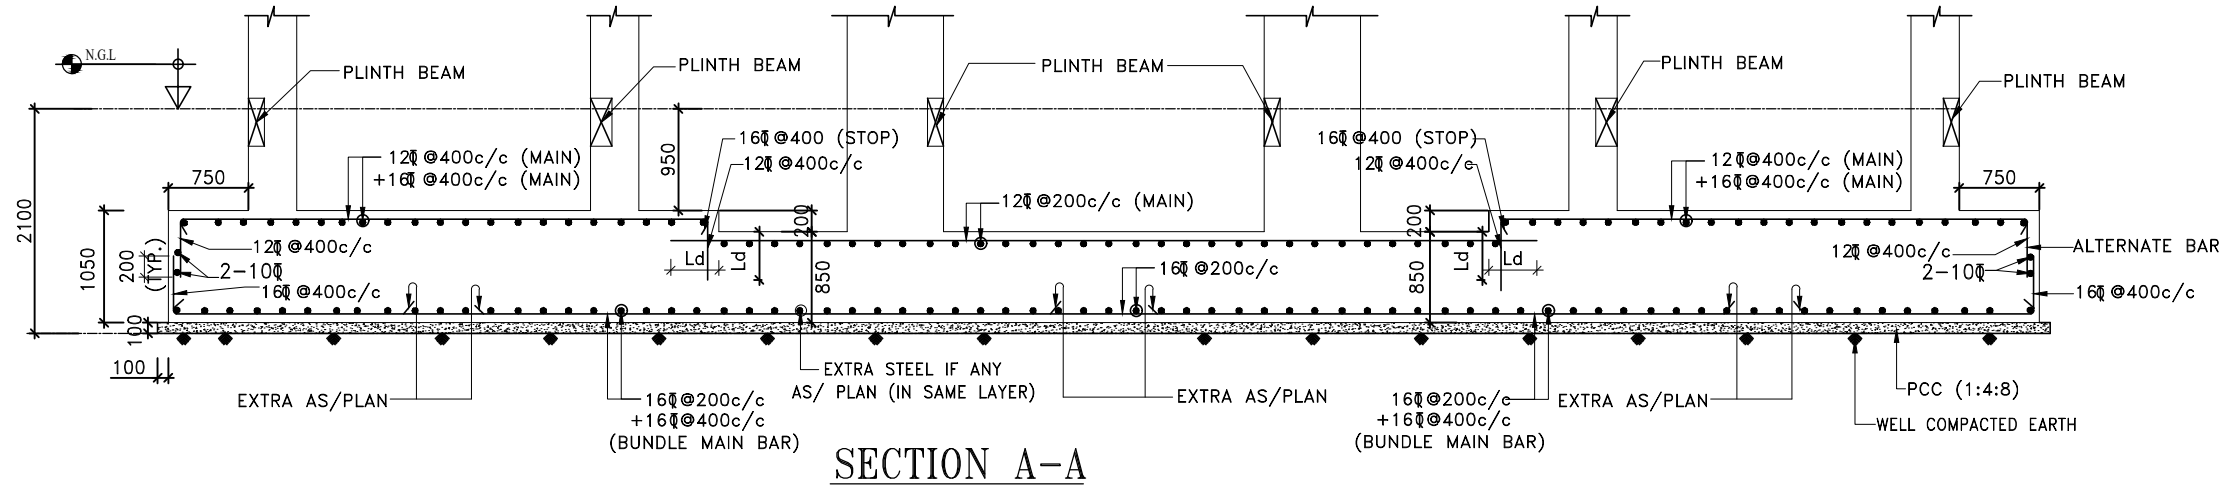

SCHEDULE OF
EXTRA BOTTOM R/F

A	12 # @ 200c/c
B	16 # @ 200c/c
C	20 # @ 200c/c
D	25 # @ 200c/c
E	20 # @ 400c/c
F	10 # @ 200c/c
G	12 # @ 400c/c
	+16 # @ 400c/c
* REIN. IN 2ND LAYER	

TOWER-A&B ST-03

GENERAL NOTES -
NOTES & REFERENCES

1. READ THIS DRAWING IN CONJUNCTION WITH RELEVANT ARCHITECTURAL DRAWINGS. ANY DISCREPANCY IF FOUND SHALL BE BROUGHT TO THE NOTICE OF CONSULTANT.
2. ALL DIMENSIONS ARE IN MM & LEVELS IN MILLIMETERS.
3. DO NOT SCALE ANY DIMENSION.
4. CONFIRM LOCATION OF WALLS WITH RELEVANT ARCH. DRGS.
5. FOR RCC WORK USE MIX M30 CONFORMING TO IS 456 : 2000 OR AS SPECIFIED IN RESPECTIVE DWG.
6. THE REINFORCEMENT SHALL BE COLD TWISTED DEFORMED BARS (C.T.D.) OR T.M.T. BARS HAVING YIELD STRENGTH NOT LESS THAN 500 N/mm² AND CONFORMING TO I.S. 1786 - 1979.
7. THE CLEAR COVER TO THE REINFORCEMENT SHALL BE AS FOLLOWS:-
 - (a) FOUNDATION : 60 MM surfaces in contact with earth
 - (b) COLUMNS : 40 MM
 - (c) BEAMS (top & bottom) : 25 MM side cover 25mm
 - (d) CHAJJAS/CANOPY : 20 MM
 - (e) R.C.C. WALL : 25 MM
8. NOT MORE THAN 50% OF THE BARS SHALL BE LAPPED AT ANY SECTION. LAPS CLOSE TO THE MID SPAN IN BOTTOM BARS & CLOSE TO SUPPORTS IN TOP BARS SHALL BE AVOIDED.
9. ----- INDICATES TOP BARS
----- INDICATES BOTTOM BARS
10. ALL CUTOUP LOCATION AND SIZE SHALL BE CONFIRMED WITH THE ARCHITECTURAL/SERVICES DRAWINGS.
11. BEAM LAYOUT SHALL BE CHECKED WITH RELEVANT ARCHITECTURAL DRAWINGS.
12. ALL SUNKEN AREAS SHALL BE FILLED WITH FOAM CONCRETE HAVING DENSITY NOT MORE THAN 800KG/m³.
13. RAMP AND STAIR CASE DETAILS SHALL BE CHECKED FROM RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS BEFORE CASTING.
14. THE LEVELS GIVEN IN THE STRUCTURAL DRAWINGS SHALL BE CHECKED WITH RELEVANT ARCHITECTURAL DRAWINGS BEFORE CASTING.
15. THE SUNKEN AREAS AND DEPTH SHOWN IN THE DRAWING ARE BASED ON ARCHITECTURAL DRAWING AND SERVICE DRAWINGS. DISCREPANCY IF ANY SHALL BE BROUGHT TO THE NOTICE OF CONSULTANTS.
16. MS. SLEEVES SHALL BE PROVIDED AT THE TIME OF CASTING.
17. PROVIDE 2-12# (T&B) IN SLABS BELOW WALLS WHEREVER NO BEAM IS PROVIDED.
18. ○ INDICATES SLAB MARKING.
19. NET BEARING CAPACITY OF 40.0 T/m²(GROSS) HAS BEEN CONSIDERED FOR RAFT AT THE DEPTH OF 2.0m BELOW N.G.L. as/Soil Report-14062553

R0	04.06.21	GOOD FOR CONSTRUCTION
Rev.no.	Date	Revision

DRAWING TITLE:

M/S GLS INFRACON PVT. LTD.


PROJECT TITLE :

PROPOSED PLAN OF AFFORDABLE GROUP HOUSING COLONY FOR AN AREA MEASURING 5.6625 ACRE (LICENCE NO. 34 OF 2020 DATED 30/10/2020) IN SECTOR-81, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY SMT. GEETA YADAV W/O SH. SUMAN KUMAR AND OTHERS IN COLLABORATION WITH GLS INFRACON PVT. LTD.

DRAWING TITLE :	DWG NO.
FOUNDATION PLAN & DETAILS EXTRA BOTTOM REINFORCEMENT(IN SAME LAYER)	
TOWER-A&B (S+20)	ST-03

SCALE	N.T.S
DATE	12/01/2023
DRAWN BY	ASHOK
DESIGNED BY	SHIVAM SHARMA
APPROVED BY	STA

Architect:

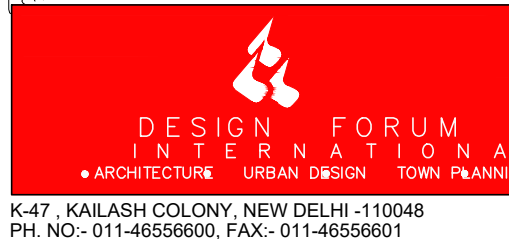

structural consultant:

Keen Associates Pvt. Ltd.
STRUCTURAL ENGINEERS & PROJECT CONSULTANTS
Office : 1st Floor, H-53, OPP. VIJAYA BANK COMMERCIAL AREA, SECTOR-63, NOIDA UP.
TELEPHONE : +91-120-4568644, 01204240514
E-mail : keenassociates2005@gmail.com, keen_associates@hotmail.com.

DRAWING RELEASED FOR:

- ☐ APPROVAL ☒ SUBMISSION ☐ ADVANCE COPY
☐ TENDER ☐ PROOF CHECKING ☐ CONSTRUCTION

Syafin
SYED TALUDDIN ASHRAF
C. E. -AM-100566-1