

DD (T) MEMBER BPAC

S.T.P. (HQ) Member Secretary B.P.A.C. S.T.P. (G) Member B.P.A.C. S.T.P. (MR) Member B.P.A.C.

DTP (HQ)

AD. FA. A.P.

Consultant Architect

ATP (HQ)

Rajesh Dutt JD (HQ)


Checked and found ok for Public Health (Internal) Service only subject to comments in forwarding letter No. 18520 dated 14/01/24
Superintendent Engineer (HQ) for Chief Engineer-1 HSPV, Panchkula

TO BE READ WITH THIS OFFICE
MEMO NO.: 9920
DATED: 15/03/24

TYPE	WIDTH	HEIGHT	CILL	LINTEL	FIRE RATING
D1	800	2425	00	2425	
D2	1000	2425	00	2425	
D3	800	2425	00	2425	
D4	850	2125	300	2425	
D5	750	2425	00	2425	
D6	1200	2425	00	2425	
DW1	1000	2425	00	2425	
DW2	850	2425	00	2425	
V1	800	625	1800	2425	
V2	500	625	1800	2425	
V3	650	625	1800	2425	
SD1	1725	2425	00	2425	
SD2	2010	2425	00	2425	
SD3	2075	2425	00	2425	
SD4	3110	2425	00	2425	
SD5	1800	2425	00	2425	
SD6	2435	2425	00	2425	
GL1	2000	2425	00	2425	
FD1 (FIRE DOOR)	1200	2425	00	2425	1HR. FIRE RATING DOOR
FD2 (FIRE DOOR)	900	2425	00	2425	1HR. FIRE RATING DOOR
FD3 (FIRE DOOR)	900	2425	00	2425	2 HR. FIRE RATING DOOR
FD4 (FIRE DOOR)	900	2425	00	2425	2 HR. FIRE RATING DOOR



PLUMBING LEGEND:
1 1100 SOIL PIPE
2 1100 WASTE PIPE
3 1100 RAIN WATER PIPE
4 DWS DN TAKE PIPE
5 DWS FROM BOOSTER PUMP FOR TOP TWO FLOOR
6 FWS DN TAKE PIPE
7 1100 BALCONY DRAIN PIPE
8 650 DOMESTIC WATER SUPPLY RISER
9 500 FLUSHING WATER SUPPLY RISER
10 750 ANTISYPHONAGE PIPE
WB TO FT 320 WASTE PIPE
SINK TO FT 500 WASTE PIPE
FD 1 FLOOR DRAIN WITH GRATING
FT 1 FLOOR TRAP WITH GRATING
MT 1 MULTI TRAP WITH GRATING
BD 1 BALCONY DRAIN WITH GRATING
DWS DOMESTIC WATER SUPPLY PIPE
FWS FLUSHING WATER SUPPLY PIPE
DWS DWS PIPE THROUGH BOOSTER PUMP
GEYSER TOILET GEYSER 25LTR
GEYSER KITCHEN GEYSER 6LTR
P BOOSTER PUMP SET FOR TOP TWO FLOOR
CATCH BASIN 1100x500mm

Note:
1. The kitchen space has been considered as non-habitable space as per NBC 2016 Part-3 Section 2.45 clause, thus lighting and ventilation clause for kitchen do not apply only for main units kitchen.
2. Toilets are mechanically ventilated wherever marked in plan.

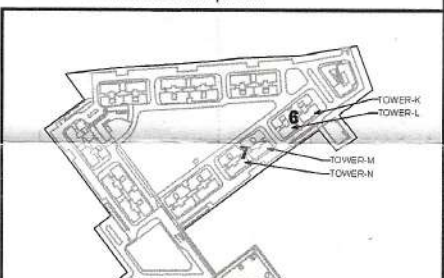

PROJECT
REVISED BUILDING PLANS FOR GROUP HOUSING COLONY UNDER MIXED LAND USE IN TOD ZONE FOR AN AREA MEASURING 16.1125 ACRES (89% GROUP HOUSING COMPONENT AND 11% COMMERCIAL COMPONENT) (LICENSE NO.108 OF 2022 DATED 05.08.2022) IN REVENUE ESTATE OF CHAUNDA, SECTOR-113, GURGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY M/S NOURISH DEVELOPERS PVT. LTD.

ARCHITECT'S SEAL & SIGNATURE
REGD. No. 93/11-197
Scale: Drawing Title: BLOCK 06 & 07 TERRACE & ROOF PLAN & AREA DIAGRAMS
Drawing No: 35

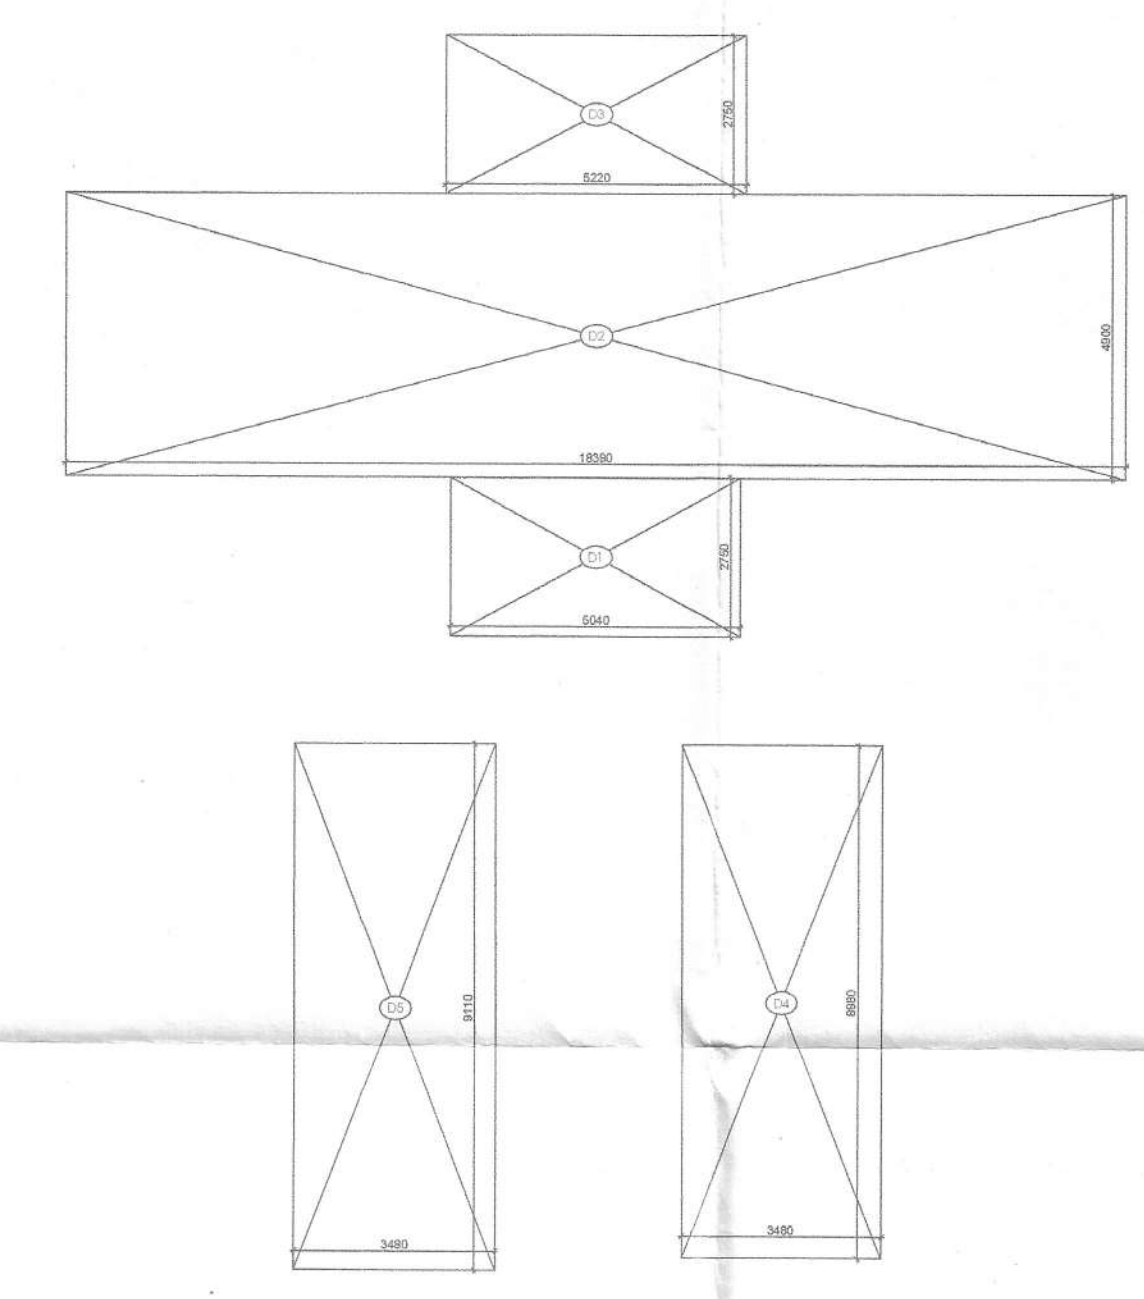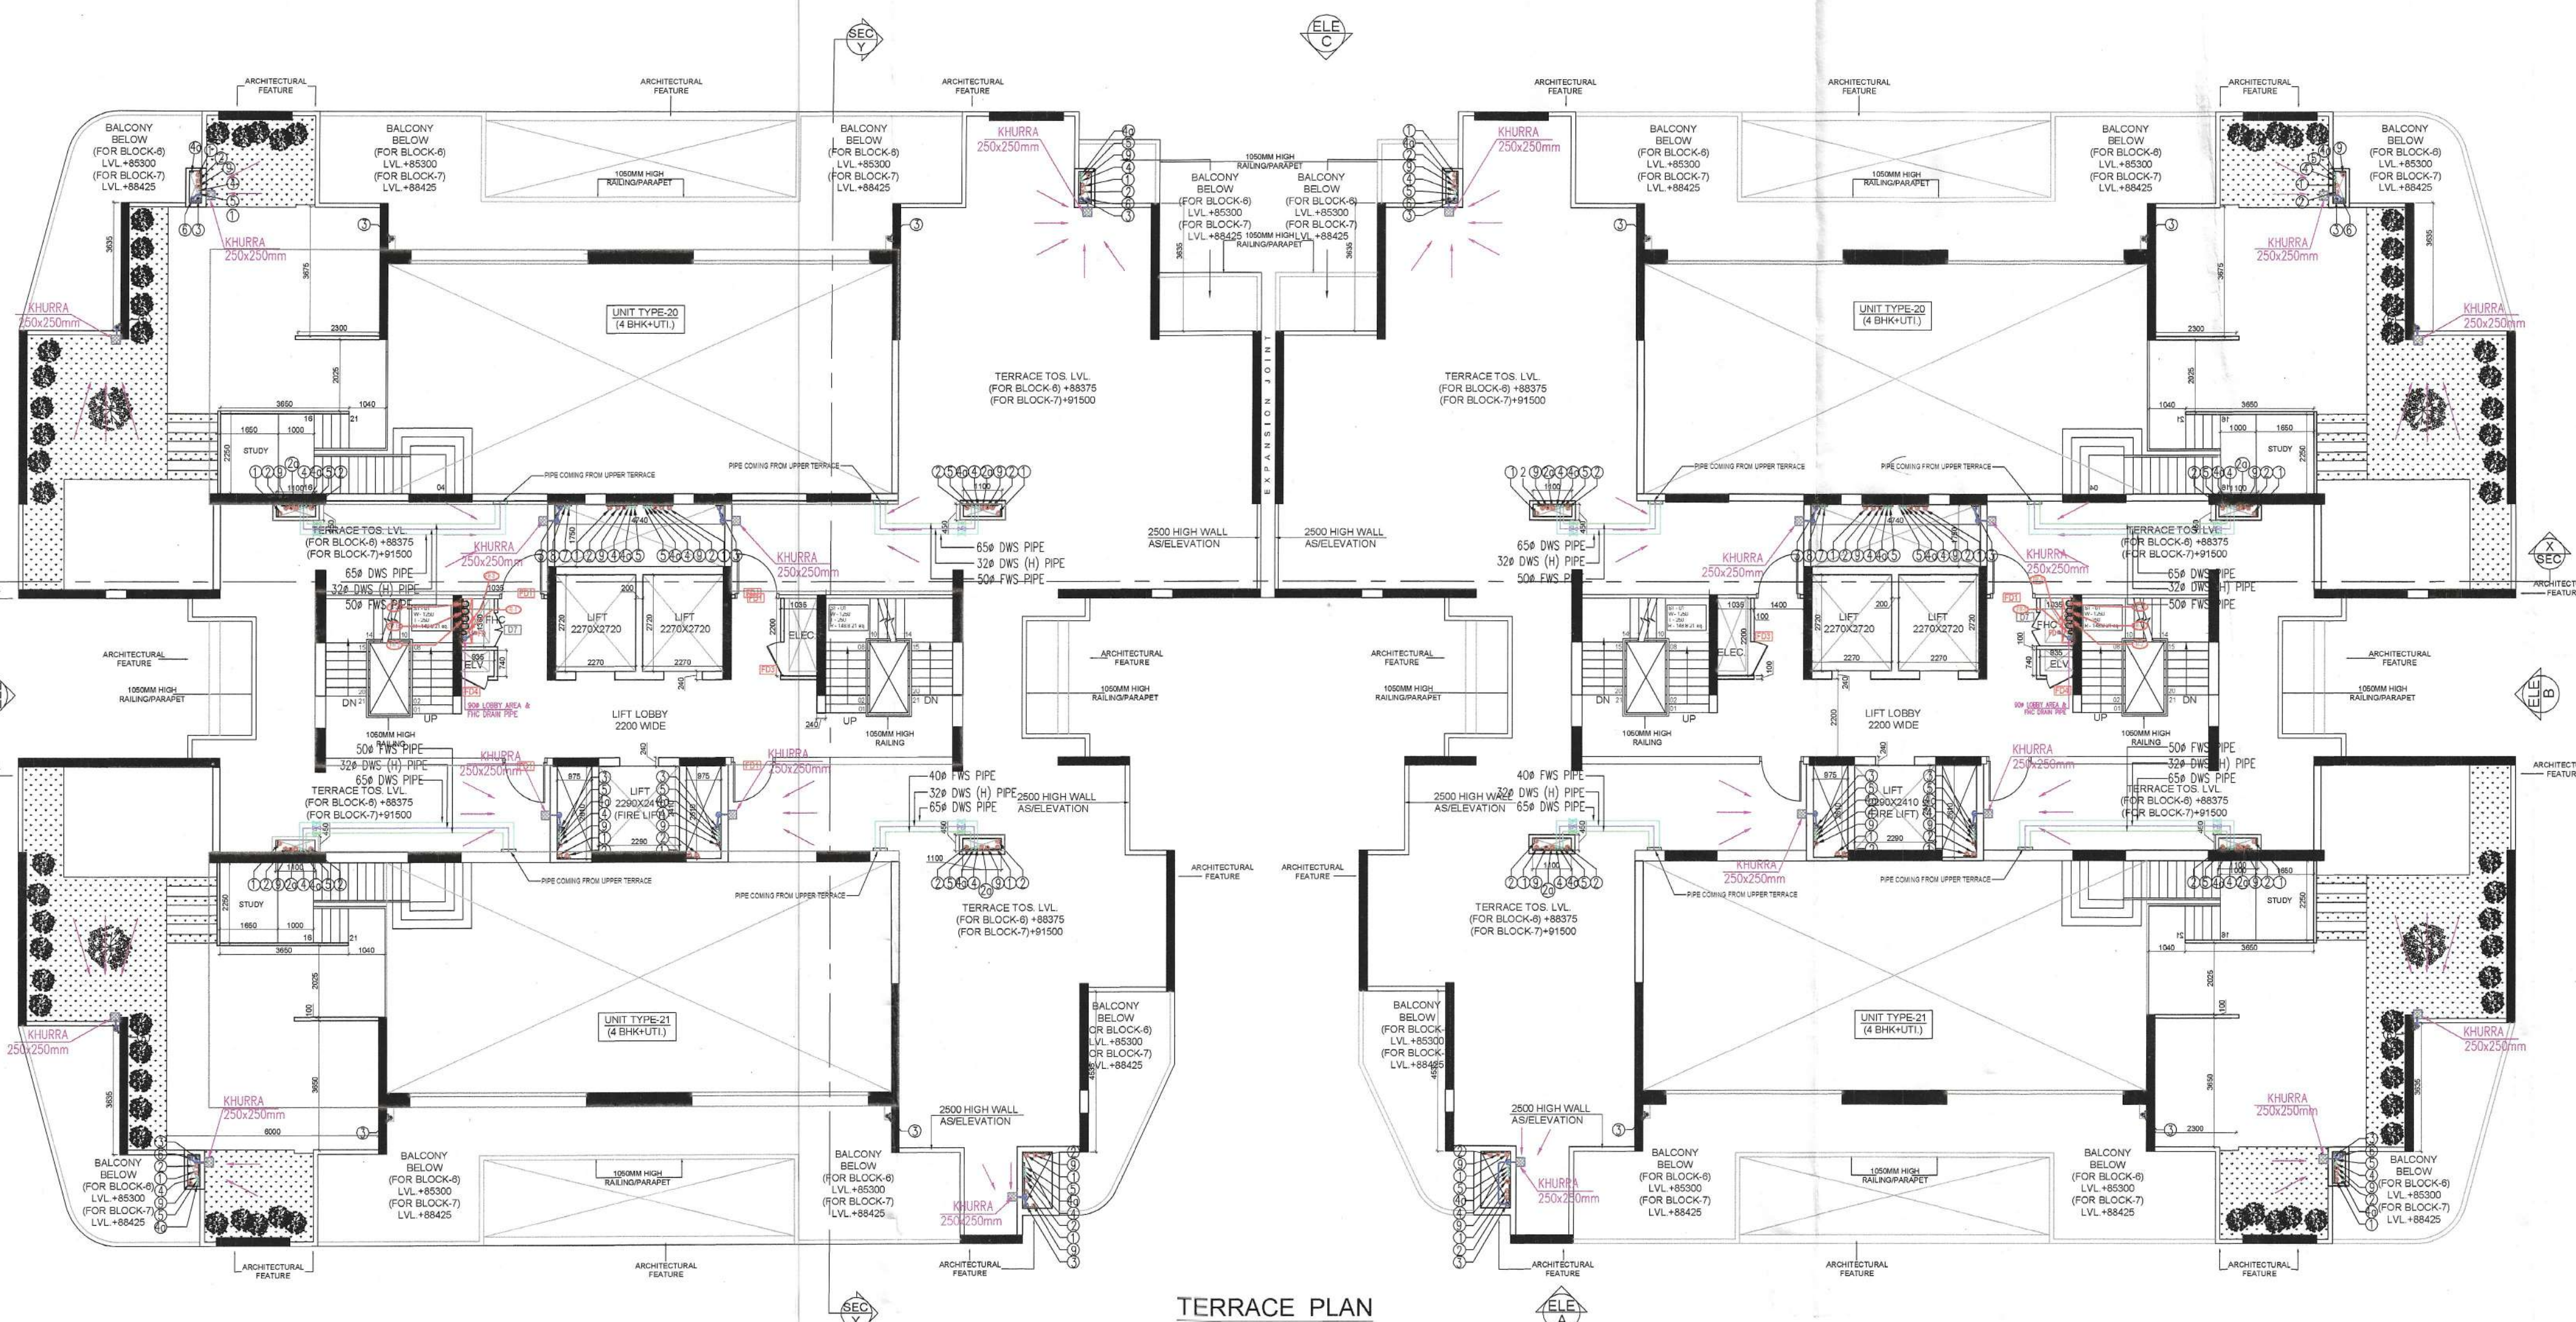

AREA CALCULATION FOR MUMTY, OH TANKS						
NON FAR REA						
D1	2	L X W	5.040	2.750	27.720	SQM.
D2	2	L X W	18.390	4.900	180.222	SQM.
D3	2	L X W	5.220	2.750	28.710	SQM.
D4	2	L X W	3.480	8.880	61.805	SQM.
D5	2	L X W	3.480	9.110	63.406	SQM.
TOTAL TERRACE NON FAR AREA					361.862	SQM.