


NOTES :-	• WIV System is being provided. • Full DG power back up is being provided. • Toilets are mechanical ventilated. • All electrical installations shall be as per provision of NBC. • Fire fighting capacity provisions will be as per NBC. • Basement area shall have mechanically ventilated as per relevant code. • Mechanical ventilation as per hygroena building code 2017. • Building has automatic sprinkler system wherever required. • Building will be designed (structured) as per relevant I. s. codes for earthquake resistance. • Solar panels of required capacity shall be provided for power generation for all norms. • All handpump stalls with railing. • All fire fighting installations shall be as per relevant code. • The rainwater harvesting system shall be provided as per central ground water auth norms.
----------	--

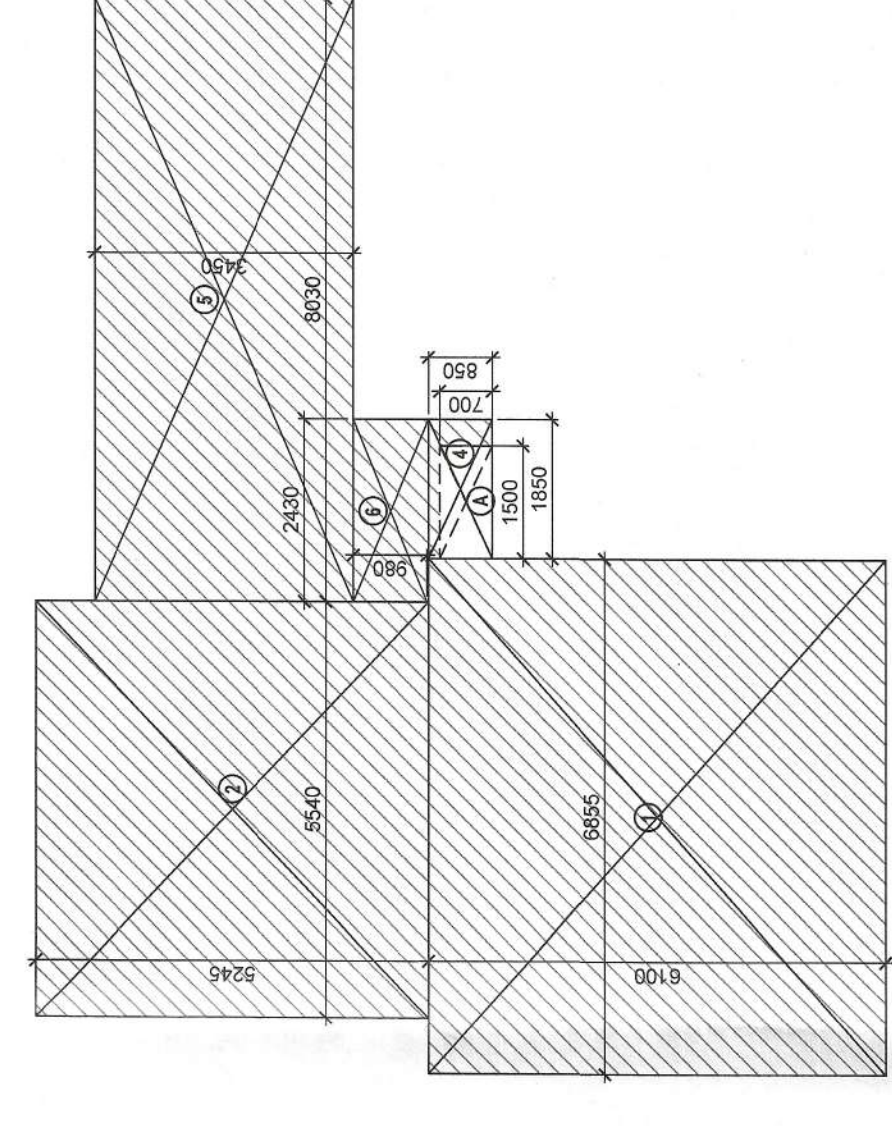

SANCTIONED
TO BE READ WITH THIS OFFICE
MEMO NO.:
DATED:

Checked and found ok for Public Health
(Internal) Service only subject to comments in
in forwarding letter No. 163789...DW. 2/14/24

AREA DIAGRAM
SCALE 1:100

TOWER C_TERRACE FLOOR AREA DIAGRAM

AREA DIAGRAM
SCALE 1:100

[illegible]