

# ADORE BUILDCON LLP

---

Date :- 19-07-2024

To,

JE/SDO (OP)

Sohna, Gurugram, Haryana.

**Subject :-** Application for shifting of 11 KV HT Line from our project Affordable Group Housing Colony 6.76875 acres, Project Located in the revenue estate of Village Sohna, Sector 2 & 35, Sohna, Gurugram by M/s Adore Buildcon LLP.

Respected Sir,

This is in regard of the subject and references that we will be developing an Affordable Group Housing Project on land measuring 6.76875 acres located in the revenue estate of Village Sohna, Sector 02 & 35, Sohna, Gurugram, Haryana (License No.51 of 2024 dated 15-03-2024).

Therefore, there will be a requirement of shifting of 11 KV HT line from our project (Rectangle No 40, Killa No 3(8-0), Rectangle No 28, Killa No 24 (8-0)).

On behalf of the Company, we assure to DHBVN that we will promptly deposit any estimated expenses for the line shifting incurred by the Nigam.

You are kindly requested for shifting of 11KV HT line from our project.

Thanking You,

Yours sincerely,

For Adore Buildcon LLP

For ADORE BUILDCON LLP

Authorized Signatory

Authorized Signatory

*Mustaf*  
21/07/24  
SDO (OP)  
Sub-Division Sohna  
DHBVN, Gurugram

## DHBVN

**Name of work :-** Deposit Estimate for shifting of LT line due to crossing of Premises of MS Adore Buildcon LLP at Sec. 2 & 35 Sohna under 11 kv line Mohmad pur AP feeder emanating from 66 kv S/Stn. Sohna under "OP" S/Divn, DHBVN, Sohna during the year 2024-25.

**Framed By:-** SDO 'OP' S/Divn DHBVN, Sohna.

**Allocation:-**

**Major Head:-**

**Miner Head:-**

**Cost of Estimate :-** Rs.44500/- only.

(SSD- 382 / 2024-25.

Estimate No.

Amount Rs. 44500/-

Ritik

# DHBVN

**History & Scope: -**

This deposit estimate has been framed to cover the cost of material, over head charge, Labor charge etc. This Deposit Estimate for shifting of LT line due to crossing of Premises of MS Adore Buildcon LLP at Sec. 2 & 35 Sohna under 11 kv line Mohmad pur AP feeder emanating from 66 kv S/Stn. Sohna under "OP" S/Divn, DHBVN, Sohna during the year 2024-25. Consumer want to shift this LT pole for safety purpose. They are ready to the deposit cost of the estimate. All Dismantled material will be return to the Nigam store after complete the work. Hence this estimate has been framed. The provision has been made in the estimate according to latest guidelines issued by the Chief Engineer PD&C DHBVN, Hisar .

**Rate:**

As per the latest rates of the quarter of the year 2024-25.issued by Chief Engineer PD&C DHBVN, Hisar .

**Method: -**


The work will be carried by (A) class Pvt. Contractor under super vision of the Nigam JE/AFM incharge.

**Time: -**

The work will be complete within a short time after sanctioned the estimate and terms & conditions of the contract.

**Cost:-**

Total cost of the estimate comes out to Rs. 44500/- only.

  
SDO 'OP' S/Divn.  
DHBVN, Sohna





**Labour Charge**

Sr. No.	Description Of Material	Unit	Total.	Erection Rate	Erection Amount Material Erection
1	Erection of single PCC Pole 9 Mtr. Long with all fitting	No.	2	798	1596
2	D/o of single PCC Pole 9 Mtr. Long with all fitting	No.	1	399	399
3	D/o ACSR Conductor 50 mm2	Mtr.	300	1.035	310.5
4	E/o of ACSR Conductor 50 mm2	Mtr.	480	2.07	993.6
5	Stay Set Complete	No	1	299	299
					3598.1

**Loading & unloading charge**

Sr. No.	Description of material	Unit	Total	Loading charges	Unloading charges	G.Total
1	11 KV PCC Pole 9 Mtr long	No	2	120	60	360
2	11 KV PCC Pole 11 Mtr long	No	0	200	100	0
3	Transportation of T/F including loading & Unloading from store to site of work. (200 KVA T/F)	No	0	375	375	0
4	Transportation of T/F including loading & Unloading from store to site of work.	No	0	200	200	0
					Total	360

  
 SDO "OP" S/Divn.  
 DHBVN, Sohna


A

Pritik

Rough sketch.

Relay 2 gas.  
 Area 2 480 m<sup>2</sup>

311E 100 KWATF Sol to  
 H11122 AP

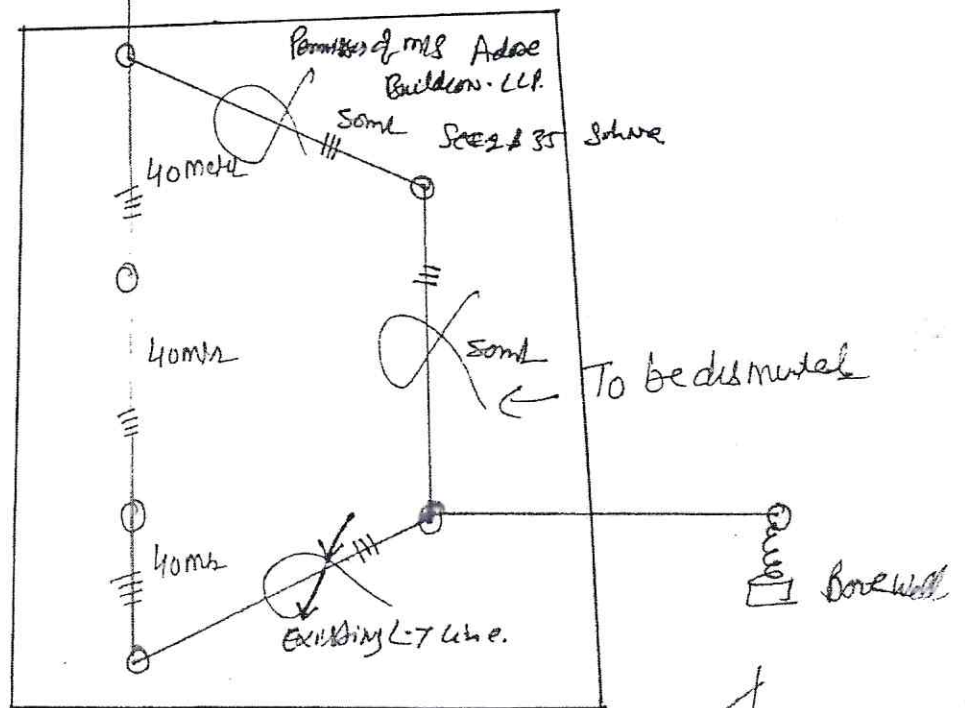

SCSOP/10/15/20  
 10/15/20

Partik