
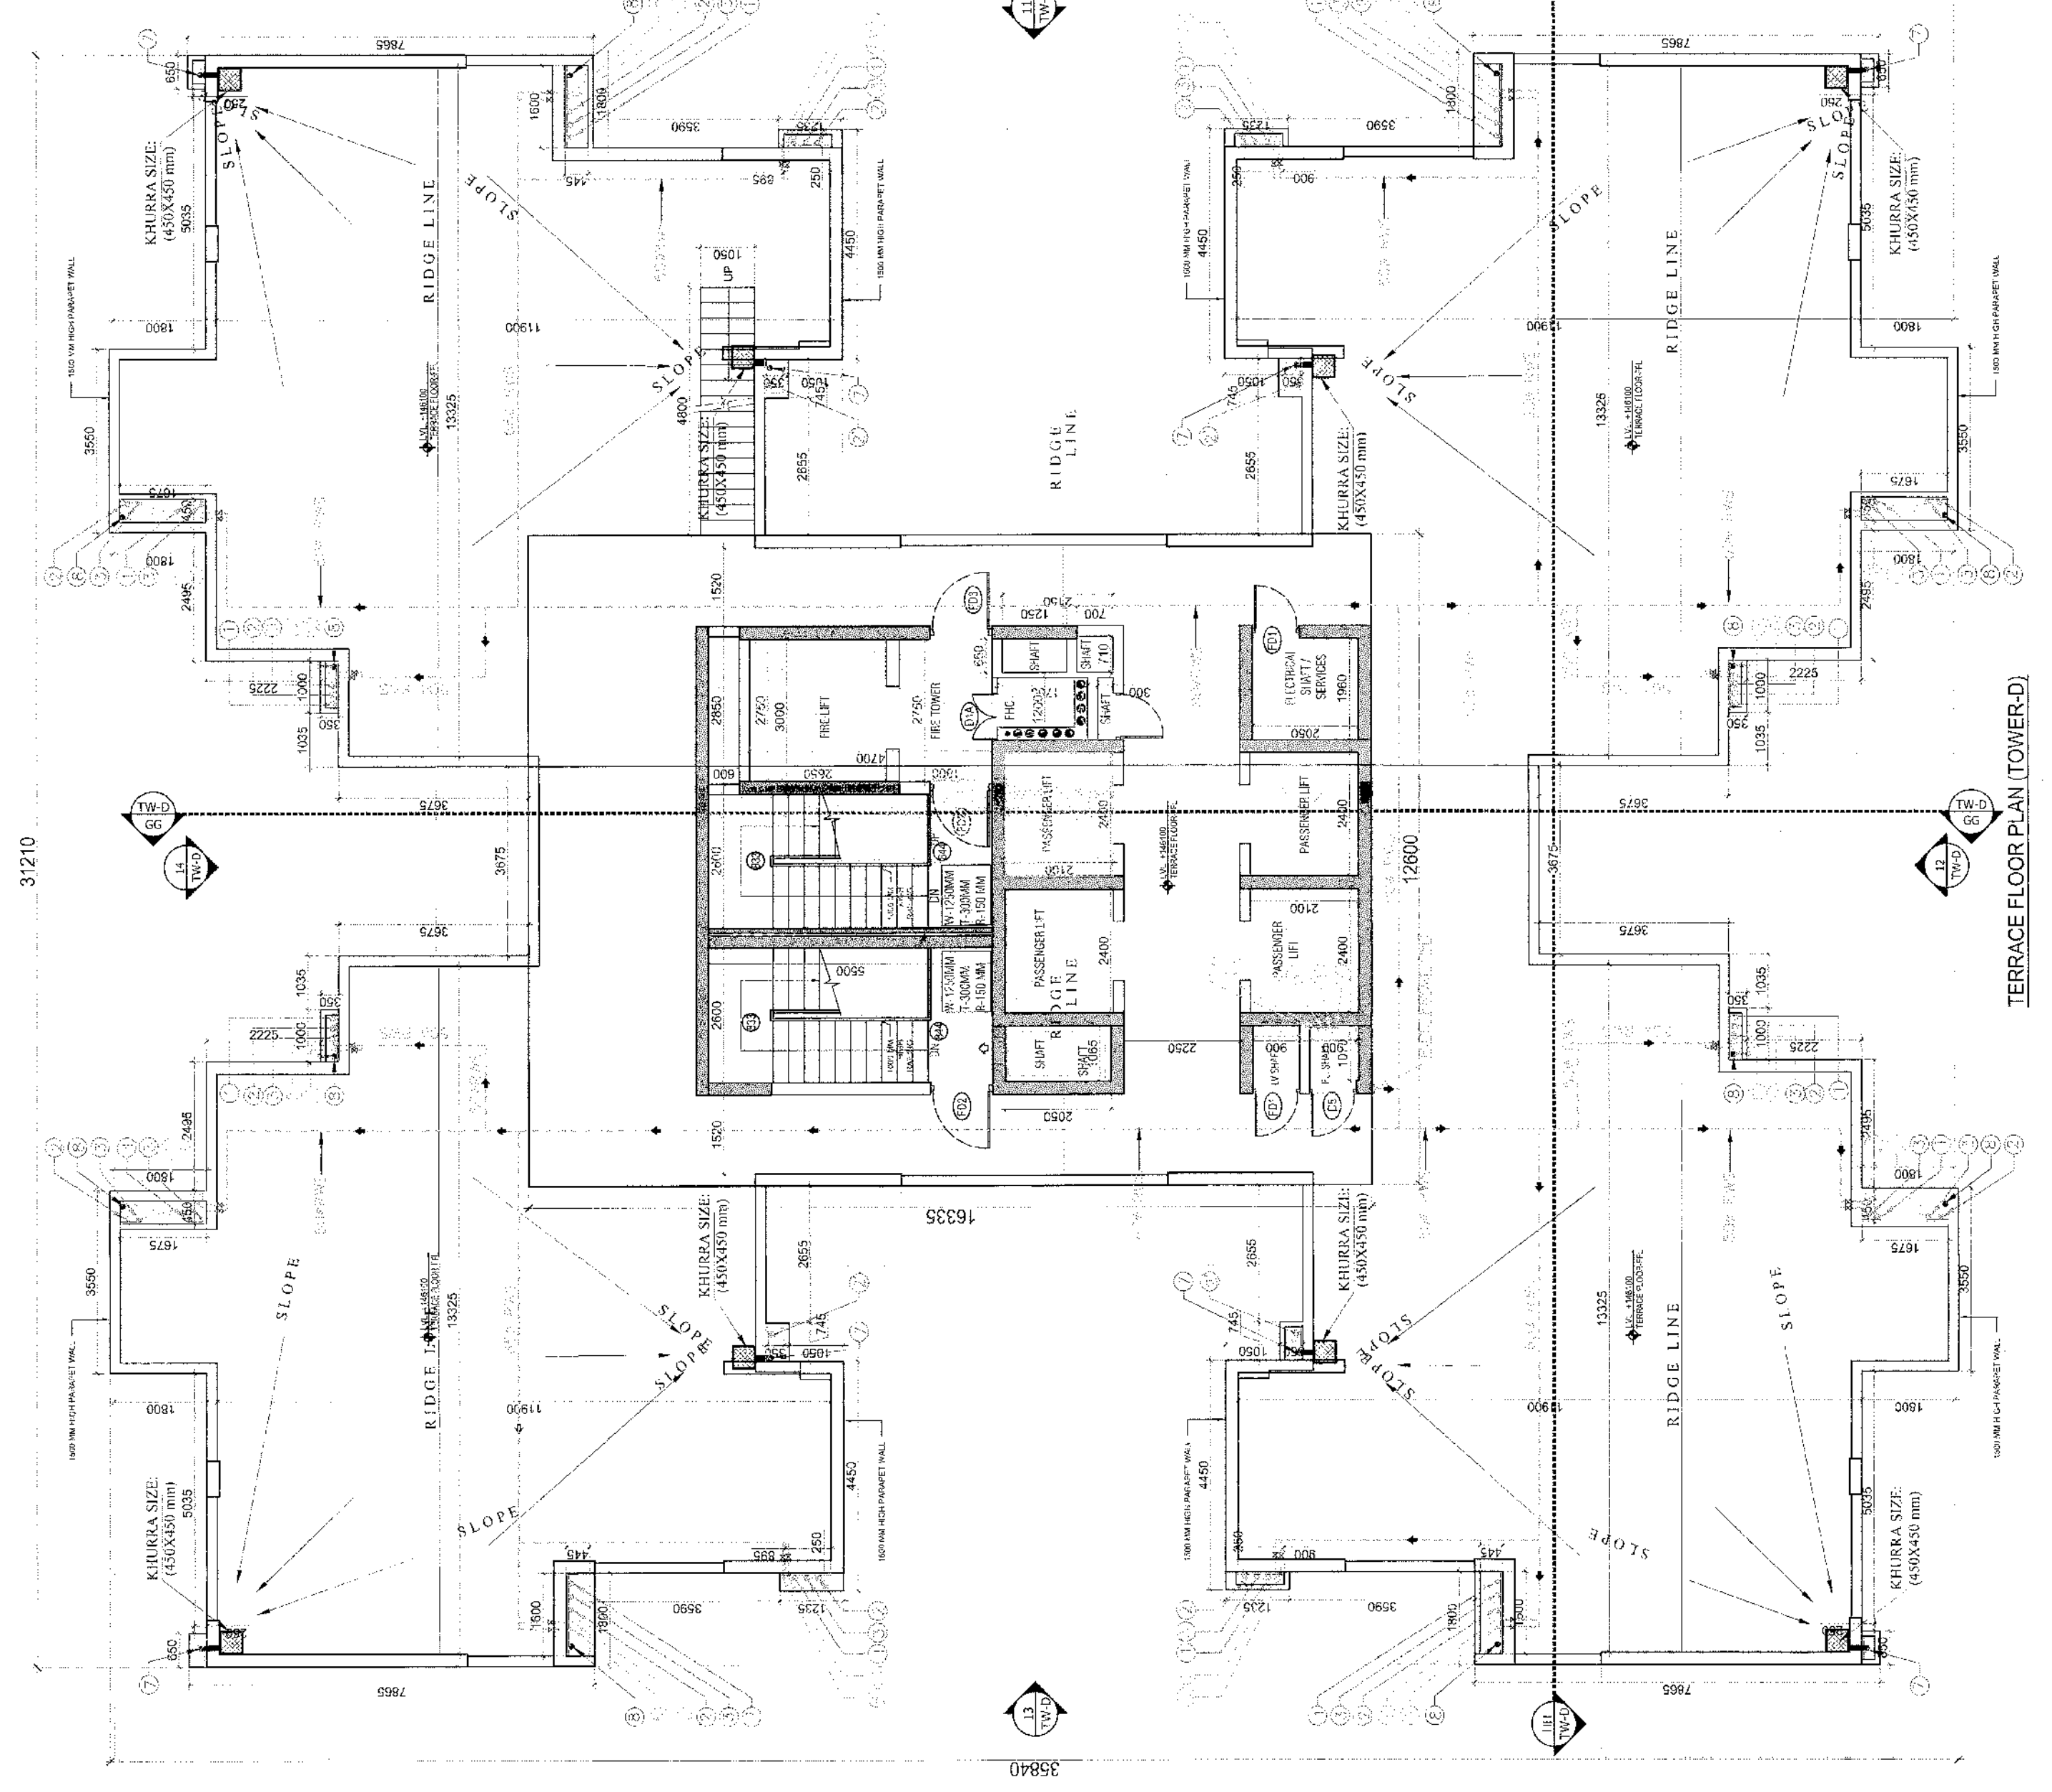
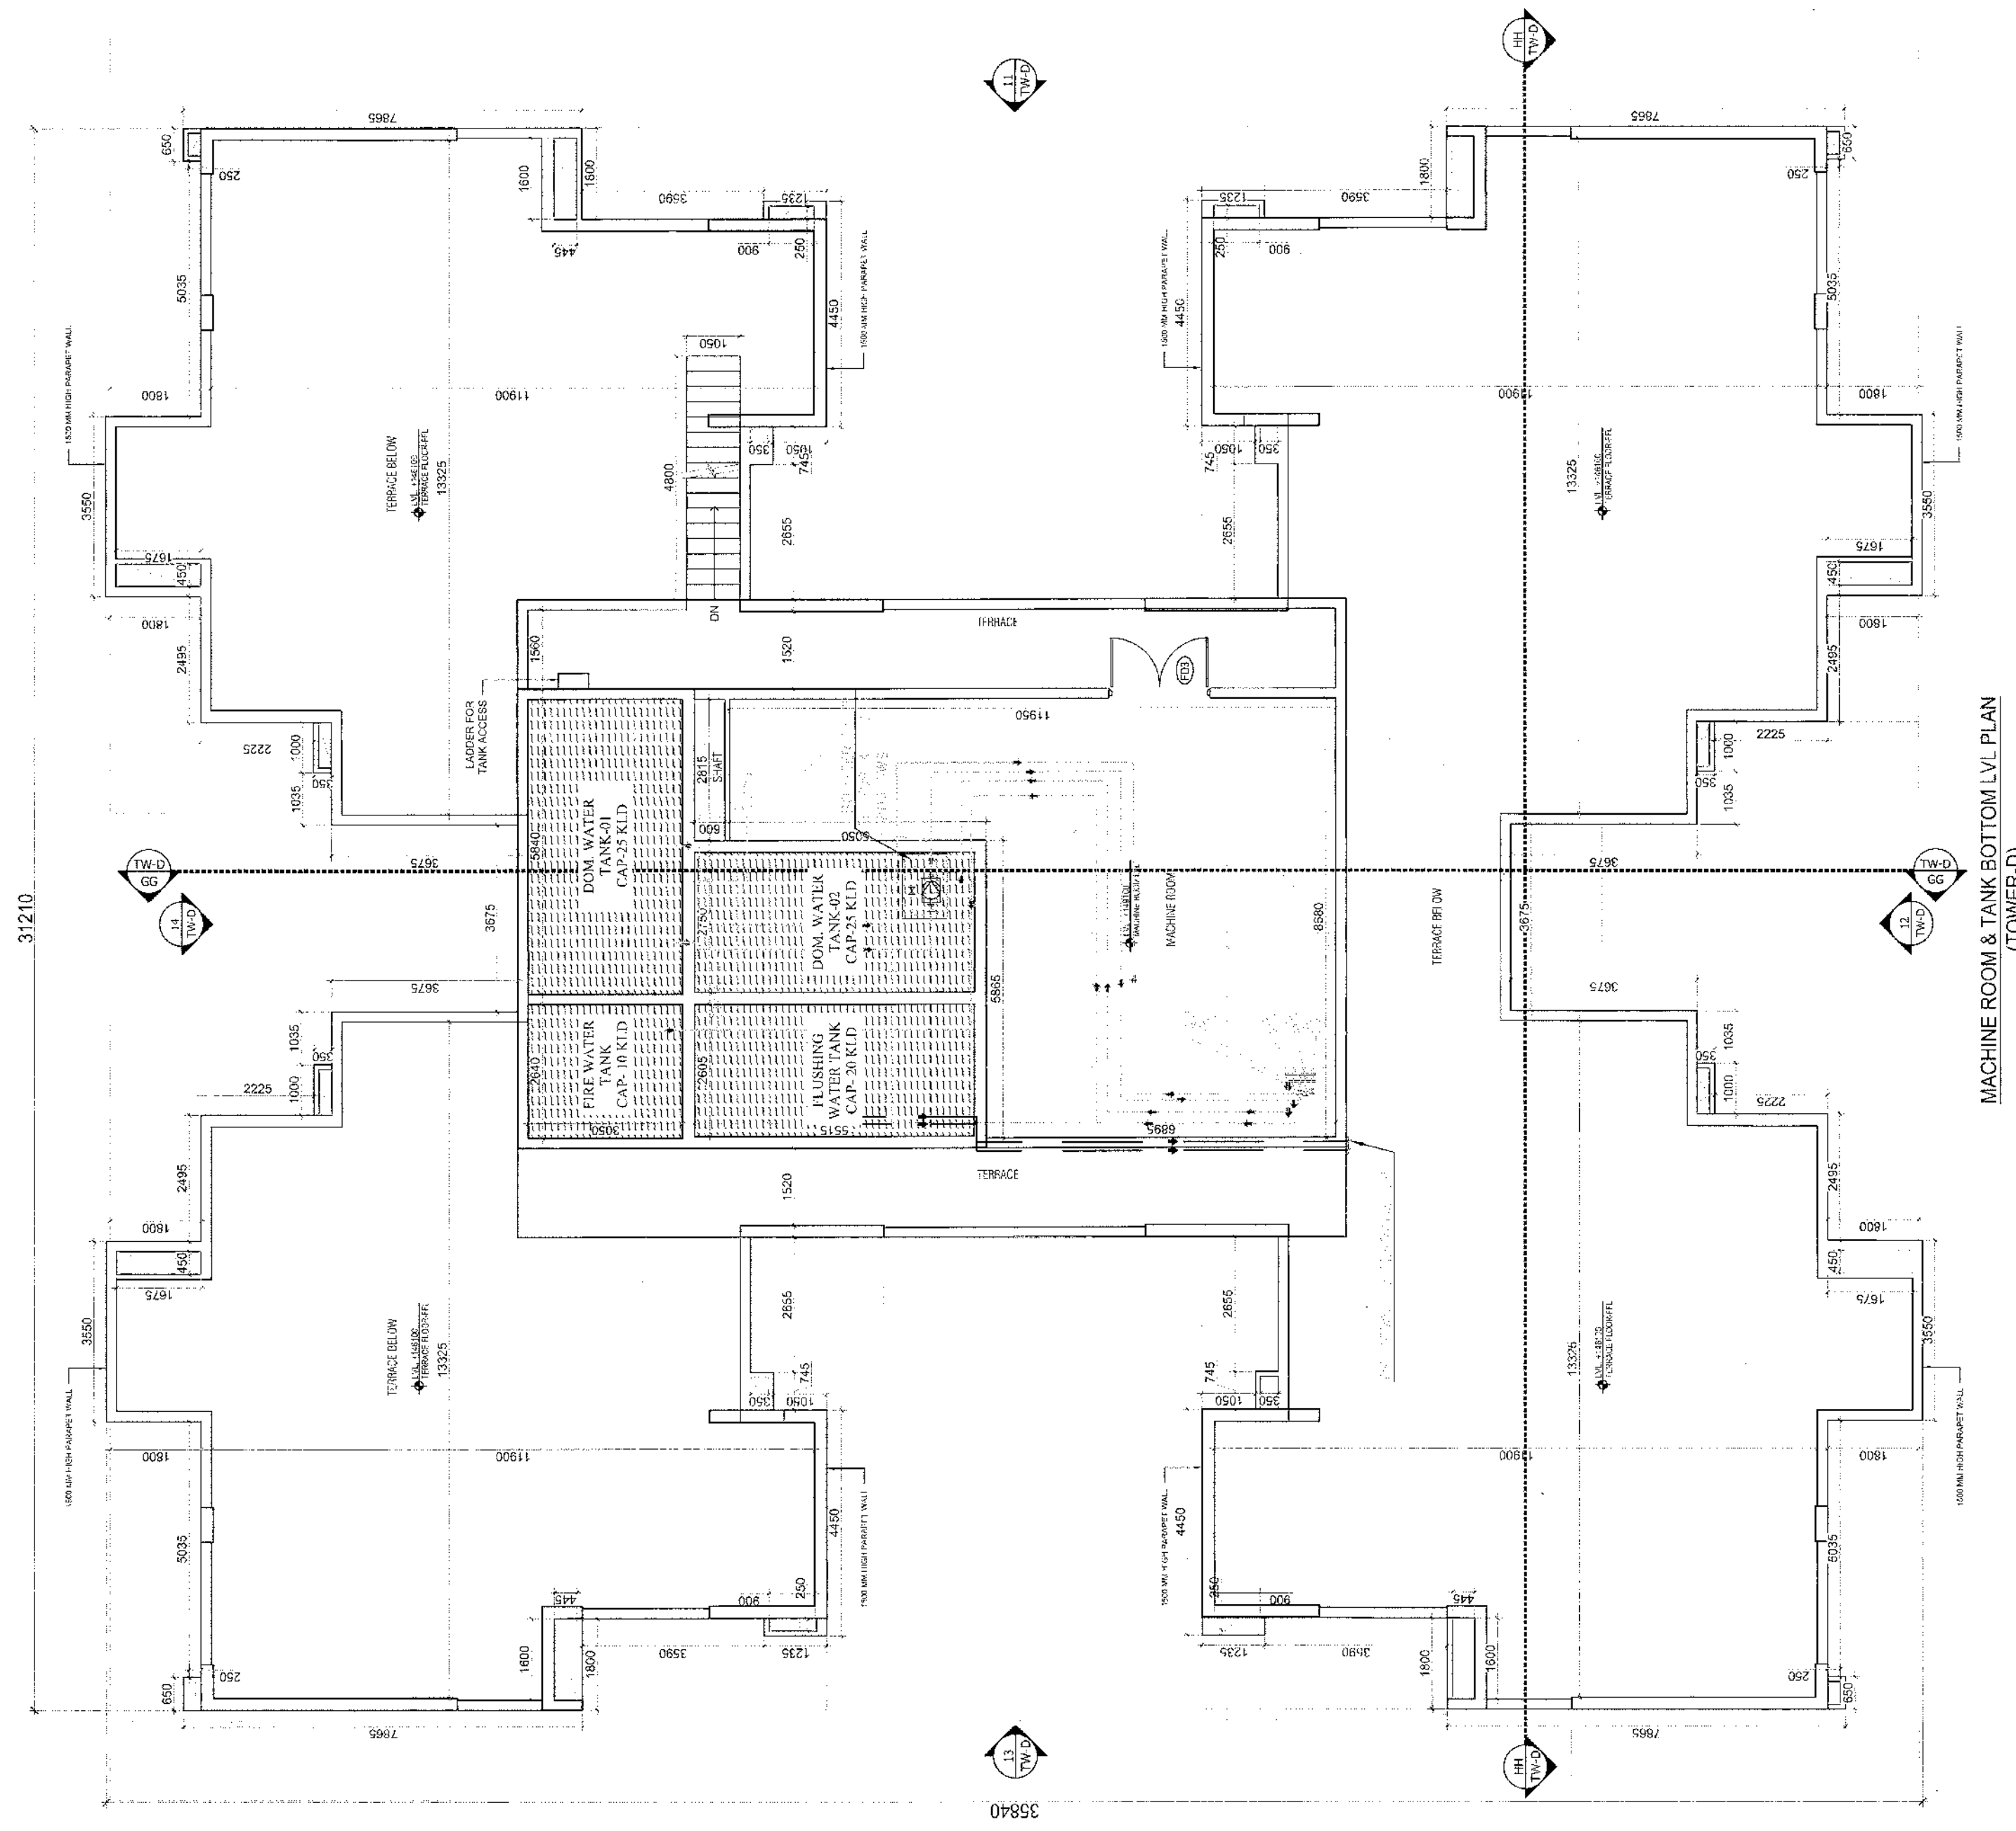
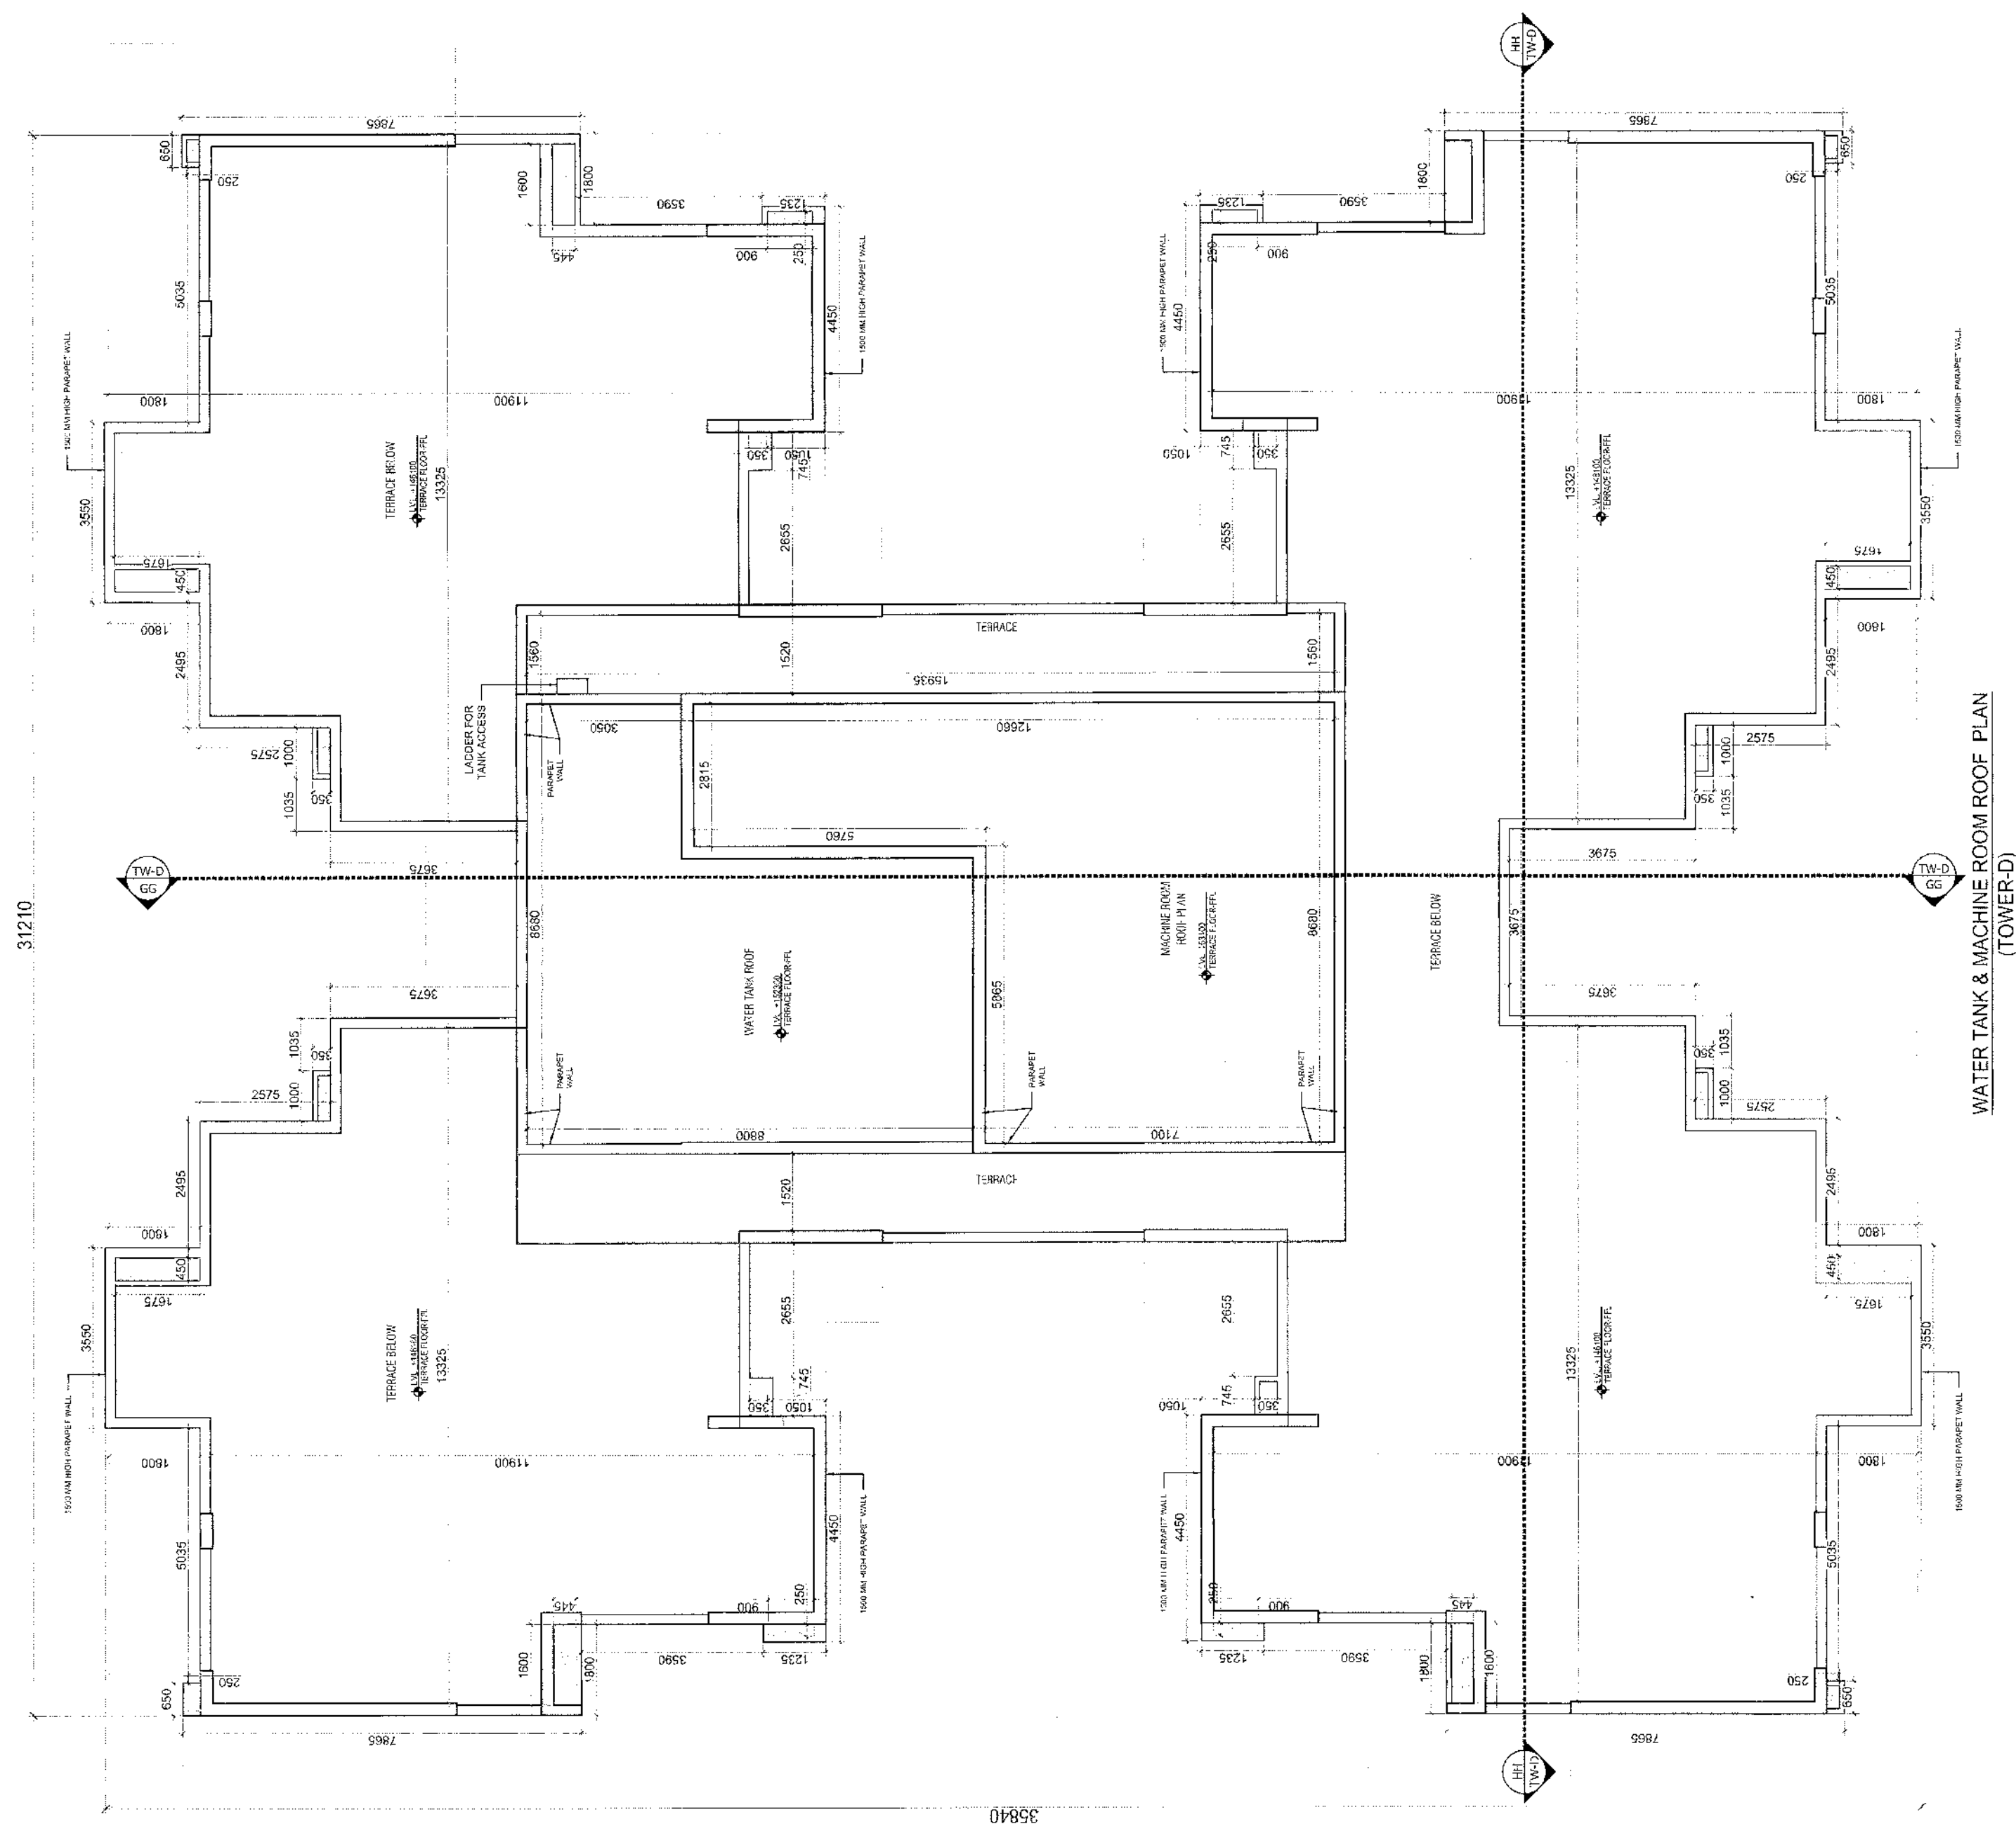


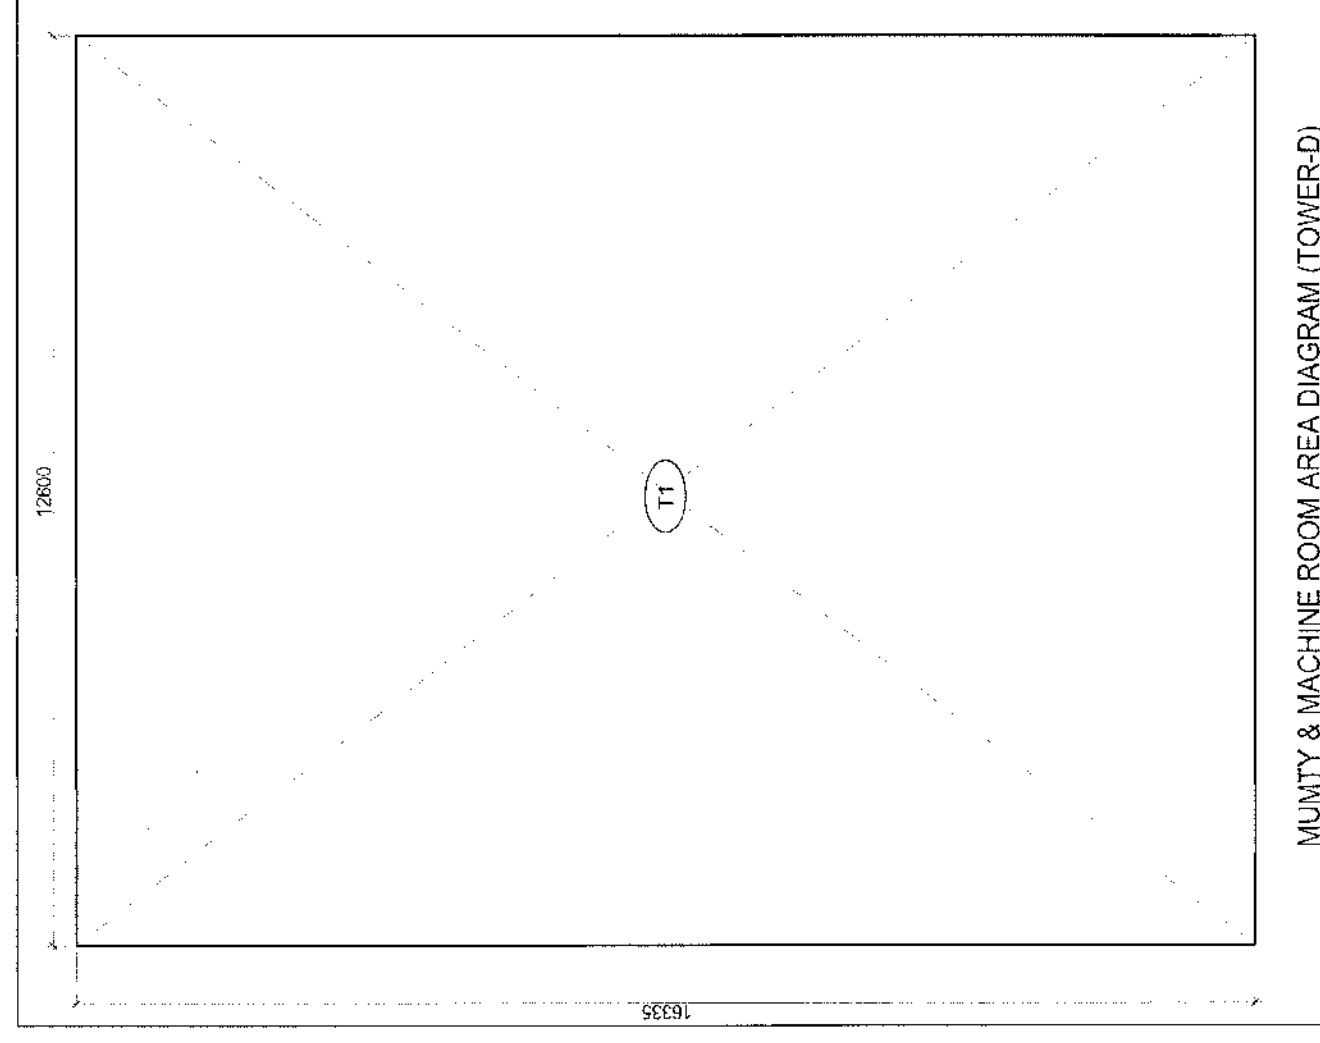

SAC	TRF	SIZE	SW	LEVEL	HAMPS
1	11	1020X400	0	160	
2	22	1020X400	0	160	0
3	31	200X400	0	160	0
4	32	200X400	0	160	0
5	33	200X400	0	160	0
6	34	200X400	0	160	0
7	V1	607X95	1500	160	0
8	V2	607X95	1500	160	0
9	V3	607X95	1500	160	0
10	V4	607X95	1500	160	0
11	FM1	1100X400	0	160	ONE HOUR FIRE RATED DOOR
12	FM2	1100X400	0	160	ONE HOUR FIRE RATED DOOR
13	FM3	1100X400	0	160	ONE HOUR FIRE RATED DOOR
14	FM4	1100X400	0	160	ONE HOUR FIRE RATED DOOR
15	FM5	1100X400	0	160	ONE HOUR FIRE RATED DOOR
16	FM6	1100X400	0	160	ONE HOUR FIRE RATED DOOR
17	FM7	1100X400	0	160	ONE HOUR FIRE RATED DOOR
18	FM8	1100X400	0	160	ONE HOUR FIRE RATED DOOR
19	FM9	1100X400	0	160	ONE HOUR FIRE RATED DOOR
20	FM10	1100X400	0	160	ONE HOUR FIRE RATED DOOR
21	FM11	1100X400	0	160	ONE HOUR FIRE RATED DOOR
22	FM12	1100X400	0	160	ONE HOUR FIRE RATED DOOR
23	FM13	1100X400	0	160	ONE HOUR FIRE RATED DOOR
24	FM14	1100X400	0	160	ONE HOUR FIRE RATED DOOR
25	FM15	1100X400	0	160	ONE HOUR FIRE RATED DOOR
26	FM16	1100X400	0	160	ONE HOUR FIRE RATED DOOR
27	FM17	1100X400	0	160	ONE HOUR FIRE RATED DOOR
28	FM18	1100X400	0	160	ONE HOUR FIRE RATED DOOR
29	FM19	1100X400	0	160	ONE HOUR FIRE RATED DOOR
30	FM20	1100X400	0	160	ONE HOUR FIRE RATED DOOR
31	FM21	1100X400	0	160	ONE HOUR FIRE RATED DOOR
32	FM22	1100X400	0	160	ONE HOUR FIRE RATED DOOR
33	FM23	1100X400	0	160	ONE HOUR FIRE RATED DOOR
34	FM24	1100X400	0	160	ONE HOUR FIRE RATED DOOR
35	FM25	1100X400	0	160	ONE HOUR FIRE RATED DOOR
36	FM26	1100X400	0	160	ONE HOUR FIRE RATED DOOR
37	FM27	1100X400	0	160	ONE HOUR FIRE RATED DOOR
38	FM28	1100X400	0	160	ONE HOUR FIRE RATED DOOR
39	FM29	1100X400	0	160	ONE HOUR FIRE RATED DOOR
40	FM30	1100X400	0	160	ONE HOUR FIRE RATED DOOR
41	FM31	1100X400	0	160	ONE HOUR FIRE RATED DOOR
42	FM32	1100X400	0	160	ONE HOUR FIRE RATED DOOR
43	FM33	1100X400	0	160	ONE HOUR FIRE RATED DOOR
44	FM34	1100X400	0	160	ONE HOUR FIRE RATED DOOR
45	FM35	1100X400	0	160	ONE HOUR FIRE RATED DOOR
46	FM36	1100X400	0	160	ONE HOUR FIRE RATED DOOR
47	FM37	1100X400	0	160	ONE HOUR FIRE RATED DOOR
48	FM38	1100X400	0	160	ONE HOUR FIRE RATED DOOR
49	FM39	1100X400	0	160	ONE HOUR FIRE RATED DOOR
50	FM40	1100X400	0	160	ONE HOUR FIRE RATED DOOR
51	FM41	1100X400	0	160	ONE HOUR FIRE RATED DOOR
52	FM42	1100X400	0	160	ONE HOUR FIRE RATED DOOR
53	FM43	1100X400	0	160	ONE HOUR FIRE RATED DOOR
54	FM44	1100X400	0	160	ONE HOUR FIRE RATED DOOR
55	FM45	1100X400	0	160	ONE HOUR FIRE RATED DOOR
56	FM46	1100X400	0	160	ONE HOUR FIRE RATED DOOR
57	FM47	1100X400	0	160	ONE HOUR FIRE RATED DOOR
58	FM48	1100X400	0	160	ONE HOUR FIRE RATED DOOR
59	FM49	1100X400	0	160	ONE HOUR FIRE RATED DOOR
60	FM50	1100X400	0	160	ONE HOUR FIRE RATED DOOR
61	FM51	1100X400	0	160	ONE HOUR FIRE RATED DOOR
62	FM52	1100X400	0	160	ONE HOUR FIRE RATED DOOR
63	FM53	1100X400	0	160	ONE HOUR FIRE RATED DOOR
64	FM54	1100X400	0	160	ONE HOUR FIRE RATED DOOR
65	FM55	1100X400	0	160	ONE HOUR FIRE RATED DOOR
66	FM56	1100X400	0	160	ONE HOUR FIRE RATED DOOR
67	FM57	1100X400	0	160	ONE HOUR FIRE RATED DOOR
68	FM58	1100X400	0	160	ONE HOUR FIRE RATED DOOR
69	FM59	1100X400	0	160	ONE HOUR FIRE

MUNITY & MACHINE ROOM AREA CALCULATIONS				
S. No.	DESCRIPTION	WIDTH	LENGHT	AREA IN SQ/MT
1	T-1	12.600	16.325	205.821
TOTAL ADDITION (A)				205.821

[illegible][illegible][illegible]

DRAWING TITLE TOWER-D TERRACE FLOOR, MACHINE ROOM TANK & BOTTOM LVL PLAN, MACHINE ROOM ROOF & AREA DIAGRAM	DRAWING NO. T-D-AR-05	SCALE :- 1:100
--	-----------------------	----------------