





TOWER- B
PENTHOUSE LVL AREA DIAGRAM
(LEVEL - 31ST)

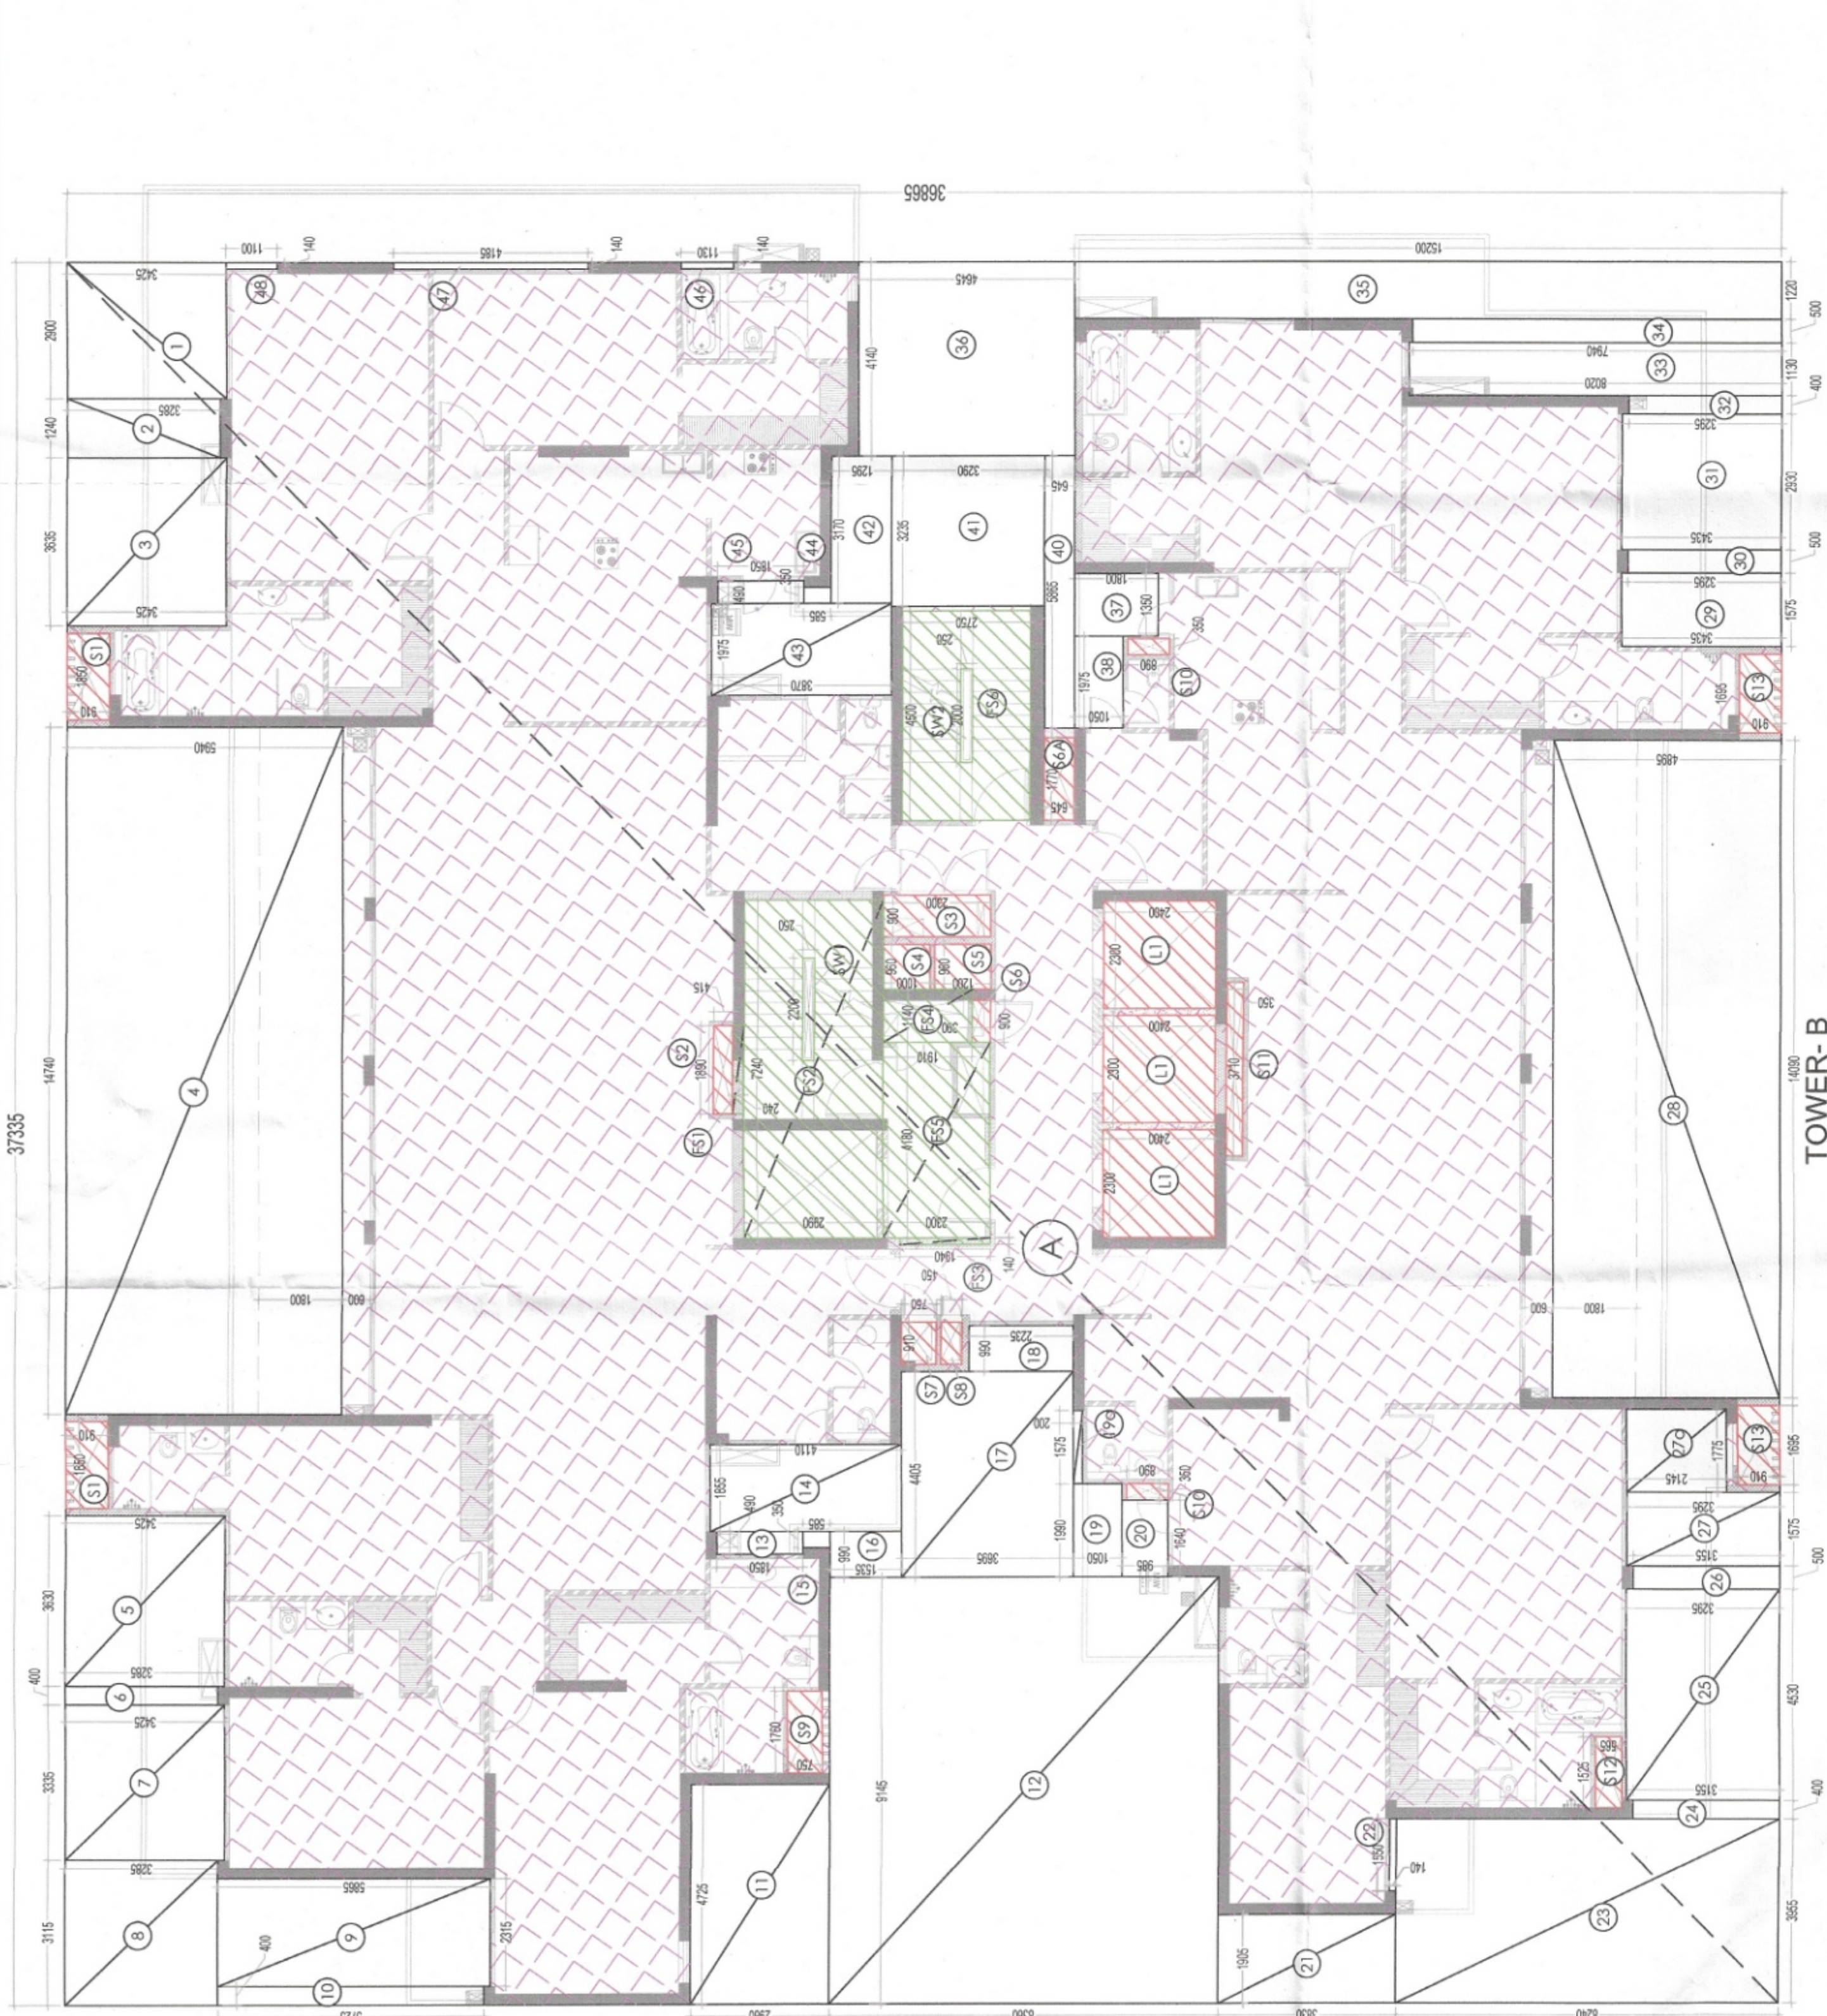

5 Bhk + Utility(penthouse)

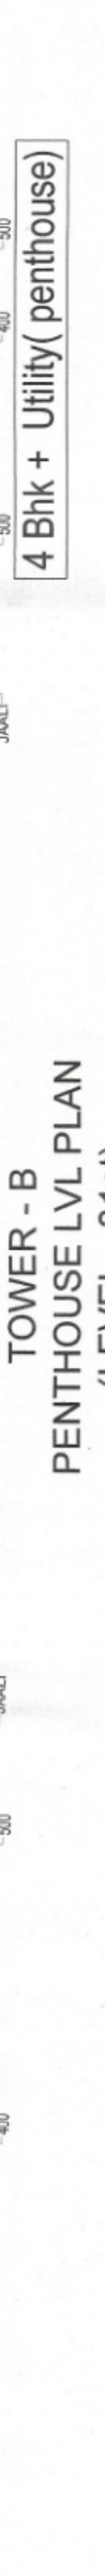


4 Bhk + Utility(penthouse)

[illegible][illegible]

Diagram illustrating a typical mechanical ventilation detail. The cross-section shows a wall with a window unit (W.C.) and a mechanical ventilation system (M.V.) installed above it. The M.V. unit is connected to the exterior air supply (18" O.D. 18" I.D. 18" S.D.) and the exhaust air supply (18" O.D. 18" I.D. 18" S.D.). The diagram also shows the FFL LEVEL (Finished Floor Level) and the ZFS (Zero Floor Surface) level.

TYPICAL MECHANICAL				D
Location	Area	Height	Volume	(Cu.ft.)
	(Sq.ft.)	(Ft.)		
TYPICAL MECHANICAL VENTILATION FOR W.C.				
W.C.	41	10.2	420	
W.C.	51	10.2	519	

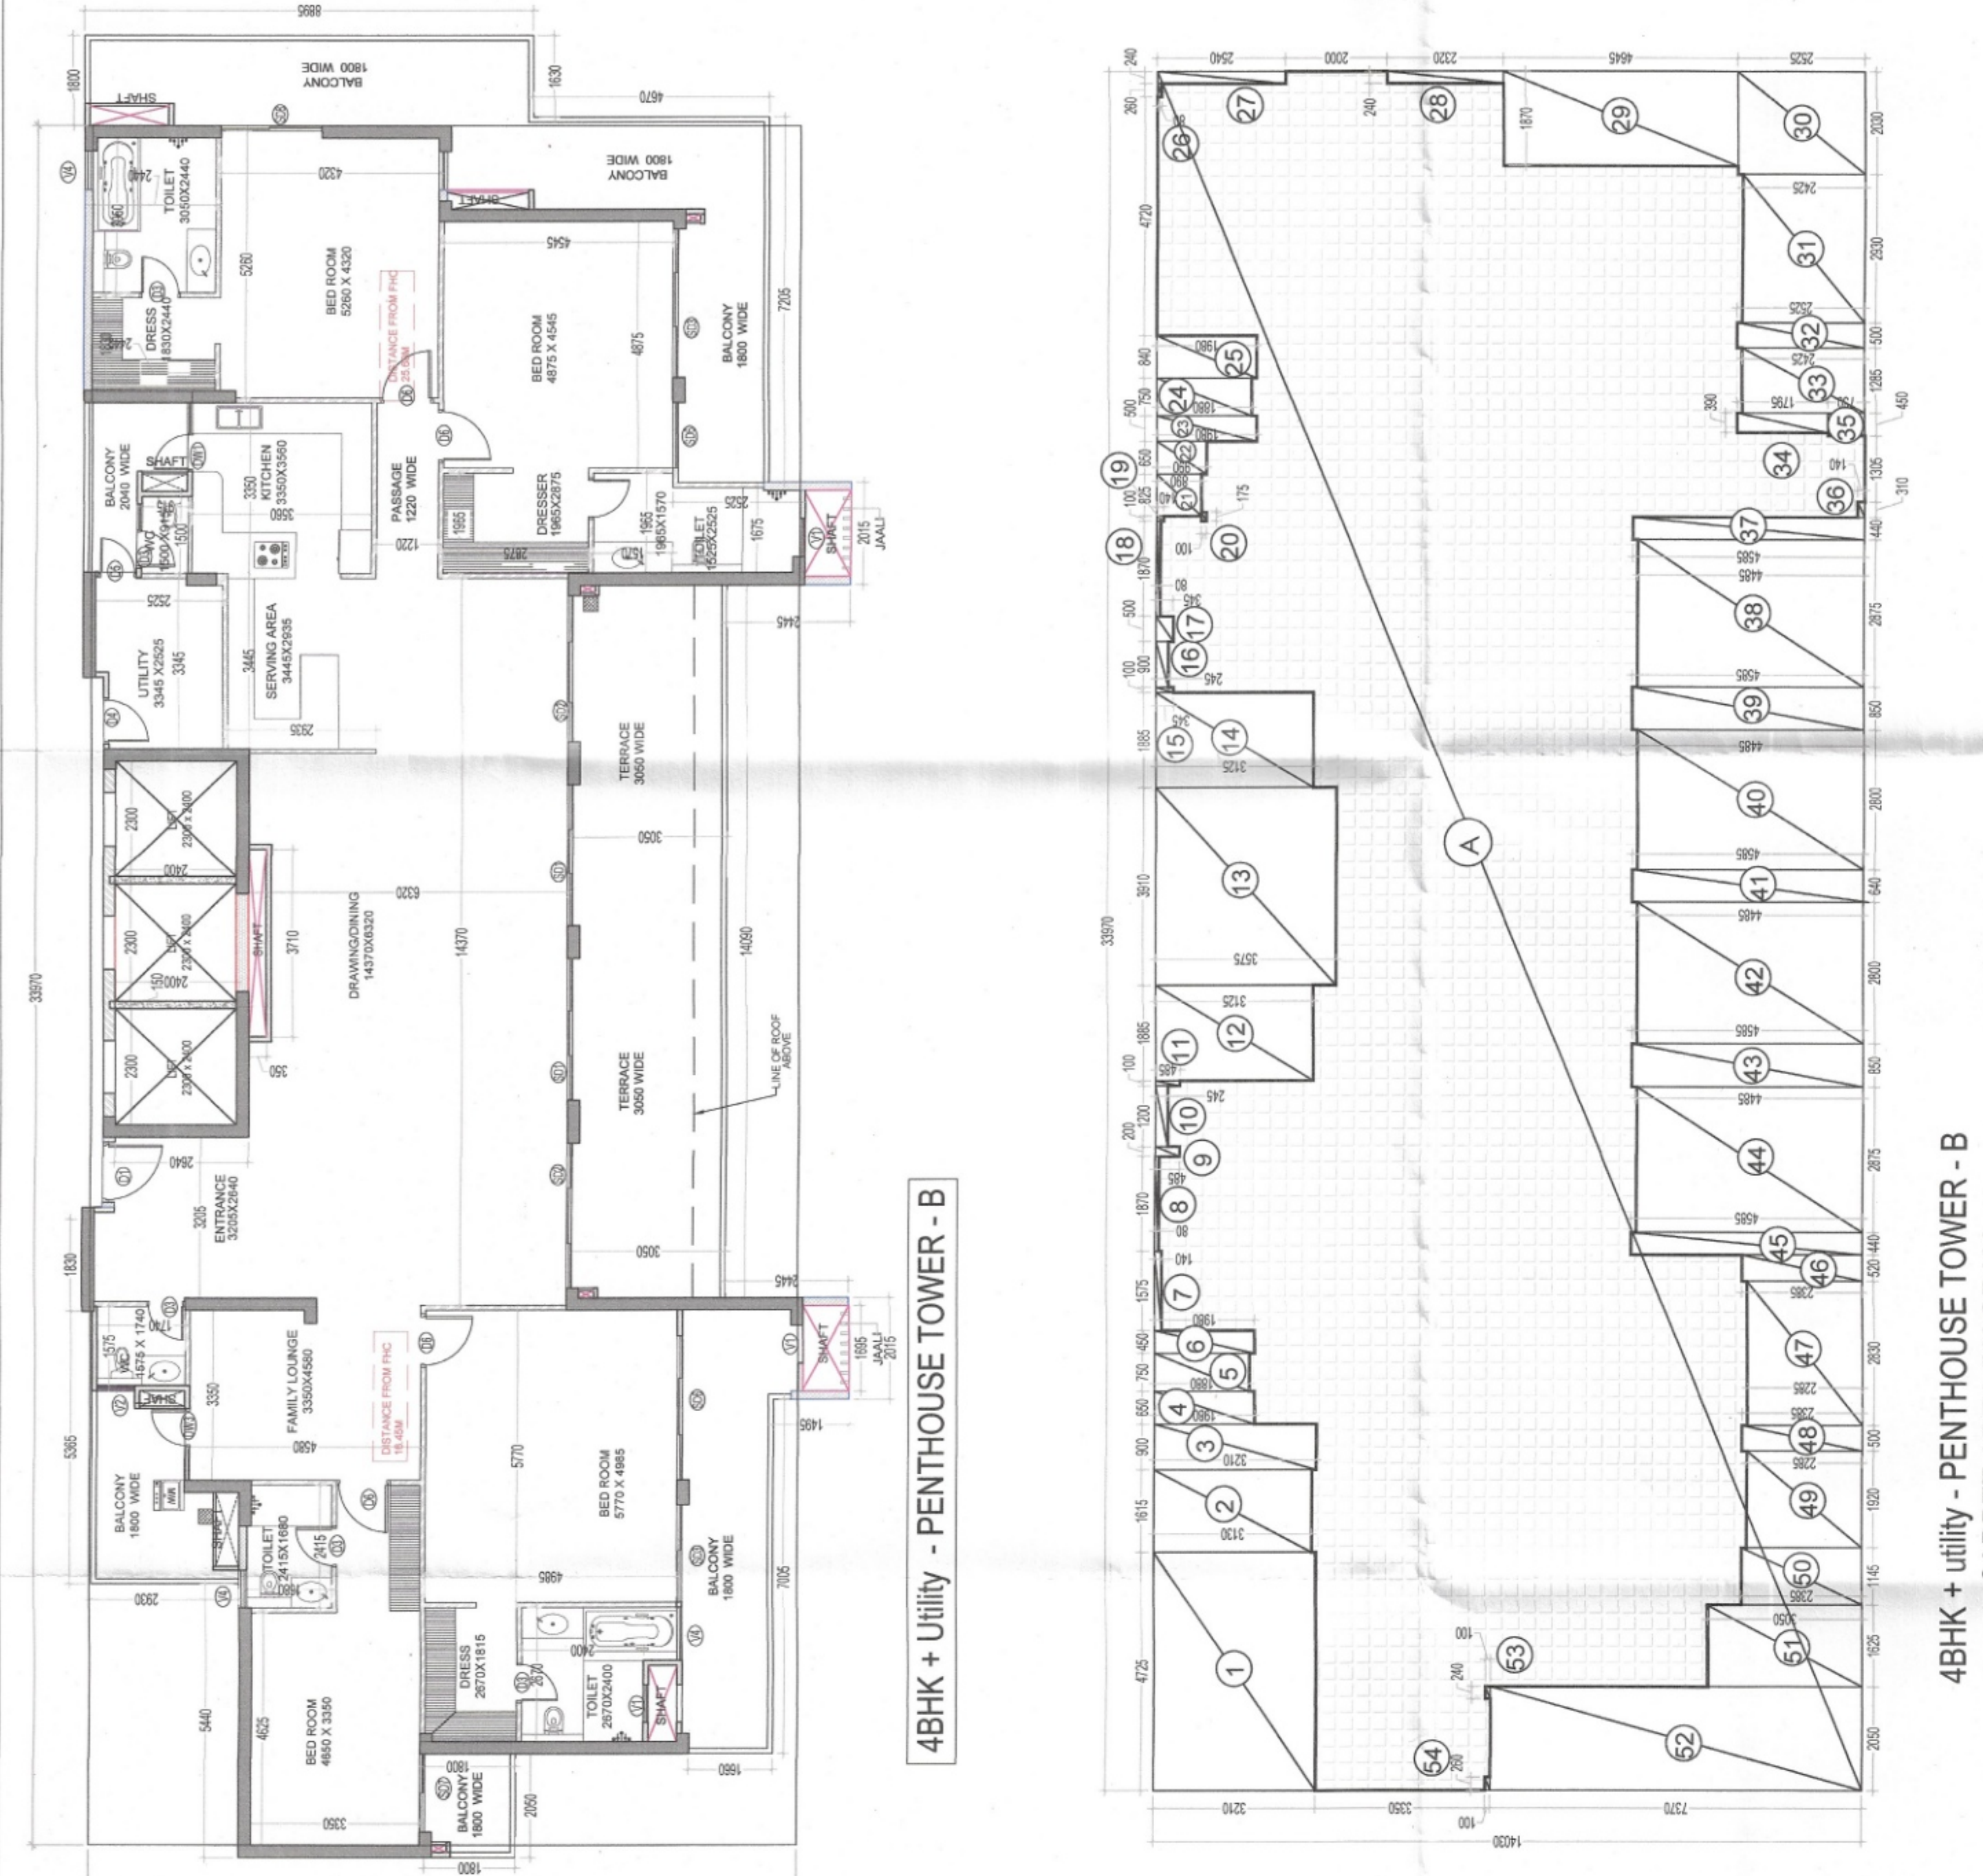

4BHK + Utility - PENTHOUSE TOWER - B



4BHK + utility - PENTHOUSE TOWER - B
CARPET AREA DIAGRAM

48HK - Utility - ENTRANCE CAMPER AREA TOWER-B (All Distances are in Meter & Areas in Sqm)									
ADDITION (A)				LENGTH (1.50/1.75/2.40/3.00)		AREA (A) * B NO. X LENGTH WIDTH		TOTAL (A) *	
ITEM	NO.3	WIDTH (1.50/1.75/2.40/3.00)	LENGTH (1.50/1.75/2.40/3.00)	NO.3 X LENGTH WIDTH	AREA (A) * B NO. X LENGTH WIDTH				
A	1	3.0/3.0	14.0/30	42.00	42.00				
					476.88				
DEDUCTION (B)					AREA (A) * B NO. X LENGTH * WIDTH				
ITEM	NO.3	WIDTH (1.50/1.75/2.40/3.00)	LENGTH (1.50/1.75/2.40/3.00)	NO.3 X LENGTH WIDTH	AREA (A) * B NO. X LENGTH * WIDTH				
1	1	4.7/25	3.2/30	15.167	15.167				
2	1	1.6/15	3.1/30	5.0/5	5.0/5				
3	1	1.6/15	3.2/30	5.120	5.120				
4	1	0.6/50	1.8/60	1.080	1.080				
5	1	0.7/50	1.8/60	1.410	1.410				
6	1	0.4/50	1.5/60	0.891	0.891				
7	1	0.4/50	1.5/60	0.891	0.891				
8	1	1.8/30	0.8/60	0.1512	0.1512				
9	1	0.2/30	0.4/65	0.026	0.026				
10	1	0.2/30	0.3/65	0.024	0.024				
11	1	0.2/30	0.3/65	0.024	0.024				

12	1	1.885	3.315	5.875	13.976
13	1	1.910	3.575		
14	1	1.935	3.835	0.052	
15	1	1.910	3.845	0.052	
16	1	1.900	3.945	0.271	
17	1	1.925	4.045	0.271	
18	1	1.970	4.090	0.155	
19	1	1.100	0.140	0.004	
20	1	1.100	0.140	0.004	
21	1	0.915	0.900	0.018	
22	1	0.950	0.900	0.044	
23	1	0.900	1.980	0.904	
24	1	0.900	1.980	0.904	
25	1	0.240	0.080	0.023	
26	1	0.240	0.080	0.023	
27	1	0.240	0.080	0.023	
28	1	0.240	2.100	0.957	
29	1	1.970	4.465	0.668	
30	1	1.970	4.465	0.668	
31	1	2.500	2.525	2.120	
32	1	0.250	2.525	1.163	
33	1	0.250	2.425	0.116	
34	1	0.250	2.425	0.116	
35	1	0.010	0.700	0.643	
36	1	0.010	0.140	0.043	
37	1	0.010	0.140	0.043	
38	1	2.875	4.485	12.864	
39	1	1.850	4.585	3.897	
40	1	1.850	4.585	3.897	
41	1	0.440	4.585	2.934	
42	1	2.800	4.485	12.558	
43	1	2.800	4.485	12.558	
44	1	2.800	4.485	12.558	
45	1	0.440	4.585	2.017	
46	1	0.030	2.385	0.242	
47	1	0.030	2.385	0.242	
48	1	0.500	2.385	1.153	
49	1	1.900	2.385	4.367	
50	1	1.900	2.385	4.367	
51	1	1.625	3.600	4.566	
52	1	2.950	2.700	15.228	
53	1	2.950	2.700	15.228	
54	1	0.300	0.100	0.020	
TOTAL				198.624	
TOTAL SHEDD AREA + ADDITIONAL REDUCTION (BP)				287.547	
- 47.628				109.952	
				207.547	
				207.547	

LEGEND:-

- ① 110 GPM FIVE MINUTE FIVE FEET PPE
- ② 110 GPM FIVE MINUTE FIVE FEET PPE
- ③ 90 GPM FIVE MINUTE FIVE FEET PPE
- ④ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑤ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑥ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑦ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑧ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑨ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑩ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑪ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑫ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑬ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑭ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑮ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑯ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑰ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑱ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑲ 90 GPM FIVE MINUTE FIVE FEET PPE
- ⑳ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉑ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉒ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉓ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉔ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉕ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉖ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉗ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉘ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉙ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉚ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉛ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉜ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉝ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉞ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㉟ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊱ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊲ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊳ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊴ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊵ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊶ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊷ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊸ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊹ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊺ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊻ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊼ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊽ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊾ 90 GPM FIVE MINUTE FIVE FEET PPE
- ㊿ 90 GPM FIVE MINUTE FIVE FEET PPE

UNITED EXHAUST FAN	FAN SIZE	EXHAUST DUCT SIZE
100W M.S. FIRE SPRINKLER PIPE (ZONE-2)	V1 750 1700	+150 TOILETS
14th FLOOR TO 28th FLOOR	V2 750 1600	+150 TOILETS
150W M.S. FIRE SPRINKLER PIPE (ZONE-3)	V3 600 1400	+150 TOILETS
15th FLOOR TO 19th FLOOR	V4 750 1200	+1250 TOILETS
29th FLOOR TO TERRACE FLOOR	G1 8205 4800	±00 ENTRANCE LOBBY ST/LT/FLOOR
50W M.S. FIRE SPRINKLER DRAIN PIPE	G2 8010 2400	±00 ENTRANCE LOBBY ST/LT/FLOOR
100W M.S. FIRE WAC-UP LINE	G3 2225 1500	±00 LIFT LOBBY
100M M.S. FIRE HORIZONTAL PIPE (LOW ZONE) ST/LT FLOOR TO 13th FLOOR	W3 1055 1550	900 BED ROOM
100M M.S. FIRE HORIZONTAL PIPE (HIGH ZONE) 14th TO TERRACE FLOOR	W4 900 1550	900 BED ROOM
	W5 1100 1550	900 BED ROOM

THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE
NOTES TO THIS DRAWING. IN THE EVENT OF ANY
DISCREPANCY BETWEEN THE VARIOUS DRAWINGS SHALL
BE BROUGHT TO THE NOTICE OF THE ARCHITECT IMMEDIATELY.
THE DRAWING SHALL NOT BE SCALED, ONLY WRITTEN DIMENSIONS
SHALL BE FOLLOWED.
LEVELS GIVEN IN THIS DRAWING ARE WITH
RESPECT TO THE CENTRE LINE OF THE FRONT ROAD AT THE MIDDLE
OF PLOT AS 4.00M.
PLEASE FOLLOW SERVICES DRAWING FOR ELECTRICAL AND
SERVICES SHAFT DETAIL
FOR STAIRS/STIFF LOBBY, TOILET, KITCHEN, RAILING AND
ROOFING DETAIL.

SANCTIONED

RECEIVED FBI NEW YORK OFFICE

APR 17 1968

NY 100-371112

Key Plan

The site plan shows a rectangular development area. A large, irregularly shaped area is labeled "PROPOSED PARKING LOT". To the right of this area, a small circular feature is labeled "TOWER B". The plan also shows "EXISTING ROADS" and "EXISTING UTILITIES". A north arrow is located in the upper right corner of the plan.

LEGEND:-

	AREA FAR
	AREA NON FAR
	SERVICE SHAFT (CUTOUT)
	2 HRS. FIRE RATED FULL HEIGHT WALL
	CARPET AREA

Candidates also focus oil for routine health
(General) Service only subject to comments in
the forwarding report No. 4-652-09254/MS

Sgt. [Signature]
Squad Training Engineer (HQ)
for
Engineer-I
HSPF, Alameda

UNION
 Union Buildmart Pvt.Ltd. Vibrant Infracore Pvt. Ltd.
 Targe Buildcon Pvt in Collaboration with
 Union Buildmart Pvt. Ltd

architect:

 GANP MATHEP AND ASSOCIATES (P) LTD.
 C-35, East of Kailash, New Delhi-110005
 T: 011-46595959 / F: 011-46595912
 E: info@ganpindia.com / IV: www.ganpindia.com
 ARCHITECTS
 & PLANNERS

Project Title:	PROPOSED BUILDING PLAN OF PHASE - 2 GROUP HOUSING COLONY (MIX LAND USE RESIDENTIAL 99.5% AND 0.5% COMMERCIAL) IN THE AREA MEASURING 10.225 ACRES INCENCE NO. 229 OF 2023 DATED 02-11-2023 SECTOR -113, GURUGRAM
Sheet Title	RESIDENTIAL TOWER - B PENTHOUSE FLOOR LVL LAYOUT PLAN & CARPET AREA DETAIL
Author's Sign	Architect's Sign

100% Resident Private Limited Authorized Signatory	SCALE: 1: 100	DWG. No. SD/AR/M3M-113A/T-B-106