

DRG. NO.: 2723F-04

PROJECT:
PROPOSED GROUP HOUSING (GH1)
BUILDING PLAN AN AREA MEASURING
0.75989 ACRES IN SECTOR-23 & 23A,
GURUGRAM, BEING DEVELOPED BY:-
M/S META DESIGN SOLUTIONS PVT. LTD.

Certified that the Fire Fighting Scheme is as per the C.O. Part-IV, revised 2016


Fire Fighting Scheme Approval
Vide letter No. 2723F-04/2024
Dated: 22.07.2024

Director
Gurugram

OPENING SCHEDULE		
S.NO	TYPE	HEIGHT (IN MM)
1	D1	750
2	D2	850
3	D3	950
4	D4	1200
5	D5	1500
6	D6	1800
7	FD1	2100
8	FD2	2100
9	FD3	2100
10	W1	1800
11	W2	1800
12	W3	1500
13	W4	1200
14	W5	1500
15	W6	1500
16	W7	1500
17	W8	1500
18	W9	1500
19	W10	1500
20	W11	1500
21	W12	1500
22	GL1	570

1X1800 CFM AXIAL FLOW FAN FOR EXHAUST

LEGEND	
	SPRINKLER (PENDENT TYPE)
	SPRINKLER HEAD (SIDE WALL TYPE) NORMAL THROW
	SPRINKLER (PENDENT TYPE)
	FD1 = FIRE SMOKE CHECK DOOR SIZE = 1.25X2.1M HT.
	FD2 = FIRE SMOKE CHECK DOOR SIZE = 1.5X2.1M HT.
	FD3 = FIRE SMOKE CHECK DOOR SIZE = 0.6X2.1M HT. (FOR L.V. SHAFT & ELEC. SHAFT)
	150Ø BUTTERFLY VALVE
	FLOW SWITCH
	FD= FIRE DOOR
	1HR RATED MAIN UNIT DOOR OF FLATS SIZE = 1.2X2.10M HT.
	4KG ABC FIRE EXTINGUISHER
	4.5KG CO2 FIRE EXTINGUISHER
	MANUAL CALL POINT
	HOOTER
	100Ø WET RISER WITH 1/2" B.S.P. BRANCH PIPE 2 NOS. RLL HOSE (15M LENGTH), 30M LENGTH HOSE REEL (25M DIA) AND FIRE MAN AXES
	ED = EXIT DOOR SIZE = 2.4X2.1M HT.

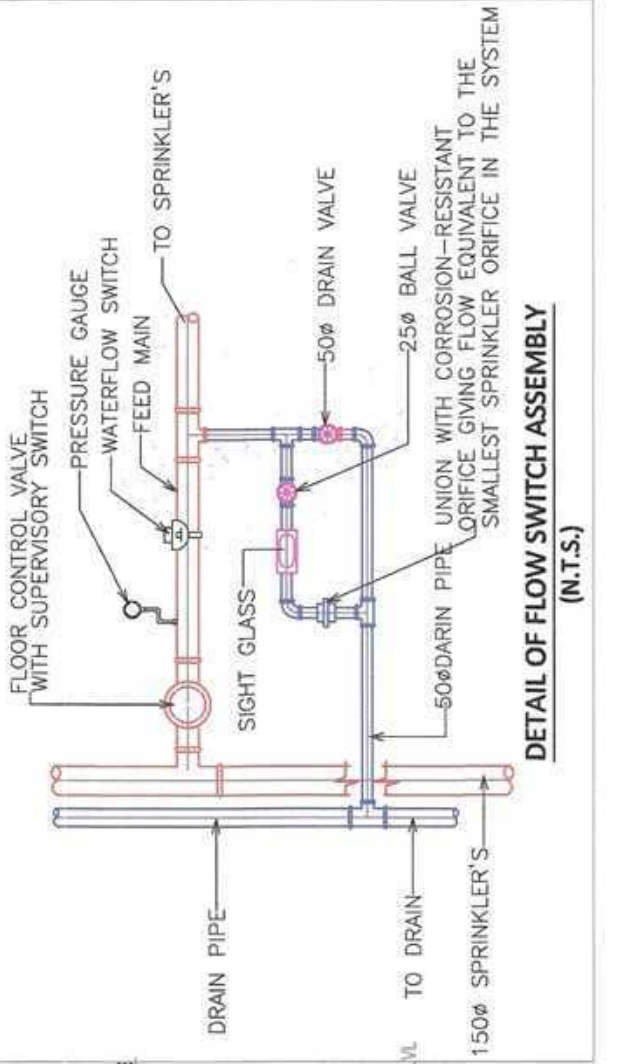

IT IS CERTIFIED THAT DRAWINGS ARE AS PER ORIGINAL DRAWING APPROVED BY BUILDING PLAN COMMITTEE FOR PROPOSED GROUP HOUSING SOCIETIES HSVP CIRCLE GURUGRAM

MEMO NO. - 7268
DATED -06/07/2024

For: MetaDesign Solutions Pvt. Ltd.
Director

OWNER'S SIGN
ARCHITECT'S SIGN

OWNER'S SIGNATURE
ARCHITECT'S SIGNATURE



FIRE CONSULTANTS SIGNATURE

E.P. RAMKUNWAR
CONSULTING ENGINEERING SERVICES
& Mechanical Ventilation System
100, Indra Colony-1, Sector-22, Gurugram (Hr.)
Mob. : 9899004192

FIRE PROTECTION CONSULTANT
RAMKUNWAR AND ASSOCIATES
CONSULTING ENGINEERING SERVICES
100, G.F. INDRAL COLONY-1
SECTOR-22, GURUGRAM.
MOB. 9899004192

DRG. NO. 2723F-04
DATE JULY 2024
SCALE 1:150
DRAWN BY: SWEETY
AT

