



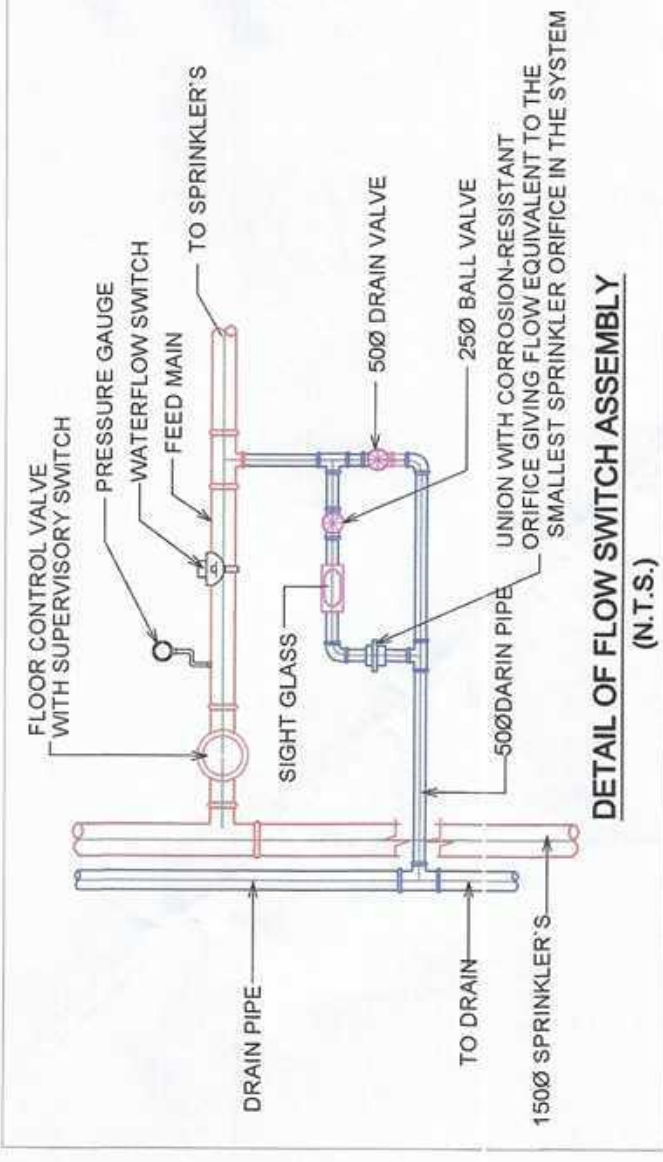

S.NO.	DESCRIPTION	LPM	HEAD (MT.)
1	D.P. DIESEL STAND BY PUMP	2280	90
2	H.P. HYDRANT PUMP	2280	90
3	S.P. SPRINKLER PUMP	2280	90
4	S.U.P. SPRINKLER JOCKEY PUMP	180	90
5	H.U.P. HYDRANT JOCKEY PUMP	180	90
6	W.C.P. WATER CURTAIN PUMP	900	60

SPRINKLER PIPE	
PENDENT SPRINKLER	①
SMOKE DETECTOR	②
4KG ABC FIRE EXTINGUISHER	☒
4.5KG CO2 FIRE EXTINGUISHER	●
MANUAL CALL POINT	◼
HOOTER	☒
150# WET RISER WITH SINGLE HYDRANT VALVE, 2 NOS RRL, HOSE (15M LENGTH), 30M REEL (25M DIA) AND FIRE MAN AXES	☒ FHC
FD =FIRE SMOKE CHECK DOOR SIZE =0.60X2.1M HT. (FOR LV / ELEC. SHAFT)	☒ FD3
FD2 =FIRE SMOKE CHECK DOOR SIZE =1.25X2.4M HT.	☒ FD1
EXTENDED SIDE WALL SPRINKLER	☒
WATER CURTAIN NOZZLE	☒
DELUGE VALVE	☒
BUTTER FLY VALVE	☒
WATER CURTAIN PIPE	☒
150# BUTTERFLY VALVE	☒
FLOW SWITCH	☒

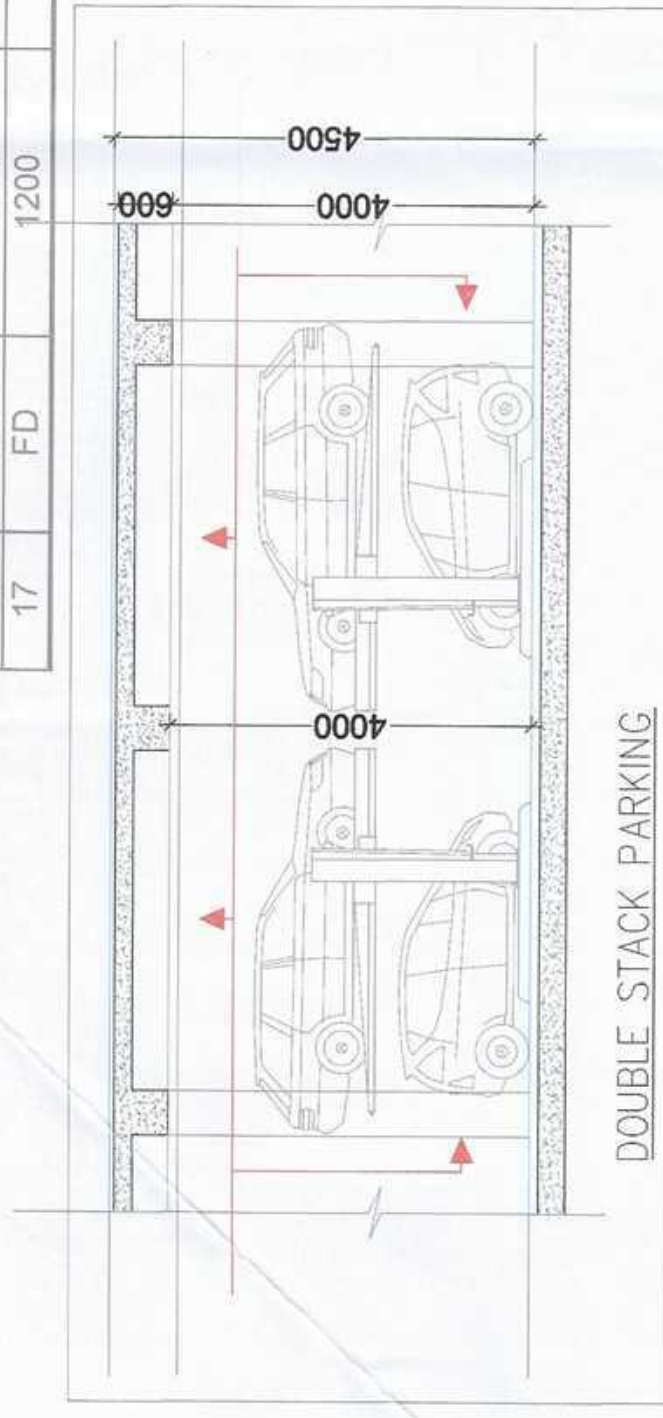

MEMO NO. - 7268
DATED - 05/07/2024

etaDesign Solutions Pvt. Ltd. Director

✓✓

DOUBLE STACK PARKING

OWNER'S SIGN _____

ARCHITECT'S SIGN

ORG. TITLE
FIRE SUBMISSION
MIDDLE BASEMENT PLAN,
ORDER BASEMENT PLAN

DRG. NO.	2723/F-02
SIZE	A1

DRG. NO.	2723/F-02
SIZE	A1