



HARYANA VIDYUT PRASARAN NIGAM LIMITED

Regd. Office: Shakti Bhawan, Plot No. C-4, Sector-6, Panchkula, 134109
Corporate Identity Number: U40101HR1997SGC033683
Superintending Engineer, Trans. System Circle, Gurugram
Office: Mehrauli Road, Gurugram-122001, Haryana
Website: www.hvpn.org.in, Email - setsagn@hvpn.org.in
Telephone No.: 0124-2320318

To



The Executive Engineer,
TS Division, HVPNL,
Manesar

Memo No.-Ch-09/TSG-595

Dated: 07.07.2025

Sub:

Approval for shifting/re-routing of part section of 66kV S/C Badshahpur-Sector-35 line between TL no. 23 to TL no. 24A from overhead to underground through XLPE power cable infringing the land of M/s Birla Estates Pvt. Limited in Sector-71, Gurugram as a deposit work of M/s Birla Estates Private limited.

The Whole time Directors and Worthy ACS Energy cum Chairman accorded the approval for shifting/re-routing of part section of 66kV S/C Badshahpur-Sector-35 line between TL no. 23 to TL no. 24A from overhead to underground through XLPE power cable infringing the land of M/s Birla Estates Pvt. Limited in Sector-71, Gurugram as a deposit work of M/s Birla Estates Private limited on dated 13.02.2025 and 31.03.2025 respectively circulated vide CE/TS HVPNL, Hisar office memo no. Ch-75/CETS-675Vol-XIV dated 04.04.2025.

In view of the above, the final route plan for above mentioned work submitted by your office vide memo no. Ch-07/Birla, dated 05.05.2024 has been examined & approved by this office.

The salient features of the route for laying of underground cables which are as under:-

Material to be erected:-

1. Cable Route length	=	153 Meters
2. Cable Required (153+25+10)X 4	=	752 Meters
3. Cable size	=	1200sqmm XLPE
4. RCC Trench	=	153 Meters
5. Monopole BXA 13M PD/DE(0°-15°)	=	01 No.
6. UGFO	=	190 mtrs

Material to be dismantled:-

1. Conductor 0.15 Sq inch ACSR(112X3)	=	336 Meters
2. Earth wire	=	112 mtrs
3. Monopole BXA 13M PD/DE (0°-15°)	=	02 No.


However following is required to be adhered strictly while carried out execution of work:-

1. All clearance w.r.t. buildings, ground, transmission lines and other existing structures would be maintain as per I.E rule.
2. It may be ensured that R.O.W do not infringe forest land being environment issue. If so required clearance be obtained immediately.
3. The requisite approval from local bodies /HSIIDC/ NHAI /GMDA /GAIL /DMRC/IOCL etc. wherever required be obtained immediately by the GMDA, so as to avoid hindrance while construction of line.
4. The requisite ROW shall be arranged by the firm with all time access of the site to HVPNL for maintenance/modification work from future perspective.
5. All the dismantled/spare material i.e. Monopole/cable etc. if any shall be handed over to HVPNL.
6. Turning radius of XLPE cable mentioned in route plan of minimum 20D be maintained.
7. While laying the cable, follow all electricity clearance as per IE rules.



The approval is accordingly conveyed.

The approved copy of the same is sent to your office for taking further necessary action.

DA/As above

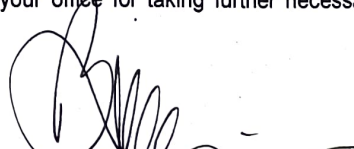
SE/TS Circle,
HVPNL, Gurugram

FINAL ROUTE FOR SHIFTING OF 64 KV SEC BRUSHMABIR, SEC-36 LINE BETWEEN TL NO 23 TO TL NO 24A DUE TO INFRINGING THE LAND OF MS BIRLA ESTATE PVT. LTD.

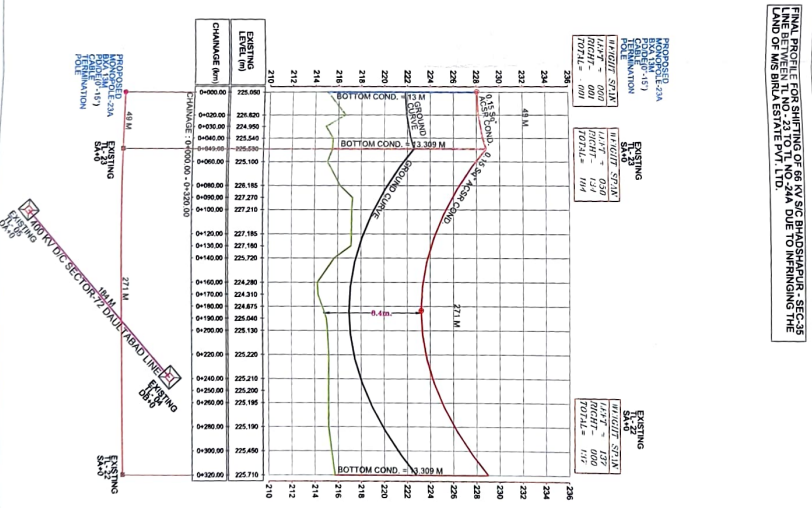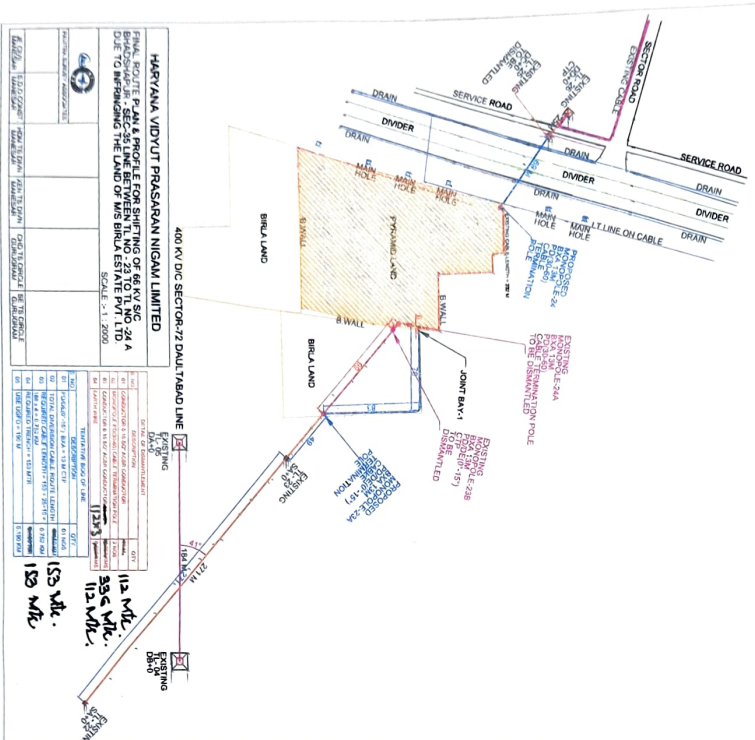

UNDERSTANDING

1. THE ROUTE IS ACCEPTABLE TO MS BIRLA ESTATE PVT. LTD.
2. MS BIRLA ESTATE PVT. LTD. SHALL BE RESPONSIBLE FOR THE CORRECTION OF THE OVERHEAD AND CABLE ROUTE.
3. THE ROUTE SHALL BE MAINTAINED AND WORK SHALL BE DONE BY MS BIRLA ESTATE PVT. LTD.
4. NECESSARY CLEARANCE FROM BIRLA LAND, GOVT. GULF, LOCAL, AND OTHER CONCERNED AGENCIES SHALL BE OBTAINED BY MS BIRLA ESTATE PVT. LTD.
5. MS BIRLA ESTATE PVT. LTD. SHALL PROVIDE A CLEAR PASSAGE FOR ALL THE ACCESS TO THE RIGHT OF WAY TO STAKE HOLDER.
6. MS BIRLA ESTATE PVT. LTD. SHALL MAINTAIN ALL TIES & WORKS.
7. MS BIRLA ESTATE PVT. LTD. SHALL MAINTAIN ALL TIES & WORKS.

APPROVED SIGNATORY

MS BIRLA ESTATE PVT. LTD.

APPROVED SIGNATORY

MS BIRLA ESTATE PVT. LTD.

APPROVED SIGNATORY

MS BIRLA ESTATE PVT. LTD.