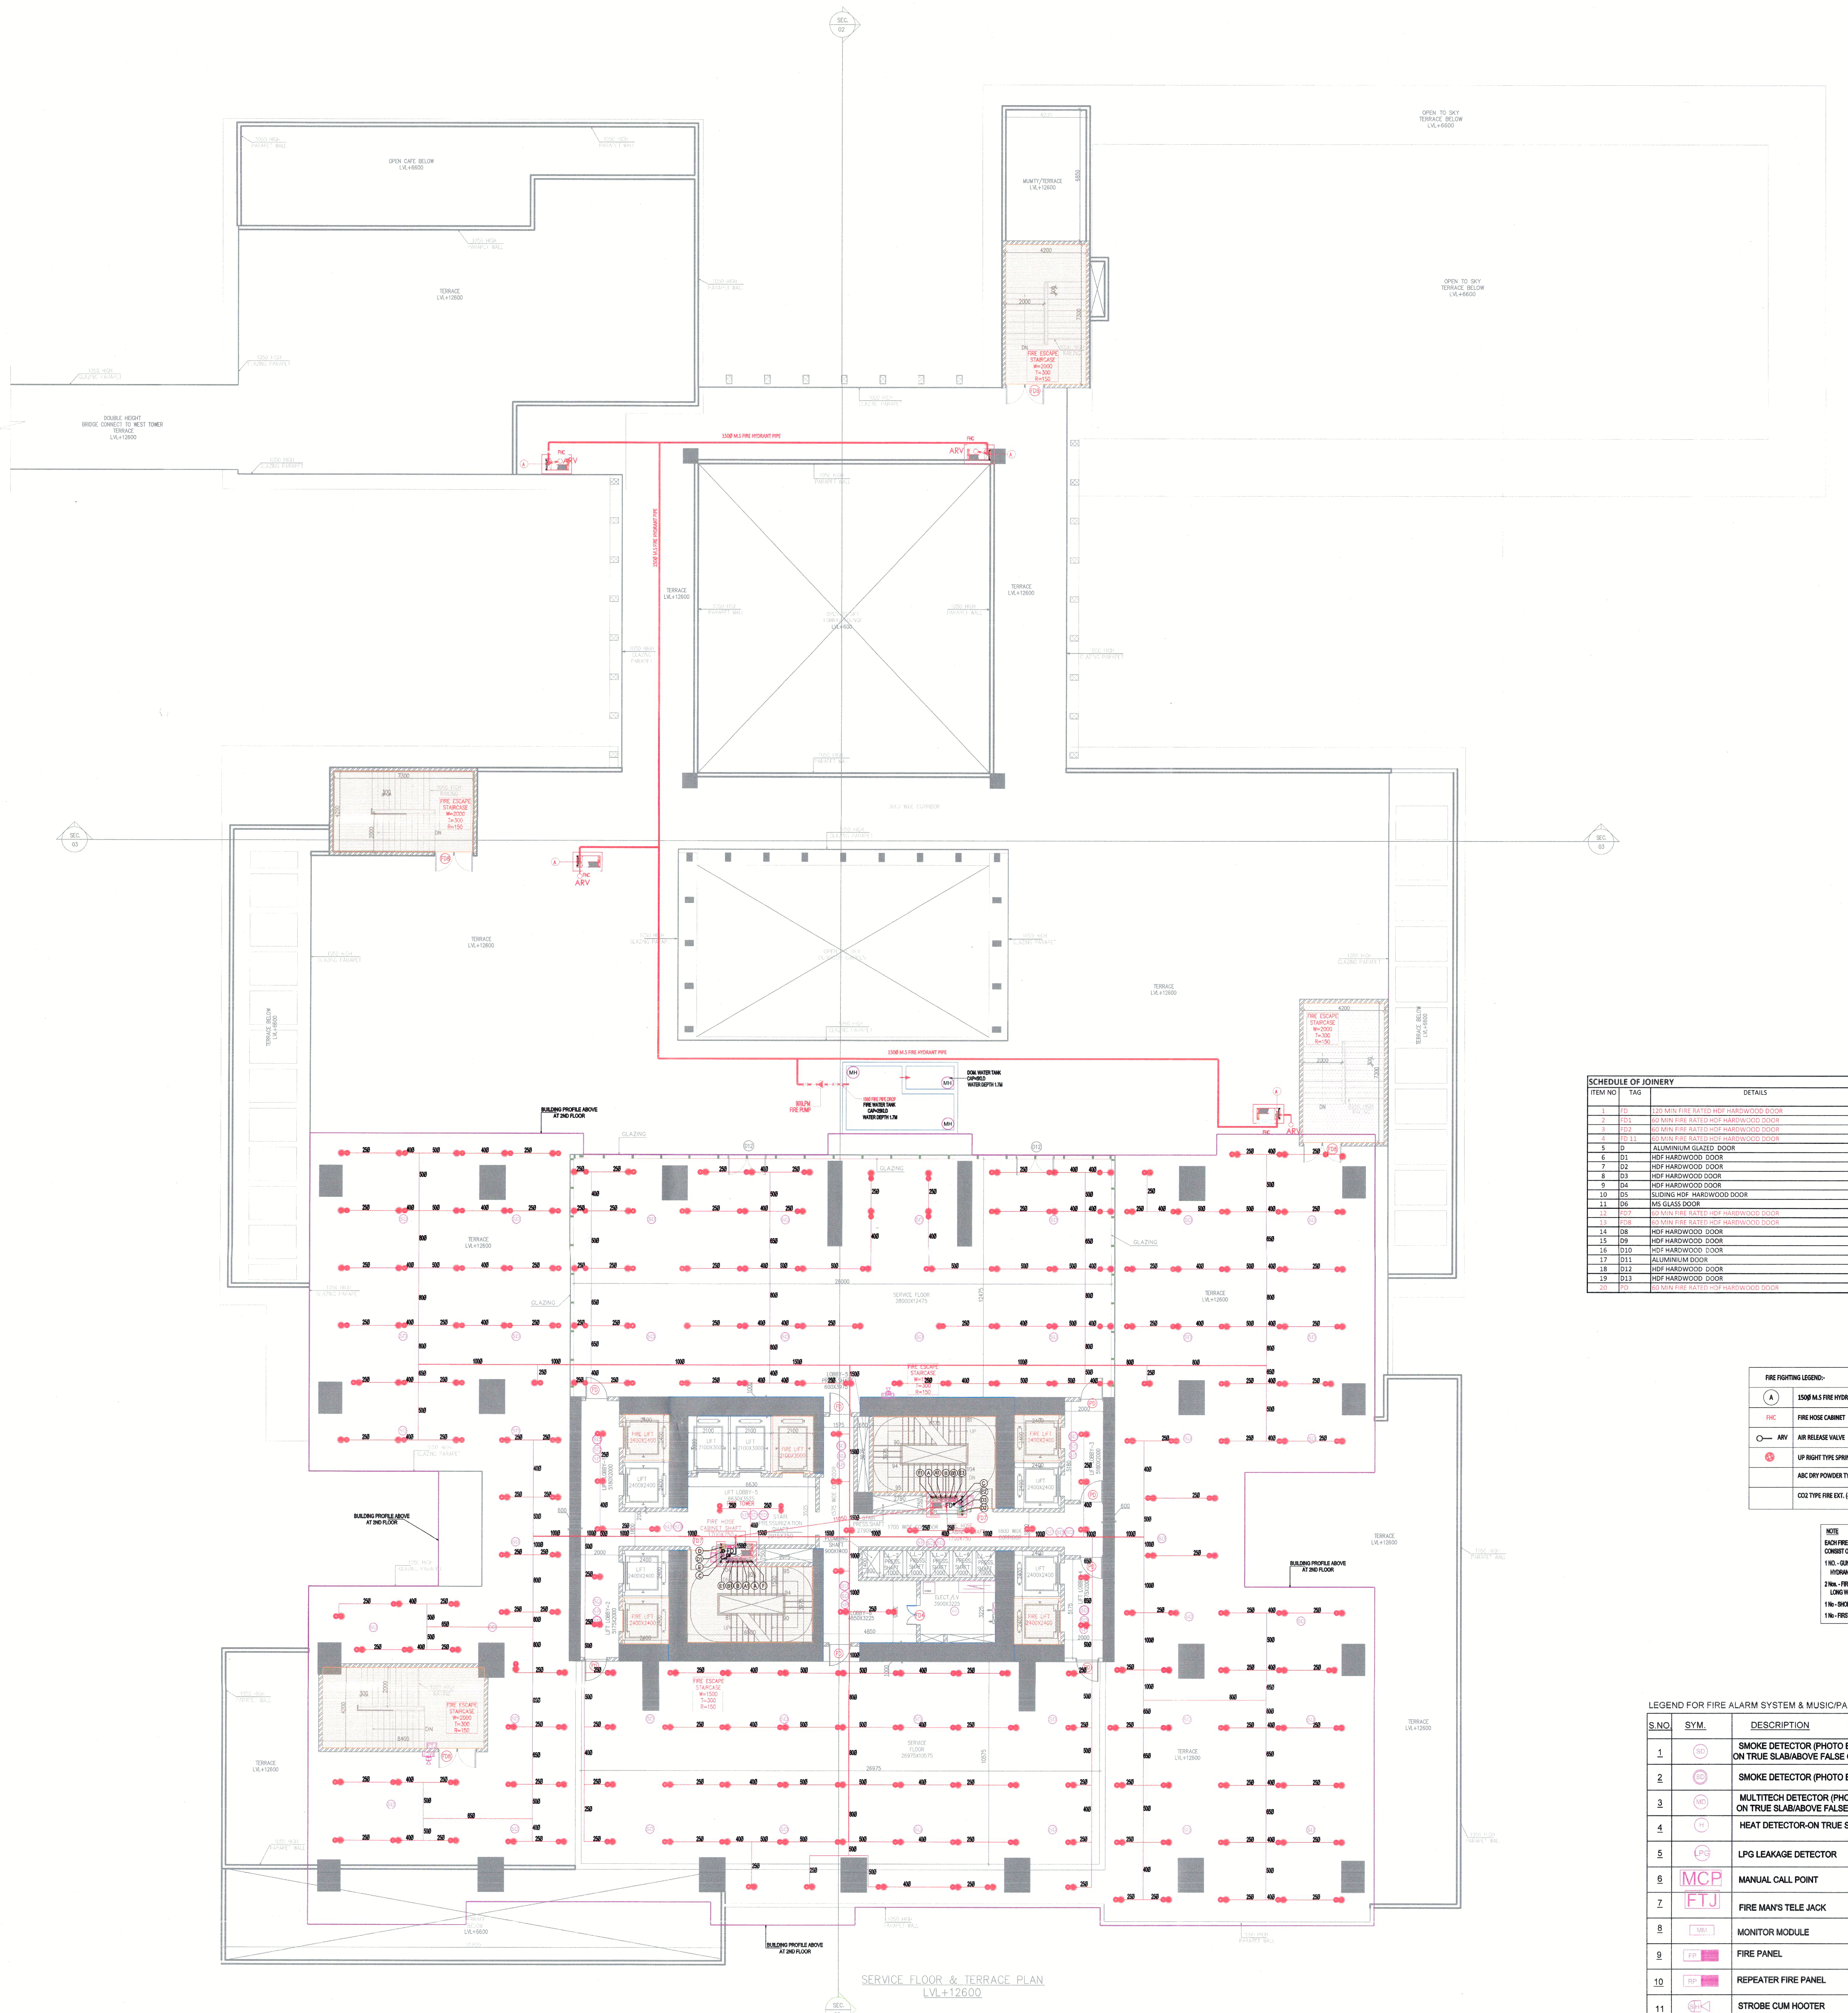

SERVICE FLOOR & TERRACE PLAN
LVL+12600

SCHEDULE OF JOINERY

ITEM NO	TAG	DETAILS	SIZE WIDTH	SIZE HEIGHT	LOCATION
1	FD	120 MIN FIRE RATED HDF HARDWOOD DOOR	1100	2400	REFUGE ENTRY DOOR
2	FD1	60 MIN FIRE RATED HDF HARDWOOD DOOR	1200	2400	ALL MAIN ENTRY DOOR (REFUGE FLOOR)
3	FD2	60 MIN FIRE RATED HDF HARDWOOD DOOR	1200	2100	ELECTRIC SHAFT
4	FD 11	60 MIN FIRE RATED HDF HARDWOOD DOOR	1000	2100	SERVICE SHAFT
5	D	ALUMINIUM GLAZED DOOR	1200	2400	BALCONY DOOR
6	D1	HDF HARDWOOD DOOR	1200	2400	ENTRY DOOR
7	D2	HDF HARDWOOD DOOR	1000	2400	BEDROOM DOORS
8	D3	HDF HARDWOOD DOOR	850	2400	KITCHEN DOORS/TOILET DOOR
9	D4	HDF HARDWOOD DOOR	750	2400	UTILITY/BALCONY/TOILET DOORS
10	D5	SLIDING HDF HARDWOOD DOOR	650	2400	CARETAKER ROOM TOILET
11	D6	MS GLASS DOOR	900	2400	FHC's
12	FD7	60 MIN FIRE RATED HDF HARDWOOD DOOR	1100	2400	STARCASE DOOR-PERFORATED DOOR
13	FD8	60 MIN FIRE RATED HDF HARDWOOD DOOR	2000	2400	STARCASE DOOR-PERFORATED DOOR
14	D8	HDF HARDWOOD DOOR	1200	2400	MACHINE ROOM TERRACE
15	D9	HDF HARDWOOD DOOR	750	2100	PLUMBING SHAFT
16	D10	HDF HARDWOOD DOOR	1000	2400	HANDICAP TOILET (STILT)
17	D11	ALUMINIUM DOOR	1000	2400	KITCHEN DOOR (OPENING IN BALCONY)
18	D12	HDF HARDWOOD DOOR	600	2100	SHAFT DOOR
19	D13	HDF HARDWOOD DOOR	2000	2100	ENTRY DOOR
20	PD	60 MIN FIRE RATED HDF HARDWOOD DOOR	1000	2400	PRIVATE LIFT LOBBY

FIRE FIGHTING LEGEND:-

A	150Ø M.S FIRE HYDRANT PIPE
FHC	FIRE HOSE CABINET
ARV	AIR RELEASE VALVE
	UP RIGHT TYPE SPRINKLER
	ABC DRY POWDER TYPE FIRE EXT. (6.0KG)
	CO2 TYPE FIRE EXT. (4.5KG)

NOTE

EACH FIRE HOSE CABINET SHALL CONSIST OF
1 NO. - GUNMETAL SINGLE HEADED HYDRANT VALVE (63mm).
2 Nos. - FIRE HOSES 63mm 15M LONG WITH ACCESSORIES.
1 No - SHORT BRANCH PIPE
1 No - FIRST AID HOSE REEL

LEGEND FOR FIRE ALARM SYSTEM & MUSIC/PA SYSTEM

S.NO.	SYM.	DESCRIPTION
1	SD	SMOKE DETECTOR (PHOTO ELECTRIC-OPTICAL) ON TRUE SLAB/ABOVE FALSE CEILING
2	SD	SMOKE DETECTOR (PHOTO ELECTRIC-OPTICAL)- ON FALSE CEILING
3	MD	MULTITECH DETECTOR (PHOTO-THERMAL) ON TRUE SLAB/ABOVE FALSE CEILING
4	H	HEAT DETECTOR-ON TRUE SLAB/ABOVE FALSE CEILING
5	LPG	LPG LEAKAGE DETECTOR
6	MCP	MANUAL CALL POINT
7	FTJ	FIRE MAN'S TELE JACK
8	MM	MONITOR MODULE
9	FP	FIRE PANEL
10	RP	REPEATER FIRE PANEL
11	SH	STROBE CUM HOOTER
12	H	HOOTER
13	SP	SPEAKER FIRE- CEILING MOUNTED

Note :-

1. BUILDING WILL BE DESIGNED (STRUCTURES) AS PER RELEVANT IS CODES FOR EARTH QUAKE RESISTANCE.

PROJECT

REVISED BUILDING PLANS OF COMMERCIAL COLONY(TOD) MEASURING 17.4875 ACRES (LICENCE NO. 240 OF 2007 DATED 25.10.2007) AND 6.99025 ACRES (LICENCE NO. 239 OF 2007 DATED 25.10.2007, LICENCE NO. 241 OF 2007 DATED 25.10.2007 & LICENCE NO. 199 OF 2008 DATED 8.12.2008) TOTALLING **24.47775 ACRES** IN SECTOR-62, GURUGRAM MANESAR URBAN COMPLEX BEING DEVELOPED BY PIONEER URBAN LAND & INFRASTRUCTURE LTD.

CLIENT

Pioneer Urban
Ground Floor
Near GOLF Course Extension Road,
Sector-62,
Gurugram -122001 Haryana

DESIGN ARCHITECT

RSP
RSP Design consultants
(India) Pvt. Ltd.
103, First Floor, Bestech Business Tower, Sector: 48, Sohna Road
Gurgaon, 122018, India TEL: 4706868 FAX: 4706818
HEAD OFFICE:NO.30, MUSEUM ROAD, BANGALORE-560 001
TEL: 25596868 FAX:25596818
EMAIL: rsp@rspindia.net ; www.rspindia.net

ASSOCIATE ARCHITECT

RSMS ARCHITECTS
RSMS ARCHITECTS PVT. LTD.
69,Nora Niwas Bhawani Kunj
(Behind D2), Vasant Kunj,
New Delhi-110070.
Tel.:011-26898616,26898617
www.rsms-arch.com

FIRE SUBMISSION

IT IS CERTIFIED THAT THESE DRAWING ARE AS PER APPROVED DWG BY STP (CHAIRMAN,BUILDING PLAN APPROVAL COMMITTEE) GURUGRAM , HARYANA
VIDE MEMO NO. ZP-338-II/PA(DK)/2025/31457 DATED 13-08-2025

ARCHITECT'S SEAL & SIGNATURE

OWNER'S SEAL & SIGNATURE

JUNE.-2024
Scale : 1:100
Drawing Title:-
SERVICE FLOOR & TERRACE PLAN
FIRE FIGHTING LAYOUT
(CLUB)
Drawing No:-
SNC-CLB-FF-03
23112024-3
N